

Firetox

LSZH Flame Retardant Power & Control Cables


www.caledonian-cables.co.uk www.addison-cables.com



Caledonian


» | TABLE OF CONTENTS

- 01/** 300/500V LSZH Insulated, Non-sheathed Power Cables to BS EN 50525-3-31 (Single Core)
- 04/** 300/500V LSZH Insulated, Non-sheathed Power Cables to BS EN 50525-3-41 (Single Core)
- 07/** 300/500V XLPE Insulated, LSZH Sheathed Power Cables to BS 7211 (Single Core)
- 10/** 300/500V XLPE Insulated, LSZH Sheathed Power Cables to BS 7211 (2-3 Cores)
- 13/** 300/500V XLPE Insulated, LSZH Sheathed, Screened Power Cables to BS 8436 (2-4 Cores)
- 16/** 450/750V LSZH Insulated, Non-sheathed Power Cables to BS EN 50525-3-31 (Single Core)
- 21/** 450/750V LSZH Insulated, Non-sheathed Power Cables to BS EN 50525-3-41 (Single Core)
- 25/** 450/750V XLPE Insulated, LSZH Sheathed Power Cables to BS 7211 (Single Core)
- 29/** 450/750V XLPE Insulated, LSZH Sheathed Power Cables to BS 7211 (2-5 Cores)
- 34/** 600/1000V LSZH Insulated, Non-sheathed Power Cables to BS EN 50525-3-41 (Single Core)
- 38/** 600/1000V XLPE Insulated, LSZH Sheathed Power Cables to BS 8573 (Single Core)
- 42/** 600/1000V XLPE Insulated, LSZH Sheathed Power Cables to IEC 60502-1 (Single Core)

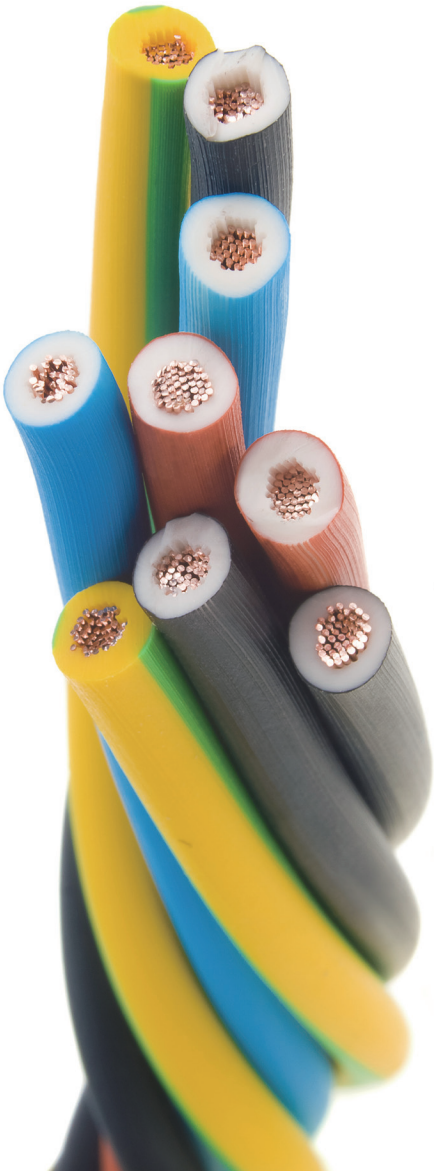

» | TABLE OF CONTENTS

- 46/** 600/1000V XLPE Insulated, LSZH Sheathed, Armoured Power Cables to BS 6724 (Single Core)
- 50/** 600/1000V XLPE Insulated, LSZH Sheathed, Armoured Power Cables to IEC 60502-1 (Single Core)
- 54/** 600/1000V XLPE Insulated, LSZH Sheathed Power Cables to BS 8573 (2-5 Cores)
- 59/** 600/1000V XLPE Insulated, LSZH Sheathed Power Cables to IEC 60502-1 (2-5 Cores & Multicore)
- 65/** 600/1000V XLPE Insulated, LSZH Sheathed, Armoured Power Cables to BS 6724 (2-5 Cores)
- 70/** 600/1000V XLPE Insulated, LSZH Sheathed, Armoured Power Cables to IEC 60502-1 (2-4 Cores)
- 75/** Type Codes for LSZH Flame Retardant Power & Control Cables
- 76/** Technical Information for Fire Properties

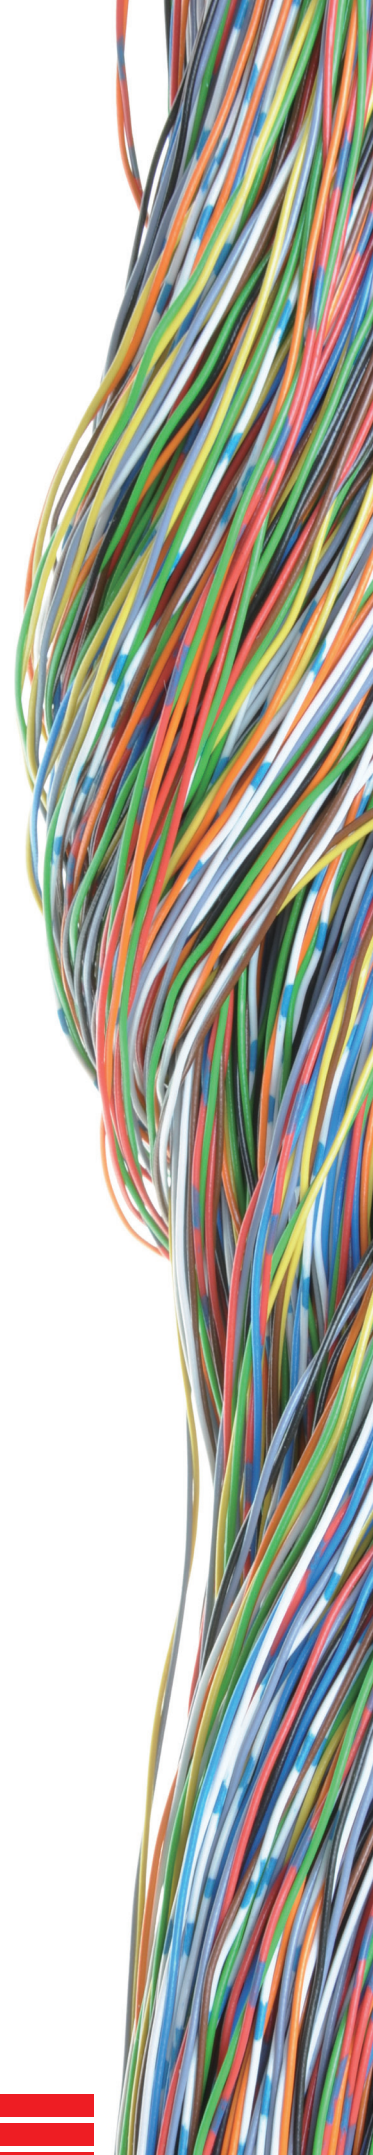



Caledonian



FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

300/500V LSZH Insulated, Non-sheathed Power Cables to BS EN 50525-3-31 (Single Core)

FTX100 05Z1-U/R/K (CU/LSZH 300/500V Class 1/2/5)

HAR Code: H05Z1-U/R/K

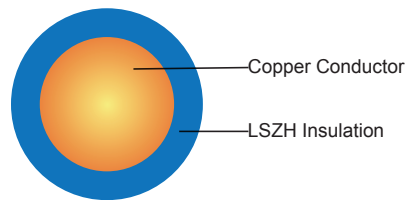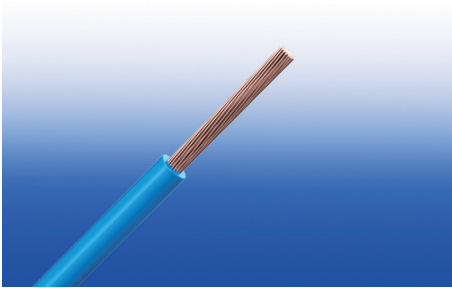

APPLICATION

The cables are mainly used in power stations, mass transit underground passenger systems, airports, petrochemical plants, hotels, hospitals and high-rise buildings.

STANDARDS

Basic design to BS EN 50525-3-31

FIRE PERFORMANCE

| | |
|---|-------------------------------|
| Flame Retardance (Single vertical wire or cable test) | IEC 60332-1-2; EN 60332-1-2 |
| Reduced Fire Propagation (Vertically-mounted bundled wires & cables test) | IEC 60332-3-24; EN 60332-3-24 |
| Halogen Free | IEC 60754-1; EN 50267-2-1 |
| No Corrosive Gas Emission | IEC 60754-2; EN 50267-2-2 |
| Minimum Smoke Emission | IEC 61034-2; EN 61034-2 |

VOLTAGE RATING

300/500V

CABLE CONSTRUCTION

Conductor: Copper conductor according to BS EN 60228 class 1/2/5.

Insulation: Thermoplastic compound of type TI 7 to EN 50363-7.

Insulation Option: UV resistance, hydrocarbon resistance, oil resistance, anti-rodent and anti-termite properties can be offered as option.

COLOUR CODE

Black, Blue, Brown, Grey, Orange, Pink, Red, Turquoise, Violet, White, Green and Yellow. Bi-colours of any combination of the above mono-colours are permitted.

PHYSICAL AND THERMAL PROPERTIES**Maximum temperature range during operation:** 70°C**Maximum short circuit temperature (5 Seconds):** 160°C**Minimum bending radius:** 4 x Overall Diameter**CONSTRUCTION PARAMETERS**

| Conductor | | FTX100 05Z1-U/R/K | | | |
|-------------------------------------|-----------------|------------------------------|-----------------------|-----------------------|----------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Min. Overall Diameter | Max. Overall Diameter | Approx. Weight |
| No. × mm ² | | mm | mm | mm | kg/km |
| 1×0.50 | 1 | 0.6 | 1.9 | 2.3 | 9.4 |
| 1×0.75 | 1 | 0.6 | 2.1 | 2.5 | 12.2 |
| 1×1.0 | 1 | 0.6 | 2.2 | 2.7 | 15.4 |
| 1×0.50 | 2 | 0.6 | 2.0 | 2.4 | 10.1 |
| 1×0.75 | 2 | 0.6 | 2.2 | 2.6 | 13.0 |
| 1×1.0 | 2 | 0.6 | 2.3 | 2.8 | 16.8 |
| 1×0.50 | 5 | 0.6 | 2.1 | 2.5 | 9.9 |
| 1×0.75 | 5 | 0.6 | 2.2 | 2.7 | 13.3 |
| 1×1.0 | 5 | 0.6 | 2.4 | 2.8 | 16.2 |

ELECTRICAL PROPERTIES**Conductor operating temperature:** 70°C**Ambient temperature:** 30°C**Current-Carrying Capacities (Amp)**

| Conductor Cross-sectional Area | Single-phase a.c. | Three-phase a.c. |
|--------------------------------|-------------------|------------------|
| mm ² | A | A |
| 0.5 | 3 | 3 |
| 0.75 | 6 | 6 |
| 1.0 | 10 | 10 |

Note: These values apply to the majority of cases. Further information should be sought in unusual cases eg.:

- (i) When high ambient temperatures are involved, ie. above 30°C
- (ii) Where long lengths are used
- (iii) Where ventilation is restricted
- (iv) Where the cords are used for other purposes, e.g. internal wiring of apparatus.



Caledonian


FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

Voltage Drop (Per Amp Per Meter)

| Conductor cross-sectional area | 2 cables d.c. | 2 cables, single-phase a.c. | | | 3 or 4 cables, three-phase a.c. | | | |
|--------------------------------|---------------|--|---|----------------|--|---|-----------------------|----------------------|
| | | Ref. Methods A&B (enclosed in conduit or trunking) | Ref. Methods C, F&G (clipped direct, on trays or in free air) | | Ref. Methods A&B (enclosed in conduit or trunking) | Ref. Methods C, F&G (clipped direct, on trays or in free air) | | |
| | | | Cables touching | Cables spaced* | | Cables touching, Trefoil | Cables touching, Flat | Cables spaced*, Flat |
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 |
| mm ² | mV/A/m | mV/A/m | mV/A/m | mV/A/m | mV/A/m | mV/A/m | mV/A/m | mV/A/m |
| 0.5 | 93 | 93 | 93 | 93 | 80 | 80 | 80 | 80 |
| 0.75 | 62 | 62 | 62 | 62 | 54 | 54 | 54 | 54 |
| 1.0 | 46 | 46 | 46 | 46 | 40 | 40 | 40 | 40 |

Note: *Spacings larger than one cable diameter will result in a large voltage drop.



Rated Voltage




Standard



Flame Retardancy
IEC 60332-1-2



Reduced Fire Propagation
IEC 60332-3-24



Halogen Free
IEC 60754-1



Low Corrosivity
IEC 60754-2





Low Smoke Emission
IEC 61034-2

300/500V LSZH Insulated, Non-sheathed Power Cables to BS EN 50525-3-41 (Single Core)

FTX100 05Z-U/K (CU/LSZH 300/500V Class 1/5)

BS Code: 2491B

HAR Code: H05Z-U/K

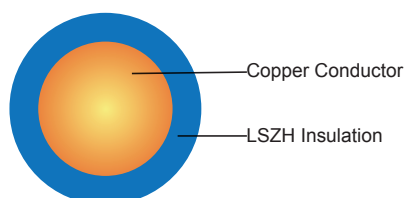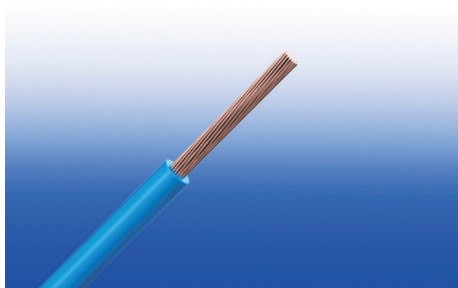

APPLICATION

The cables are mainly used in power stations, mass transit underground passenger systems, airports, petrochemical plants, hotels, hospitals and high-rise buildings.

STANDARDS

Basic design to BS EN 50525-3-41(formerly BS 7211)

FIRE PERFORMANCE

| | |
|---|-----------------------------|
| Flame Retardance (Single vertical wire or cable test) | IEC 60332-1-2; EN 60332-1-2 |
| Halogen Free | IEC 60754-1; EN 50267-2-1 |
| No Corrosive Gas Emission | IEC 60754-2; EN 50267-2-2 |
| Minimum Smoke Emission | IEC 61034-2; EN 61034-2 |

VOLTAGE RATING

300/500V

CABLE CONSTRUCTION

Conductor: Copper conductor according to BS EN 60228 class 1/5.

Insulation: Crosslinked polyolefin material type EI 5 according to EN 50363-5.

Insulation Option: UV resistance, hydrocarbon resistance, oil resistance, anti-rodent and anti-termite properties can be offered as option.

COLOUR CODE

Black, Blue, Brown, Grey, Orange, Pink, Red, Turquoise, Violet, White, Green and Yellow. Bi-colours of any combination of the above mono-colours are permitted.



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

PHYSICAL AND THERMAL PROPERTIES

Maximum temperature range during operation: 90°C

Maximum short circuit temperature (5 Seconds): 250°C

Minimum bending radius: 4 × Overall Diameter

CONSTRUCTION PARAMETERS

| Conductor | | FTX100 05Z-U/K | | | |
|-------------------------------------|-----------------|------------------------------|-----------------------|-----------------------|----------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Min. Overall Diameter | Max. Overall Diameter | Approx. Weight |
| No. × mm ² | | mm | mm | mm | kg/km |
| 1×0.50 | 1 | 0.6 | 1.9 | 2.4 | 9.4 |
| 1×0.75 | 1 | 0.6 | 2.1 | 2.6 | 12.2 |
| 1×1.0 | 1 | 0.6 | 2.2 | 2.8 | 15.4 |
| 1×0.50 | 5 | 0.6 | 2.1 | 2.6 | 9.9 |
| 1×0.75 | 5 | 0.6 | 2.2 | 2.8 | 13.3 |
| 1×1.0 | 5 | 0.6 | 2.4 | 2.9 | 16.2 |

ELECTRICAL PROPERTIES

Conductor operating temperature: 90°C

Ambient temperature: 30°C

Current-Carrying Capacities (Amp)

| Conductor cross-sectional area | Single-phase a.c. | Three-phase a.c. |
|--------------------------------|-------------------|------------------|
| mm ² | A | A |
| 0.5 | 3 | 3 |
| 0.75 | 6 | 6 |
| 1.0 | 10 | 10 |


Note: These values apply to the majority of cases. Further information should be sought in unusual cases eg.:

- (i) When high ambient temperatures are involved, ie. above 30°C
- (ii) Where long lengths are used
- (iii) Where ventilation is restricted
- (iv) Where the cords are used for other purposes, e.g. internal wiring of apparatus.

Voltage Drop (Per Amp Per Meter) according to BS 7671:2008 table 4E1B

| Conductor cross-sectional area | 2 cables d.c. | 2 cables, single-phase a.c. | | | 3 or 4 cables, three-phase a.c. | | | |
|--------------------------------|---------------|--|---|----------------|--|---|-----------------------|----------------------|
| | | Ref. Methods A&B (enclosed in conduit or trunking) | Ref. Methods C, F&G (clipped direct, on trays or in free air) | | Ref. Methods A&B (enclosed in conduit or trunking) | Ref. Methods C, F&G (clipped direct, on trays or in free air) | | |
| | | | Cables touching | Cables spaced* | | Cables touching, Trefoil | Cables touching, Flat | Cables spaced*, Flat |
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 |
| mm ² | mV/A/m | mV/A/m | mV/A/m | mV/A/m | mV/A/m | mV/A/m | mV/A/m | mV/A/m |
| 0.5 | 101 | 101 | 101 | 101 | 87 | 87 | 87 | 87 |
| 0.75 | 68 | 68 | 68 | 68 | 59 | 59 | 59 | 59 |
| 1.0 | 50 | 50 | 50 | 50 | 44 | 44 | 44 | 44 |

Note: *Spacings larger than one cable diameter will result in a large voltage drop.




Rated Voltage



Standard



Flame Retardancy
IEC 60332-1-2



Halogen Free
IEC 60754-1



Low Corrosivity
IEC 60754-2



Low Smoke Emission
IEC 61034-2



Caledonian



FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

300/500V XLPE Insulated, LSZH Sheathed Power Cables to BS 7211 (Single Core)

FTX300 05RZ1-U (CU/XLPE/LSZH 300/500V Class 1)

BS Code: 6241B

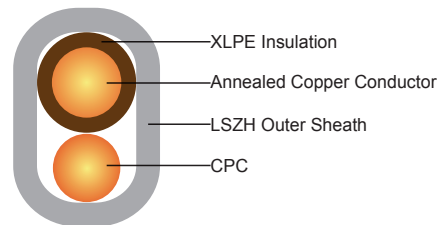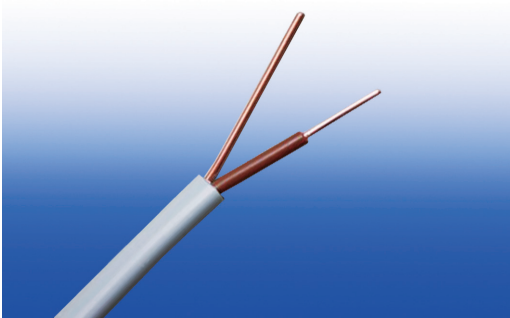

APPLICATION

The cables are mainly used in power stations, mass transit underground passenger systems, airports, petrochemical plants, hotels, hospitals and high-rise buildings.

STANDARDS

Basic design to BS 7211:2012

FIRE PERFORMANCE

| | |
|---|-------------------------------|
| Flame Retardance (Single vertical wire or cable test) | IEC 60332-1-2; EN 60332-1-2 |
| Reduced Fire Propagation (Vertically-mounted bundled wires & cables test) | IEC 60332-3-24; EN 60332-3-24 |
| Halogen Free | IEC 60754-1; EN 50267-2-1 |
| No Corrosive Gas Emission | IEC 60754-2; EN 50267-2-2 |
| Minimum Smoke Emission | IEC 61034-2; EN 61034-2 |

VOLTAGE RATING

300/500V

CABLE CONSTRUCTION

Conductor: Annealed copper conductor, solid according to BS EN 60228 class 1.

Insulation: XLPE type GP8 according to BS 7655-1.3. Crosslinked polyolefin material type EI 5 according to EN 50363-5 can be offered as option.

CPC (Circuit Protective Conductor): Uninsulated copper conductor.

Outer Sheath: Extruded LSZH type LTS 2 according to BS 7655-6.1.

Outer Sheath Option: UV resistance, hydrocarbon resistance, oil resistance, anti-rodent and anti-termite properties can be offered as option.

COLOUR CODE

Insulation Colour: Brown or blue.

Sheath Colour: White; other colours can be offered upon request.

PHYSICAL AND THERMAL PROPERTIES

Maximum temperature range during operation: 90°C

Maximum short circuit temperature (5 Seconds): 250°C

Minimum bending radius: 4 × Overall Diameter

CONSTRUCTION PARAMETERS

| Conductor | | FTX300 05RZ1-U | | | | | | |
|-------------------------------------|-----------------|------------------------------|-----------------------------|--------------|------------------------------|-------------------------|-------------------------|----------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Cross-sectional Area of CPC | Class of CPC | Nominal Insulation Thickness | Min. Overall Dimensions | Max. Overall Dimensions | Approx. Weight |
| No.×mm ² | | mm | mm ² | | mm | mm | mm | kg/km |
| 1×1.0 | 1 | 0.70 | 1.0 | 1 | 0.9 | 4.1x5.2 | 5.0x6.3 | 45 |
| 1×1.5 | 1 | 0.70 | 1.0 | 1 | 0.9 | 4.4x5.4 | 5.3x6.6 | 55 |

ELECTRICAL PROPERTIES

Conductor operating temperature: 90°C

Ambient temperature: 30°C

Current-Carrying Capacities (Amp) according to BS 7671:2008 table 4E1A

| Conductor cross-sectional area | Ref. Method A (enclosed in conduit in thermally insulating wall etc.) | | Ref. Method B (enclosed in conduit on a wall or in trunking etc.) | | Ref. Method C (clipped direct) | |
|--------------------------------|---|---------------------------------|---|---------------------------------|---|--|
| | 2 cables, single-phase a.c. or d.c. | 3 or 4 cables, three-phase a.c. | 2 cables, single-phase a.c. or d.c. | 3 or 4 cables, three-phase a.c. | 2 cables, single-phase a.c. or d.c. flat and touching | 3 or 4 cables, three-phase a.c. flat and touching or trefoil |
| | 2 | 3 | 4 | 5 | 6 | 7 |
| mm ² | A | A | A | A | A | A |
| 1.0 | 14 | 13 | 17 | 15 | 19 | 17.5 |
| 1.5 | 19 | 17 | 23 | 20 | 25 | 23 |



Caledonian


FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

Voltage Drop (Per Amp Per Meter) according to BS 7671:2008 table 4E1B

| Conductor cross-sectional area | 2 cables d.c. | 2 cables, single-phase a.c. | | | 3 or 4 cables, three-phase a.c. | | | |
|--------------------------------|---------------|--|---|----------------|--|---|-----------------------|----------------------|
| | | Ref. Methods A&B (enclosed in conduit or trunking) | Ref. Methods C, F&G (clipped direct, on trays or in free air) | | Ref. Methods A&B (enclosed in conduit or trunking) | Ref. Methods C, F&G (clipped direct, on trays or in free air) | | |
| | | | Cables touching | Cables spaced* | | Cables touching, Trefoil | Cables touching, Flat | Cables spaced*, Flat |
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 |
| mm ² | mV/A/m | mV/A/m | mV/A/m | mV/A/m | mV/A/m | mV/A/m | mV/A/m | mV/A/m |
| 1.0 | 46 | 46 | 46 | 46 | 40 | 40 | 40 | 40 |
| 1.5 | 31 | 31 | 31 | 31 | 27 | 27 | 27 | 27 |

Note: *Spacings larger than one cable diameter will result in a large voltage drop.



Rated Voltage




Standard



Flame Retardancy
IEC 60332-1-2



Reduced Fire Propagation
IEC 60332-3-24



Halogen Free
IEC 60754-1



Low Corrosivity
IEC 60754-2





Low Smoke Emission
IEC 61034-2

300/500V XLPE Insulated, LSZH Sheathed Power Cables to BS 7211 (2-3 Cores)

FTX200 05RZ1-U/R (CU/XLPE/LSZH 300/500V Class 1/2)

BS Code: 6242B/6243B

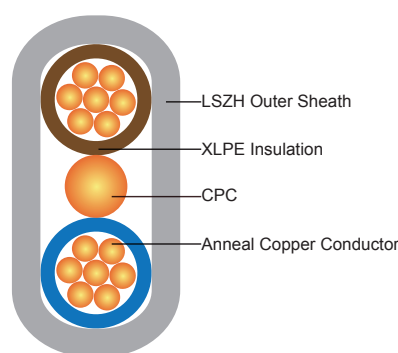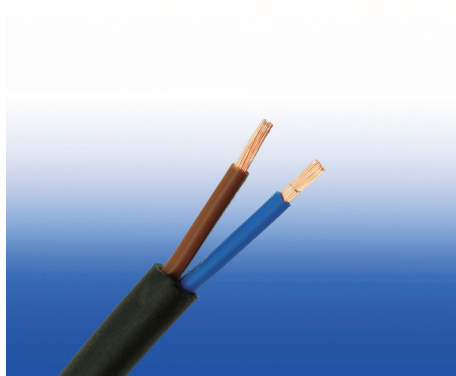

APPLICATION

The cables are mainly used in power stations, mass transit underground passenger systems, airports, petrochemical plants, hotels, hospitals and high-rise buildings.

STANDARDS

Basic design to BS 7211:2012

FIRE PERFORMANCE

| | |
|---|-------------------------------|
| Flame Retardance (Single vertical wire or cable test) | IEC 60332-1-2; EN 60332-1-2 |
| Reduced Fire Propagation (Vertically-mounted bundled wires & cables test) | IEC 60332-3-24; EN 60332-3-24 |
| Halogen Free | IEC 60754-1; EN 50267-2-1 |
| No Corrosive Gas Emission | IEC 60754-2; EN 50267-2-2 |
| Minimum Smoke Emission | IEC 61034-2; EN 61034-2 |

VOLTAGE RATING

300/500V

CABLE CONSTRUCTION

Conductor: Annealed copper conductor, solid or stranded according to BS EN 60228 class 1 or class 2.

Insulation: XLPE type GP8 according to BS 7655-1.3. Crosslinked polyolefin material type EI 5 according to EN 50363-5 can be offered as option.

CPC (Circuit Protective Conductor): Uninsulated copper conductor.

Outer Sheath: Extruded LSZH type LTS 2 according to BS 7655-6.1.

Outer Sheath Option: UV resistance, hydrocarbon resistance, oil resistance, anti-rodent and anti-termite properties can be offered as option.



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

COLOUR CODE

Insulation Colour:

Twin: Brown and blue or, for 2x1.0 and 2x1.5 cables, brown and brown.

Three cores: Brown, black (centre core) and grey.

Position of CPC:

Twin: Centrally placed between cores in same plane.

Three cores: Centrally placed between black and grey cores in same plane.

Sheath Colour: White; other colours can be offered upon request.

PHYSICAL AND THERMAL PROPERTIES

Maximum temperature range during operation: 90°C

Maximum short circuit temperature (5 Seconds): 250°C

Minimum bending radius

OD<8mm: 4 × Overall Diameter

8mm≤OD≤12mm: 5 × Overall Diameter

OD>12mm: 6 × Overall Diameter

CONSTRUCTION PARAMETERS

| Conductor | | FTX200 05RZ1-U/R | | | | | | |
|-------------------------------------|-----------------|------------------------------|-----------------------------|--------------|--------------------------|-------------------------|-------------------------|----------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Cross-sectional Area of CPC | Class of CPC | Nominal Sheath Thickness | Min. Overall Dimensions | Max. Overall Dimensions | Approx. Weight |
| No. × mm ² | | mm | mm ² | | mm | mm | mm | kg/km |
| 2×1.0 | 1 | 0.7 | 1.0 | 1 | 0.9 | 4.1×7.6 | 5.0×9.2 | 68 |
| 2×1.5 | 1 | 0.7 | 1.0 | 1 | 0.9 | 4.4×8.1 | 5.3×9.7 | 85 |
| 2×2.5 | 1 | 0.7 | 1.5 | 1 | 1.0 | 4.9×9.3 | 6.0×11.2 | 120 |
| 3×1.0 | 1 | 0.7 | 1.0 | 1 | 0.9 | 4.1×10.0 | 5.0×12.1 | 91 |
| 3×1.5 | 1 | 0.7 | 1.0 | 1 | 0.9 | 4.4×10.7 | 5.3×12.9 | 115 |
| 3×2.5 | 1 | 0.7 | 1.5 | 1 | 1.0 | 4.9×12.0 | 6.0×14.6 | 170 |
| 2×1.0 | 2 | 0.7 | 1.0 | 1 | 0.9 | 4.2×7.8 | 5.1×9.4 | 73 |
| 2×1.5 | 2 | 0.7 | 1.0 | 1 | 0.9 | 4.5×8.3 | 5.4×10.0 | 90 |
| 2×2.5 | 2 | 0.7 | 1.5 | 1 | 1.0 | 5.0×9.5 | 6.1×11.4 | 125 |
| 2×4 | 2 | 0.7 | 1.5 | 1 | 1.0 | 5.5×10.4 | 6.7×12.6 | 175 |
| 2×6 | 2 | 0.7 | 2.5 | 1 | 1.1 | 6.2×12.0 | 7.5×14.6 | 240 |
| 2×10 | 2 | 0.7 | 4.0 | 2 | 1.2 | 7.3×14.5 | 8.8×17.5 | 390 |
| 2×16 | 2 | 0.7 | 6.0 | 2 | 1.3 | 8.4×17.0 | 10.1×20.5 | 560 |
| 3×4 | 2 | 0.7 | 1.5 | 1 | 1.0 | 5.5×14.0 | 6.7×16.9 | 196 |
| 3×6 | 2 | 0.7 | 2.5 | 1 | 1.1 | 6.2×16.2 | 7.5×19.5 | 291 |
| 3×10 | 2 | 0.7 | 4.0 | 2 | 1.2 | 7.3×19.5 | 8.8×23.6 | 440 |
| 3×16 | 2 | 0.7 | 6.0 | 2 | 1.3 | 8.4×22.8 | 10.1×27.6 | 670 |

ELECTRICAL PROPERTIES

Conductor operating temperature: 90°C

Ambient temperature: 30°C


Current-Carrying Capacities (Amp) according to BS 7671:2008 table 4E2A

| Conductor cross-sectional area | Ref. Method A (enclosed in conduit in thermally insulating wall etc.) | | Ref. Method B (enclosed in conduit on a wall or in trunking etc.) | | Ref. Method C (clipped direct) | | Ref. Method E (free air or on a perforated cable tray etc. horizontal or vertical) | |
|--------------------------------|---|---|---|---|--|---|--|---|
| | 1 two-core cable*, single-phase a.c. or d.c. | 1 three-or four core cable*, three-phase a.c. | 1 two-core cable*, single-phase a.c. or d.c. | 1 three-or four core cable*, three-phase a.c. | 1 two-core cable*, single-phase a.c. or d.c. | 1 three-or four core cable*, three-phase a.c. | 1 two-core cable*, single-phase a.c. or d.c. | 1 three-or four core cable*, three-phase a.c. |
| | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 |
| mm ² | A | A | A | A | A | A | A | A |
| 1.0 | 14.5 | 13 | 17 | 15 | 19 | 17 | 21 | 18 |
| 1.5 | 18.5 | 16.5 | 22 | 19.5 | 24 | 22 | 26 | 23 |
| 2.5 | 25 | 22 | 30 | 26 | 33 | 30 | 36 | 32 |
| 4 | 33 | 30 | 40 | 35 | 45 | 40 | 49 | 42 |
| 6 | 42 | 38 | 51 | 44 | 58 | 52 | 63 | 54 |
| 10 | 57 | 51 | 69 | 60 | 80 | 71 | 86 | 75 |
| 16 | 76 | 68 | 91 | 80 | 107 | 96 | 115 | 100 |

Note: With or without a protective conductor.

Voltage Drop (Per Amp Per Meter) according to BS 7671:2008 table 4E2B

| Conductor cross-sectional area | Two-core cable, d.c. | Two-core cable, single-phase a.c. | Three- or four core cable, three-phase a.c. |
|--------------------------------|----------------------|-----------------------------------|---|
| 1 | 2 | 3 | 4 |
| mm ² | mV/A/m | mV/A/m | mV/A/m |
| 1.0 | 46 | 46 | 40 |
| 1.5 | 31 | 31 | 27 |
| 2.5 | 19 | 19 | 16 |
| 4 | 12 | 12 | 10 |
| 6 | 7.9 | 7.9 | 6.8 |
| 10 | 4.7 | 4.7 | 4.0 |
| 16 | 2.9 | 2.9 | 2.5 |



Rated Voltage




Standard



Flame Retardancy
IEC 60332-1-2




Reduced Fire Propagation
IEC 60332-3-24



Halogen Free
IEC 60754-1



Low Corrosivity
IEC 60754-2



Low Smoke Emission
IEC 61034-2





Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

300/500V XLPE Insulated, LSZH Sheathed, Screened Power Cables to BS 8436 (2-4 Cores)

FTX200 05ROZ1-U/R/K (CU/XLPE/OSCR/LSZH 300/500V Class 1/2/5)

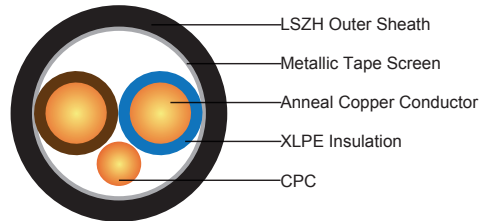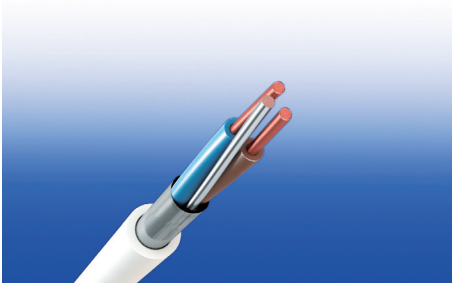

APPLICATION

The cables are mainly used in power stations, mass transit underground passenger systems, airports, petrochemical plants, hotels, hospitals and high-rise buildings.

STANDARDS

Basic design to BS 8436:2011

FIRE PERFORMANCE

| | |
|---|-----------------------------|
| Flame Retardance (Single vertical wire or cable test) | IEC 60332-1-2; EN 60332-1-2 |
| Halogen Free | IEC 60754-1; EN 50267-2-1 |
| No Corrosive Gas Emission | IEC 60754-2; EN 50267-2-2 |
| Minimum Smoke Emission | IEC 61034-2; EN 61034-2 |

VOLTAGE RATING

300/500V

CABLE CONSTRUCTION

Conductor: Tinned annealed copper conductor, solid or stranded according to BS EN 60228 class 1, class 2 or class 5.

Insulation: Thermosetting XLPE type GP 8 according to BS 7655-1.3. Crosslinked polyolefin material type EI 5 according to EN 50363-5 or crosslinked elastomeric GP 4/GP 6 according to BS 7655-1.2 can be offered as option.

CPC (Circuit Protective Conductor): Uninsulated tinned annealed copper conductor conforming to BS EN 13630:2002.

Screen: One or more metallic or laminated metallic tape(s) shall be applied, either longitudinally or helically or as a combination of both, with the metallic element in contact with the uninsulated circuit protective

conductor.

Outer Sheath: LSZH type LTS 3 according to BS 7655-6.1.

Outer Sheath Option: UV resistance, hydrocarbon resistance, oil resistance, anti-rodent and anti-termite properties can be offered as option.

COLOUR CODE

Insulation Colour:

2-core + uninsulated circuit protective conductor: Brown, blue or brown, brown.

3-core + uninsulated circuit protective conductor: Brown, black, grey.

4-core + uninsulated circuit protective conductor: Blue, brown, black, grey.

Sheath Colour: White; other colours can be offered upon request.

PHYSICAL AND THERMAL PROPERTIES

Maximum temperature range during operation: 70°C

Maximum short circuit temperature (5 Seconds): 250°C

Minimum bending radius: 6 × Overall Diameter

CONSTRUCTION PARAMETERS

| Conductor | | FTX200 05ROZ1-U/R/K | | | |
|--|--------------------|------------------------------------|--------------------------------|--------------------------------|-------------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Nominal Sheath Thickness | Approx. Overall Diameter | Approx. Weight |
| No. × mm ² | | mm | mm | mm | kg/km |
| 2×1.0 | 1/2/5 | 0.6 | 0.9 | 8.0 | 80 |
| 2×1.5 | 1/2/5 | 0.7 | 0.9 | 8.5 | 100 |
| 2×2.5 | 1/2/5 | 0.7 | 1.0 | 10.5 | 140 |
| 2×4 | 1/2/5 | 0.7 | 1.1 | 12.5 | 190 |
| 3×1.0 | 1/2/5 | 0.6 | 0.9 | 8.5 | 105 |
| 3×1.5 | 1/2/5 | 0.7 | 0.9 | 9.5 | 120 |
| 3×2.5 | 1/2/5 | 0.7 | 1.0 | 11.5 | 170 |
| 3×4 | 1/2/5 | 0.7 | 1.1 | 13.5 | 230 |
| 4×1.0 | 1/2/5 | 0.6 | 1.0 | 9.0 | 125 |
| 4×1.5 | 1/2/5 | 0.7 | 1.0 | 10.5 | 155 |
| 4×2.5 | 1/2/5 | 0.7 | 1.1 | 12.0 | 200 |
| 4×4 | 1/2/5 | 0.7 | 1.2 | 15.0 | 280 |



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

ELECTRICAL PROPERTIES

Conductor operating temperature: 70°C

Ambient temperature: 30°C


Current-Carrying Capacities (Amp) according to BS 7671:2008 table 4D2A

| Conductor cross-sectional area | Ref. Method A (enclosed in conduit in thermally insulating wall etc) | | Ref. Method B (enclosed in conduit on a wall or in trunking etc) | | Ref. Method C (clipped direct) | | Ref. Method E (in free air or on a perforated cable tray etc. horizontal or vertical) | |
|--------------------------------|--|--|--|--|--|--|---|--|
| | 1 two-core cable*, single-phase a.c. or d.c. | 1 three-core or 1 four-core cable*, three-phase a.c. | 1 two-core cable*, single-phase a.c. or d.c. | 1 three-core or 1 four-core cable*, three-phase a.c. | 1 two-core cable*, single-phase a.c. or d.c. | 1 three-core or 1 four-core cable*, three-phase a.c. | 1 two-core cable*, single-phase a.c. or d.c. | 1 three-core or 1 four-core cable*, three-phase a.c. |
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 |
| mm ² | A | A | A | A | A | A | A | A |
| 1.0 | 11 | 10 | 13 | 11.5 | 15 | 13.5 | 17 | 14.5 |
| 1.5 | 14 | 13 | 16.5 | 15 | 19.5 | 17.5 | 22 | 18.5 |
| 2.5 | 18.5 | 17.5 | 23 | 20 | 27 | 24 | 30 | 25 |
| 4 | 25 | 23 | 30 | 27 | 36 | 32 | 40 | 34 |

Note: With or without a protective conductor.

Voltage Drop (Per Amp Per Meter) according to BS 7671:2008 table 4D2B

| Conductor cross-sectional area | Two-core cable d.c. | Two-core cable single-phase a.c. | Three- or four-core cable, three-phase a.c. |
|--------------------------------|---------------------|----------------------------------|---|
| 1 | 2 | 3 | 4 |
| mm ² | mV/A/m | mV/A/m | mV/A/m |
| 1.0 | 44 | 44 | 38 |
| 1.5 | 29 | 29 | 25 |
| 2.5 | 18 | 18 | 15 |
| 4 | 11 | 11 | 9.5 |




Rated Voltage



Standard




Flame Retardancy
IEC 60332-1-2



Halogen Free
IEC 60754-1



Low Corrosivity
IEC 60754-2




Low Smoke Emission
IEC 61034-2

450/750V LSZH Insulated, Non-sheathed Power Cables to BS EN 50525-3-31 (Single Core)

FTX100 07Z1-U/R/K (CU/LSZH 450/750V Class 1/2/5)

HAR Code: H07Z1-U/R/K

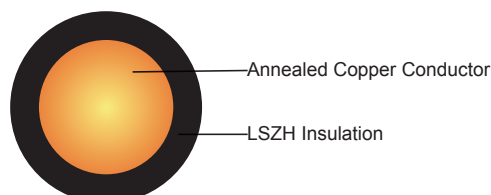

APPLICATION

The cables are mainly used in power stations, mass transit underground passenger systems, airports, petrochemical plants, hotels, hospitals and high-rise buildings.

STANDARDS

Basic design to BS EN 50525-3-31

FIRE PERFORMANCE

| | |
|---|-------------------------------|
| Flame Retardance (Single vertical wire or cable test) | IEC 60332-1-2; EN 60332-1-2 |
| Reduced Fire Propagation (Vertically-mounted bundled wires & cables test) | IEC 60332-3-24; EN 60332-3-24 |
| Halogen Free | IEC 60754-1; EN 50267-2-1 |
| No Corrosive Gas Emission | IEC 60754-2; EN 50267-2-2 |
| Minimum Smoke Emission | IEC 61034-2; EN 61034-2 |

VOLTAGE RATING

450/750V

CABLE CONSTRUCTION

Conductor: Copper conductor according to BS EN 60228 class 1/2/5.

H07Z1-U: 1.5-10mm² Class 1 solid copper conductor to BS EN 60228.

H07Z1-R: 1.5-630mm² Class 2 stranded copper conductor to BS EN 60228.

H07Z1-K: 1.5-240mm² Class 5 stranded copper conductor to BS EN 60228.

Insulation: Thermoplastic compound of type TI 7 to EN 50363-7.

Insulation Option: UV resistance, hydrocarbon resistance, oil resistance, anti-rodent and anti-termite



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

properties can be offered as option.

COLOUR CODE

Black, Blue, Brown, Grey, Orange, Pink, Red, Turquoise, Violet, White, Green and Yellow.

PHYSICAL AND THERMAL PROPERTIES

Maximum temperature range during operation: 70°C

Maximum short circuit temperature (5 Seconds): 160°C

Minimum bending radius

OD<8mm: 4 × Overall Diameter

8mm≤OD≤12mm: 5 × Overall Diameter

OD>12mm: 6 × Overall Diameter

CONSTRUCTION PARAMETERS

| Conductor | | FTX100 07Z1-U/R/K | | | |
|-------------------------------------|-----------------|------------------------------|-----------------------|-----------------------|----------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Min. Overall Diameter | Max. Overall Diameter | Approx. Weight |
| No. × mm ² | | mm | mm | mm | kg/km |
| 1×1.5 | 1 | 0.7 | 2.6 | 3.2 | 22 |
| 1×2.5 | 1 | 0.8 | 3.2 | 3.9 | 35 |
| 1×4 | 1 | 0.8 | 3.6 | 4.4 | 52 |
| 1×6 | 1 | 0.8 | 4.1 | 5.0 | 73 |
| 1×10 | 1 | 1.0 | 5.3 | 6.4 | 122 |
| 1×1.5 | 2 | 0.7 | 2.7 | 3.3 | 24 |
| 1×2.5 | 2 | 0.8 | 3.3 | 4.0 | 37 |
| 1×4 | 2 | 0.8 | 3.8 | 4.6 | 54 |
| 1×6 | 2 | 0.8 | 4.3 | 5.2 | 76 |
| 1×10 | 2 | 1.0 | 5.6 | 6.7 | 127 |
| 1×16 | 2 | 1.0 | 6.4 | 7.8 | 191 |
| 1×25 | 2 | 1.2 | 8.1 | 9.7 | 301 |
| 1×35 | 2 | 1.2 | 9.0 | 10.9 | 405 |
| 1×50 | 2 | 1.4 | 10.6 | 12.8 | 550 |
| 1×70 | 2 | 1.4 | 12.1 | 14.6 | 774 |
| 1×95 | 2 | 1.6 | 14.1 | 17.1 | 1069 |
| 1×120 | 2 | 1.6 | 15.6 | 18.8 | 1333 |
| 1×150 | 2 | 1.8 | 17.3 | 20.9 | 1640 |
| 1×185 | 2 | 2.0 | 19.3 | 23.3 | 2055 |
| 1×240 | 2 | 2.2 | 22.0 | 26.6 | 2690 |
| 1×300 | 2 | 2.4 | 24.5 | 29.6 | 3364 |
| 1×400 | 2 | 2.6 | 27.5 | 33.2 | 4252 |
| 1×500 | 2 | 2.8 | 30.5 | 36.9 | 5343 |

| Conductor | | FTX100 07Z1-U/R/K | | | |
|-------------------------------------|-----------------|------------------------------|-----------------------|-----------------------|----------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Min. Overall Diameter | Max. Overall Diameter | Approx. Weight |
| No. × mm ² | | mm | mm | mm | kg/km |
| 1×630 | 2 | 2.8 | 34.0 | 41.1 | 6868 |
| 1×1.5 | 5 | 0.7 | 2.8 | 3.4 | 23 |
| 1×2.5 | 5 | 0.8 | 3.4 | 4.1 | 37 |
| 1×4 | 5 | 0.8 | 3.9 | 4.8 | 54 |
| 1×6 | 5 | 0.8 | 4.4 | 5.3 | 76 |
| 1×10 | 5 | 1.0 | 5.7 | 6.8 | 128 |
| 1×16 | 5 | 1.0 | 6.7 | 8.1 | 191 |
| 1×25 | 5 | 1.2 | 8.4 | 10.2 | 297 |
| 1×35 | 5 | 1.2 | 9.7 | 11.7 | 403 |
| 1×50 | 5 | 1.4 | 11.5 | 13.9 | 577 |
| 1×70 | 5 | 1.4 | 13.2 | 16.0 | 803 |
| 1×95 | 5 | 1.6 | 15.1 | 18.2 | 1066 |
| 1×120 | 5 | 1.6 | 16.7 | 20.2 | 1332 |
| 1×150 | 5 | 1.8 | 18.6 | 22.5 | 1660 |
| 1×185 | 5 | 2.0 | 20.6 | 24.9 | 2030 |
| 1×240 | 5 | 2.2 | 23.5 | 28.4 | 2659 |

ELECTRICAL PROPERTIES

Conductor operating temperature: 70°C

Ambient temperature: 30°C

Current-Carrying Capacities (Amp) according to BS 7671:2008 table 4D1A

| Conductor cross-sectional area | Ref. Method A (enclosed in conduit in thermally insulating wall etc.) | | Ref. Method B (enclosed in conduit on a wall or in trunking etc.) | | Ref. Method C (clipped direct) | | Ref. Method F (in free air or on a perforated cable tray horizontal or vertical) | | | | |
|--------------------------------|---|---------------------------------|---|---------------------------------|---|--|--|---------------------------------|------------------------------------|---|-----|
| | | | | | | | Touching | | | Spaced by one diameter | |
| | 2 cables, single-phase a.c. or d.c. | 3 or 4 cables, three-phase a.c. | 2 cables, single-phase a.c. or d.c. | 3 or 4 cables, three-phase a.c. | 2 cables, single-phase a.c. or d.c. flat and touching | 3 or 4 cables, three-phase a.c. flat and touching or trefoil | 2 cables, single-phase a.c. or d.c. flat | 3 cables, three-phase a.c. flat | 3 cables, three-phase a.c. trefoil | 2 cables, single-phase a.c. or d.c. or 3 cables three-phase a.c. flat | |
| | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 |
| mm ² | A | A | A | A | A | A | A | A | A | A | A |
| 1.5 | 14.5 | 13.5 | 17.5 | 15.5 | 20 | 18 | - | - | - | - | - |
| 2.5 | 20 | 18 | 24 | 21 | 27 | 25 | - | - | - | - | - |
| 4 | 26 | 24 | 32 | 28 | 37 | 33 | - | - | - | - | - |
| 6 | 34 | 31 | 41 | 36 | 47 | 43 | - | - | - | - | - |
| 10 | 46 | 42 | 57 | 50 | 65 | 59 | - | - | - | - | - |
| 16 | 61 | 56 | 76 | 68 | 87 | 79 | - | - | - | - | - |
| 25 | 80 | 73 | 101 | 89 | 114 | 104 | 131 | 114 | 110 | 146 | 130 |



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables


www.caledonian-cables.co.uk www.addison-cables.com

| Conductor cross-sectional area | Ref. Method A (enclosed in conduit in thermally insulating wall etc.) | | Ref. Method B (enclosed in conduit on a wall or in trunking etc.) | | Ref. Method C (clipped direct) | | Ref. Method F (in free air or on a perforated cable tray horizontal or vertical) | | | | |
|--------------------------------|---|---------------------------------|---|---------------------------------|---|--|--|---------------------------------|------------------------------------|---|----------|
| | 2 cables, single-phase a.c. or d.c. | 3 or 4 cables, three-phase a.c. | 2 cables, single-phase a.c. or d.c. | 3 or 4 cables, three-phase a.c. | 2 cables, single-phase a.c. or d.c. flat and touching | 3 or 4 cables, three-phase a.c. flat and touching or trefoil | Touching | | | Spaced by one diameter | |
| | | | | | | | 2 cables, single-phase a.c. or d.c. flat | 3 cables, three-phase a.c. flat | 3 cables, three-phase a.c. trefoil | 2 cables, single-phase a.c. or d.c. or 3 cables three-phase a.c. flat | |
| | | | | | | | | | | Horizontal | Vertical |
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 |
| mm ² | A | A | A | A | A | A | A | A | A | A | A |
| 35 | 99 | 89 | 125 | 110 | 141 | 129 | 162 | 143 | 137 | 181 | 162 |
| 50 | 119 | 108 | 151 | 134 | 182 | 167 | 196 | 174 | 167 | 219 | 197 |
| 70 | 151 | 136 | 192 | 171 | 234 | 214 | 251 | 225 | 216 | 281 | 254 |
| 95 | 182 | 164 | 232 | 207 | 284 | 261 | 304 | 275 | 264 | 341 | 311 |
| 120 | 210 | 188 | 269 | 239 | 330 | 303 | 352 | 321 | 308 | 396 | 362 |
| 150 | 240 | 216 | 300 | 262 | 381 | 349 | 406 | 372 | 356 | 456 | 419 |
| 185 | 273 | 245 | 341 | 296 | 436 | 400 | 463 | 427 | 409 | 521 | 480 |
| 240 | 321 | 286 | 400 | 346 | 515 | 472 | 546 | 507 | 485 | 615 | 569 |
| 300 | 367 | 328 | 458 | 394 | 594 | 545 | 629 | 587 | 561 | 709 | 659 |
| 400 | - | - | 546 | 467 | 694 | 634 | 754 | 689 | 656 | 852 | 795 |
| 500 | - | - | 626 | 533 | 792 | 723 | 868 | 789 | 749 | 982 | 920 |
| 630 | - | - | 720 | 611 | 904 | 826 | 1005 | 905 | 855 | 1138 | 1070 |

Voltage Drop (Per Amp Per Meter) according to BS 7671:2008 table 4D1B

| Conductor cross-sectional area | 2 cables d.c. | 2 cables, single-phase a.c. | | | | | | | | | 3 or 4 cables, three-phase a.c. | | | | | | | | | | | |
|--------------------------------|---------------|--|--------|------|--|--------|-------|--|--|------|---------------------------------|-----------------------|------|--------|----------------------|-------|--------|------|------|-------|------|------|
| | | Ref. Methods A&B (enclosed in conduit or trunking) | | | Ref. Methods C & F (clipped direct, on trays or in free air) | | | Ref. Methods A & B (enclosed in conduit or trunking) | Ref. Methods C & F (clipped direct, on trays or in free air) | | | | | | | | | | | | | |
| | | Cables touching | | | Cables spaced* | | | | Cables touching, Trefoil | | | Cables touching, Flat | | | Cables spaced*, Flat | | | | | | | |
| 1 | 2 | 3 | | | 4 | | | 5 | 6 | 7 | | | 8 | | | 9 | | | | | | |
| mm ² | mV/A/m | | mV/A/m | | | mV/A/m | | | mV/A/m | | mV/A/m | | | mV/A/m | | | mV/A/m | | | | | |
| 1.5 | 29 | 29 | | | 29 | | | 29 | 25 | 25 | | | 25 | | | 25 | | | | | | |
| 2.5 | 18 | 18 | | | 18 | | | 18 | 15 | 15 | | | 15 | | | 15 | | | | | | |
| 4 | 11 | 11 | | | 11 | | | 11 | 9.5 | 9.5 | | | 9.5 | | | 9.5 | | | | | | |
| 6 | 7.3 | 7.3 | | | 7.3 | | | 7.3 | 6.4 | 6.4 | | | 6.4 | | | 6.4 | | | | | | |
| 10 | 4.4 | 4.4 | | | 4.4 | | | 4.4 | 3.8 | 3.8 | | | 3.8 | | | 3.8 | | | | | | |
| 16 | 2.8 | 2.8 | | | 2.8 | | | 2.8 | 2.4 | 2.4 | | | 2.4 | | | 2.4 | | | | | | |
| | | r | x | z | r | x | z | r | x | z | r | x | z | r | x | z | r | x | z | r | x | z |
| 25 | 1.75 | 1.80 | 0.33 | 1.80 | 1.75 | 0.20 | 1.75 | 1.75 | 0.29 | 1.80 | 1.50 | 0.29 | 1.55 | 1.50 | 0.175 | 1.50 | 1.50 | 0.25 | 1.55 | 1.50 | 0.32 | 1.55 |
| 35 | 1.25 | 1.30 | 0.31 | 1.30 | 1.25 | 0.195 | 1.25 | 1.25 | 0.28 | 1.30 | 1.10 | 0.27 | 1.10 | 1.10 | 0.170 | 1.10 | 1.10 | 0.24 | 1.10 | 1.10 | 0.32 | 1.15 |
| 50 | 0.93 | 0.95 | 0.3 | 1.0 | 0.93 | 0.19 | 0.95 | 0.93 | 0.28 | 0.97 | 0.81 | 0.26 | 0.85 | 0.8 | 0.165 | 0.82 | 0.8 | 0.24 | 0.84 | 0.8 | 0.32 | 0.86 |
| 70 | 0.63 | 0.65 | 0.29 | 0.72 | 0.63 | 0.185 | 0.66 | 0.63 | 0.27 | 0.69 | 0.56 | 0.25 | 0.61 | 0.55 | 0.16 | 0.57 | 0.55 | 0.24 | 0.6 | 0.55 | 0.31 | 0.63 |
| 95 | 0.46 | 0.49 | 0.28 | 0.56 | 0.47 | 0.18 | 0.50 | 0.47 | 0.27 | 0.54 | 0.42 | 0.24 | 0.48 | 0.41 | 0.155 | 0.43 | 0.41 | 0.23 | 0.47 | 0.4 | 0.31 | 0.51 |
| 120 | 0.36 | 0.39 | 0.27 | 0.47 | 0.37 | 0.175 | 0.41 | 0.37 | 0.26 | 0.45 | 0.33 | 0.23 | 0.41 | 0.32 | 0.15 | 0.36 | 0.32 | 0.23 | 0.4 | 0.32 | 0.3 | 0.44 |
| 150 | 0.29 | 0.31 | 0.27 | 0.41 | 0.3 | 0.175 | 0.34 | 0.29 | 0.26 | 0.39 | 0.27 | 0.23 | 0.36 | 0.26 | 0.15 | 0.3 | 0.26 | 0.23 | 0.34 | 0.26 | 0.3 | 0.40 |
| 185 | 0.23 | 0.25 | 0.27 | 0.37 | 0.24 | 0.17 | 0.29 | 0.24 | 0.26 | 0.35 | 0.22 | 0.23 | 0.32 | 0.21 | 0.145 | 0.26 | 0.21 | 0.22 | 0.31 | 0.21 | 0.3 | 0.36 |
| 240 | 0.18 | 0.195 | 0.26 | 0.33 | 0.185 | 0.165 | 0.25 | 0.185 | 0.25 | 0.31 | 0.17 | 0.23 | 0.29 | 0.16 | 0.145 | 0.22 | 0.16 | 0.22 | 0.27 | 0.16 | 0.29 | 0.34 |
| 300 | 0.145 | 0.16 | 0.26 | 0.31 | 0.15 | 0.165 | 0.22 | 0.15 | 0.25 | 0.29 | 0.14 | 0.23 | 0.27 | 0.13 | 0.14 | 0.19 | 0.13 | 0.22 | 0.25 | 0.13 | 0.29 | 0.32 |
| 400 | 0.105 | 0.13 | 0.26 | 0.29 | 0.12 | 0.16 | 0.20 | 0.115 | 0.25 | 0.27 | 0.12 | 0.22 | 0.25 | 0.105 | 0.14 | 0.175 | 0.105 | 0.21 | 0.24 | 0.1 | 0.29 | 0.31 |
| 500 | 0.086 | 0.11 | 0.26 | 0.28 | 0.098 | 0.155 | 0.185 | 0.093 | 0.24 | 0.26 | 0.1 | 0.22 | 0.25 | 0.086 | 0.135 | 0.16 | 0.086 | 0.21 | 0.23 | 0.081 | 0.29 | 0.30 |
| 630 | 0.068 | 0.094 | 0.25 | 0.27 | 0.081 | 0.155 | 0.175 | 0.076 | 0.24 | 0.25 | 0.08 | 0.22 | 0.24 | 0.072 | 0.135 | 0.15 | 0.072 | 0.21 | 0.22 | 0.066 | 0.28 | 0.29 |

Note: *Spacings larger than one cable diameter will result in a large voltage drop.
 r = conductor resistance at operating temperature
 x = reactance
 z = impedance



Rated Voltage




Standard



Flame Retardancy
IEC 60332-1-2



Reduced Fire Propagation
IEC 60332-3-24



Halogen Free
IEC 60754-1



Low Corrosivity
IEC 60754-2



Low Smoke Emission
IEC 61034-2



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables


www.caledonian-cables.co.uk www.addison-cables.com

450/750V LSZH Insulated, Non-sheathed Power Cables to BS EN 50525-3-41 (Single Core)

FTX100 07Z-U/R/K (CU/LSZH 450/750V Class 1/2/5)

BS Code: 6491B

HAR Code: H07Z-U/R/K

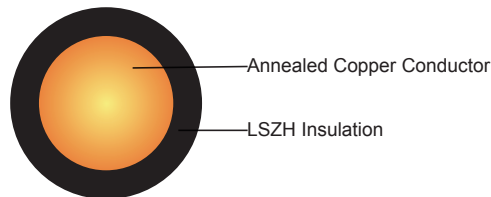

APPLICATION

The cables are mainly used in power stations, mass transit underground passenger systems, airports, petrochemical plants, hotels, hospitals and high-rise buildings.

STANDARDS

Basic design to BS EN 50525-3-41 (formerly BS 7211)

FIRE PERFORMANCE

| | |
|---|-----------------------------|
| Flame Retardance (Single vertical wire or cable test) | IEC 60332-1-2; EN 60332-1-2 |
| Halogen Free | IEC 60754-1; EN 50267-2-1 |
| No Corrosive Gas Emission | IEC 60754-2; EN 50267-2-2 |
| Minimum Smoke Emission | IEC 61034-2; EN 61034-2 |

VOLTAGE RATING

450/750V

CABLE CONSTRUCTION

Conductor: Copper conductor according to BS EN 60228 class 1/2/5.

H07Z-U: 1.5-10mm² Class 1 solid copper conductor to BS EN 60228.

H07Z-R: 1.5-630mm² Class 2 stranded copper conductor to BS EN 60228.

H07Z-K: 1.5-240mm² Class 5 stranded copper conductor to BS EN 60228.

Insulation: Crosslinked polyolefin material type EI 5 according to EN 50363-5.

Insulation Option: UV resistance, hydrocarbon resistance, oil resistance, anti-rodent and anti-termite properties can be offered as option.

COLOUR CODE

Black, Blue, Brown, Grey, Orange, Pink, Red, Turquoise, Violet, White, Green and Yellow.

PHYSICAL AND THERMAL PROPERTIES**Maximum temperature range during operation:** 90°C**Maximum short circuit temperature (5 Seconds):** 250°C**Minimum bending radius**

D<8mm: 4 × Overall Diameter

8mm≤OD≤12mm: 5 × Overall Diameter

OD>12mm: 6 × Overall Diameter

CONSTRUCTION PARAMETERS

| Conductor | | FTX100 07Z-U/R/K | | | |
|--|--------------------|------------------------------------|--------------------------|--------------------------|-------------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Min. Overall Diameter | Max. Overall Diameter | Approx. Weight |
| No.×mm ² | | mm | mm | mm | kg/km |
| 1×1.5 | 1 | 0.7 | 2.6 | 3.3 | 22 |
| 1×2.5 | 1 | 0.8 | 3.2 | 4.0 | 35 |
| 1×4 | 1 | 0.8 | 3.6 | 4.6 | 52 |
| 1×6 | 1 | 0.8 | 4.1 | 5.2 | 73 |
| 1×10 | 1 | 1.0 | 5.3 | 6.6 | 122 |
| 1×1.5 | 2 | 0.7 | 2.7 | 3.4 | 24 |
| 1×2.5 | 2 | 0.8 | 3.3 | 4.1 | 37 |
| 1×4 | 2 | 0.8 | 3.8 | 4.7 | 54 |
| 1×6 | 2 | 0.8 | 4.3 | 5.4 | 76 |
| 1×10 | 2 | 1.0 | 5.6 | 7.0 | 127 |
| 1×16 | 2 | 1.0 | 6.4 | 8.0 | 191 |
| 1×25 | 2 | 1.2 | 8.1 | 10.1 | 301 |
| 1×35 | 2 | 1.2 | 9.0 | 11.3 | 405 |
| 1×50 | 2 | 1.4 | 10.6 | 13.2 | 550 |
| 1×70 | 2 | 1.4 | 12.1 | 15.1 | 774 |
| 1×95 | 2 | 1.6 | 14.1 | 17.6 | 1069 |
| 1×120 | 2 | 1.6 | 15.6 | 19.4 | 1333 |
| 1×150 | 2 | 1.8 | 17.3 | 21.6 | 1640 |
| 1×185 | 2 | 2.0 | 19.3 | 24.1 | 2055 |
| 1×240 | 2 | 2.2 | 22.0 | 27.5 | 2690 |
| 1×300 | 2 | 2.4 | 24.5 | 30.6 | 3364 |
| 1×400 | 2 | 2.6 | 27.5 | 34.3 | 4252 |
| 1×500 | 2 | 2.8 | 30.5 | 38.2 | 5343 |
| 1×630 | 2 | 2.8 | 34.0 | 42.5 | 6868 |
| 1×1.5 | 5 | 0.7 | 2.8 | 3.5 | 23 |
| 1×2.5 | 5 | 0.8 | 3.4 | 4.3 | 37 |
| 1×4 | 5 | 0.8 | 3.9 | 4.9 | 54 |
| 1×6 | 5 | 0.8 | 4.4 | 5.5 | 76 |
| 1×10 | 5 | 1.0 | 5.7 | 7.1 | 128 |
| 1×16 | 5 | 1.0 | 6.7 | 8.4 | 191 |
| 1×25 | 5 | 1.2 | 8.4 | 10.6 | 297 |
| 1×35 | 5 | 1.2 | 9.7 | 12.1 | 403 |
| 1×50 | 5 | 1.4 | 11.5 | 14.4 | 577 |



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

| Conductor | | FTX100 07Z-U/R/K | | | |
|-------------------------------------|-----------------|------------------------------|-----------------------|-----------------------|----------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Min. Overall Diameter | Max. Overall Diameter | Approx. Weight |
| No. × mm ² | | mm | mm | mm | kg/km |
| 1×70 | 5 | 1.4 | 13.2 | 16.6 | 803 |
| 1×95 | 5 | 1.6 | 15.1 | 18.8 | 1066 |
| 1×120 | 5 | 1.6 | 16.7 | 20.9 | 1332 |
| 1×150 | 5 | 1.8 | 18.6 | 23.3 | 1660 |
| 1×185 | 5 | 2.0 | 20.6 | 25.8 | 2030 |
| 1×240 | 5 | 2.2 | 23.5 | 29.4 | 2659 |

ELECTRICAL PROPERTIES

Conductor operating temperature: 90°C

Ambient temperature: 30°C

Current-Carrying Capacities (Amp) according to BS 7671:2008 table 4E1A

| Conductor cross-sectional area | Ref. Method A (enclosed in conduit in thermally insulating wall etc) | | Ref. Method B (enclosed in conduit on a wall or in trunking etc) | | Ref. Method C (clipped direct) | | Ref. Method F (in free air or on a perforated cable tray, horizontal or vertical etc) Touching | | | Ref. Method G (in free air) Spaced by one cable diameter | |
|--------------------------------|--|---------------------------------|--|---------------------------------|---|--|--|---------------------------------|------------------------------------|---|----------|
| | 2 cables, single-phase a.c. or d.c. | 3 or 4 cables, three-phase a.c. | 2 cables, single-phase a.c. or d.c. | 3 or 4 cables, three-phase a.c. | 2 cables, single-phase a.c. or d.c. flat and touching | 3 or 4 cables, three-phase a.c. flat and touching or trefoil | 2 cables, single-phase a.c. or d.c. flat | 3 cables, three-phase a.c. flat | 3 cables, three-phase a.c. trefoil | 2 cables, single-phase a.c. or d.c. or 3 cables three-phase a.c. flat | |
| | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | Horizontal | Vertical |
| mm ² | A | A | A | A | A | A | A | A | A | A | A |
| 1.5 | 19 | 17 | 23 | 20 | 25 | 23 | - | - | - | - | - |
| 2.5 | 26 | 23 | 31 | 28 | 34 | 31 | - | - | - | - | - |
| 4 | 35 | 31 | 42 | 37 | 46 | 41 | - | - | - | - | - |
| 6 | 45 | 40 | 54 | 48 | 59 | 54 | - | - | - | - | - |
| 10 | 61 | 54 | 75 | 66 | 81 | 74 | - | - | - | - | - |
| 16 | 81 | 73 | 100 | 88 | 109 | 99 | - | - | - | - | - |
| 25 | 106 | 95 | 133 | 117 | 143 | 130 | 161 | 141 | 135 | 182 | 161 |
| 35 | 131 | 117 | 164 | 144 | 176 | 161 | 200 | 176 | 169 | 226 | 201 |
| 50 | 158 | 141 | 198 | 175 | 228 | 209 | 242 | 216 | 207 | 275 | 246 |
| 70 | 200 | 179 | 253 | 222 | 293 | 268 | 310 | 279 | 268 | 353 | 318 |
| 95 | 241 | 216 | 306 | 269 | 355 | 326 | 377 | 342 | 328 | 430 | 389 |
| 120 | 278 | 249 | 354 | 312 | 413 | 379 | 437 | 400 | 383 | 500 | 454 |
| 150 | 318 | 285 | 393 | 342 | 476 | 436 | 504 | 464 | 444 | 577 | 527 |
| 185 | 362 | 324 | 449 | 384 | 545 | 500 | 575 | 533 | 510 | 661 | 605 |
| 240 | 424 | 380 | 528 | 450 | 644 | 590 | 679 | 634 | 607 | 781 | 719 |
| 300 | 486 | 435 | 603 | 514 | 743 | 681 | 783 | 736 | 703 | 902 | 833 |
| 400 | - | - | 683 | 584 | 868 | 793 | 940 | 868 | 823 | 1085 | 1008 |
| 500 | - | - | 783 | 666 | 990 | 904 | 1083 | 998 | 946 | 1253 | 1169 |
| 630 | - | - | 900 | 764 | 1130 | 1033 | 1254 | 1151 | 1088 | 1454 | 1362 |

Voltage Drop (Per Amp Per Meter) according to BS 7671:2008 table 4E1B

| Conductor cross-sectional area | 2 cables d.c. | 2 cables, single-phase a.c. | | | | | | 3 or 4 cables, three-phase a.c. | | | | | | | | | | | | | | |
|--------------------------------|---------------|--|--------|------|---|-------|--------|--|---|------|--------|-----------------------|------|--------|----------------------|-------|--------|-------|-------|-------|------|------|
| | | Ref. Methods A&B (enclosed in conduit or trunking) | | | Ref. Methods C, F&G (clipped direct, on trays or in free air) | | | Ref. Methods A&B (enclosed in conduit or trunking) | Ref. Methods C, F&G (clipped direct, on trays or in free air) | | | | | | | | | | | | | |
| | | Cables touching | | | Cables spaced* | | | | Cables touching, Trefoil | | | Cables touching, Flat | | | Cables spaced*, Flat | | | | | | | |
| 1 | 2 | 3 | | | 4 | | | 5 | | | 6 | 7 | | | 8 | | | 9 | | | | |
| mm ² | mV/A/m | | mV/A/m | | mV/A/m | | mV/A/m | | mV/A/m | | mV/A/m | | | mV/A/m | | | mV/A/m | | | | | |
| 1.5 | 31 | 31 | | | 31 | | | 31 | | | 27 | | 27 | | | 27 | | | 27 | | | |
| 2.5 | 19 | 19 | | | 19 | | | 19 | | | 16 | | 16 | | | 16 | | | 16 | | | |
| 4 | 12 | 12 | | | 12 | | | 12 | | | 10 | | 10 | | | 10 | | | 10 | | | |
| 6 | 7.9 | 7.9 | | | 7.9 | | | 7.9 | | | 6.8 | | 6.8 | | | 6.8 | | | 6.8 | | | |
| 10 | 4.7 | 4.7 | | | 4.7 | | | 4.7 | | | 4.0 | | 4.0 | | | 4.0 | | | 4.0 | | | |
| 16 | 2.9 | 2.9 | | | 2.9 | | | 2.9 | | | 2.5 | | 2.5 | | | 2.5 | | | 2.5 | | | |
| | | r | x | z | r | x | z | r | x | z | r | x | z | r | x | z | r | x | z | r | x | z |
| 25 | 1.85 | 1.85 | 0.31 | 1.90 | 1.85 | 0.190 | 1.85 | 1.85 | 0.28 | 1.85 | 1.60 | 0.27 | 1.65 | 1.60 | 0.165 | 1.60 | 1.60 | 0.190 | 1.60 | 1.60 | 0.27 | 1.65 |
| 35 | 1.35 | 1.35 | 0.29 | 1.35 | 1.35 | 0.180 | 1.35 | 1.35 | 0.27 | 1.35 | 1.15 | 0.25 | 1.15 | 1.15 | 0.155 | 1.15 | 1.15 | 0.180 | 1.15 | 1.15 | 0.26 | 1.20 |
| 50 | 0.99 | 1.00 | 0.29 | 1.05 | 0.99 | 0.180 | 1.00 | 0.99 | 0.27 | 1.00 | 0.87 | 0.25 | 0.90 | 0.86 | 0.155 | 0.87 | 0.86 | 0.180 | 0.87 | 0.86 | 0.26 | 0.89 |
| 70 | 0.68 | 0.70 | 0.28 | 0.75 | 0.68 | 0.175 | 0.71 | 0.68 | 0.26 | 0.73 | 0.60 | 0.24 | 0.65 | 0.59 | 0.150 | 0.61 | 0.59 | 0.175 | 0.62 | 0.59 | 0.25 | 0.65 |
| 95 | 0.49 | 0.51 | 0.27 | 0.58 | 0.49 | 0.170 | 0.52 | 0.49 | 0.26 | 0.56 | 0.44 | 0.23 | 0.50 | 0.43 | 0.145 | 0.45 | 0.43 | 0.170 | 0.46 | 0.43 | 0.25 | 0.49 |
| 120 | 0.39 | 0.41 | 0.26 | 0.48 | 0.39 | 0.165 | 0.43 | 0.39 | 0.25 | 0.47 | 0.35 | 0.23 | 0.42 | 0.34 | 0.140 | 0.37 | 0.34 | 0.165 | 0.38 | 0.34 | 0.24 | 0.42 |
| 150 | 0.32 | 0.33 | 0.26 | 0.43 | 0.32 | 0.165 | 0.36 | 0.32 | 0.25 | 0.41 | 0.29 | 0.23 | 0.37 | 0.28 | 0.140 | 0.31 | 0.28 | 0.165 | 0.32 | 0.28 | 0.24 | 0.37 |
| 185 | 0.25 | 0.27 | 0.26 | 0.37 | 0.26 | 0.165 | 0.30 | 0.25 | 0.25 | 0.36 | 0.23 | 0.23 | 0.32 | 0.22 | 0.140 | 0.26 | 0.22 | 0.165 | 0.28 | 0.22 | 0.24 | 0.33 |
| 240 | 0.190 | 0.21 | 0.26 | 0.33 | 0.20 | 0.160 | 0.25 | 0.195 | 0.25 | 0.31 | 0.185 | 0.22 | 0.29 | 0.170 | 0.140 | 0.22 | 0.170 | 0.165 | 0.24 | 0.170 | 0.24 | 0.29 |
| 300 | 0.155 | 0.175 | 0.25 | 0.31 | 0.160 | 0.160 | 0.22 | 0.155 | 0.25 | 0.29 | 0.150 | 0.22 | 0.27 | 0.140 | 0.140 | 0.195 | 0.135 | 0.160 | 0.21 | 0.135 | 0.24 | 0.27 |
| 400 | 0.120 | 0.140 | 0.25 | 0.29 | 0.130 | 0.155 | 0.20 | 0.125 | 0.24 | 0.27 | 0.125 | 0.22 | 0.25 | 0.110 | 0.135 | 0.175 | 0.110 | 0.160 | 0.195 | 0.110 | 0.24 | 0.26 |
| 500 | 0.093 | 0.120 | 0.25 | 0.28 | 0.105 | 0.155 | 0.185 | 0.098 | 0.24 | 0.26 | 0.100 | 0.22 | 0.24 | 0.090 | 0.135 | 0.160 | 0.088 | 0.160 | 0.180 | 0.085 | 0.24 | 0.25 |
| 630 | 0.072 | 0.100 | 0.25 | 0.27 | 0.086 | 0.155 | 0.175 | 0.078 | 0.24 | 0.25 | 0.088 | 0.21 | 0.23 | 0.074 | 0.135 | 0.150 | 0.071 | 0.160 | 0.170 | 0.068 | 0.23 | 0.24 |

Note: *Spacings larger than one cable diameter will result in a large voltage drop.

r = conductor resistance at operating temperature

x = reactance

z = impedance




Rated Voltage



Standard




Flame Retardancy
IEC 60332-1-2



Halogen Free
IEC 60754-1



Low Corrosivity
IEC 60754-2



Low Smoke Emission
IEC 61034-2



Caledonian



FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

450/750V XLPE Insulated, LSZH Sheathed Power Cables to BS 7211 (Single Core)

FTX300 07RZ1-U/R (CU/XLPE/LSZH 450/750V Class 1/2)

BS Code: 6181B

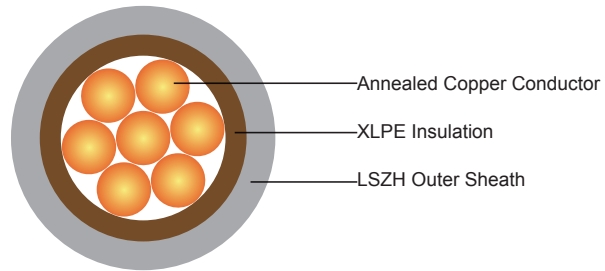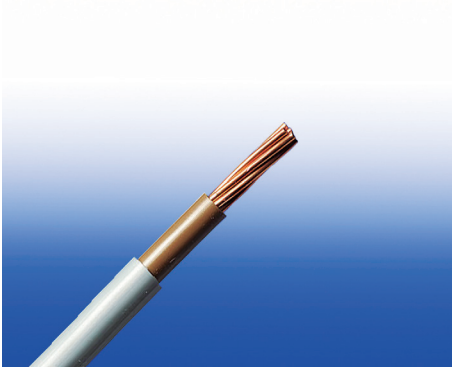

APPLICATION

The cables are mainly used in power stations, mass transit underground passenger systems, airports, petrochemical plants, hotels, hospitals and high-rise buildings.

STANDARDS

Basic design to BS 7211:2012

FIRE PERFORMANCE

| | |
|---|-------------------------------|
| Flame Retardance (Single vertical wire or cable test) | IEC 60332-1-2; EN 60332-1-2 |
| Reduced Fire Propagation (Vertically-mounted bundled wires & cables test) | IEC 60332-3-24; EN 60332-3-24 |
| Halogen Free | IEC 60754-1; EN 50267-2-1 |
| No Corrosive Gas Emission | IEC 60754-2; EN 50267-2-2 |
| Minimum Smoke Emission | IEC 61034-2; EN 61034-2 |

VOLTAGE RATING

450/750V

CABLE CONSTRUCTION

Conductor: Annealed copper conductor, solid or stranded according to BS EN 60228 class 1 or class 2.

Insulation: XLPE type GP8 according to BS 7655-1.3. Crosslinked polyolefin material type EI 5 according to EN 50363-5 can be offered as option.

Outer Sheath: Extruded LSZH type LTS 4 according to BS 7655-6.1.

Outer Sheath Option: UV resistance, hydrocarbon resistance, oil resistance, anti-rodent and anti-termite properties can be offered as option.

COLOUR CODE

Insulation Colour: Brown or blue.

Sheath Colour: White; other colours can be offered upon request.

PHYSICAL AND THERMAL PROPERTIES

Maximum temperature range during operation: 90°C

Maximum short circuit temperature (5 Seconds): 250°C

Minimum bending radius

OD<8mm: 4 × Overall Diameter

8mm≤OD≤12mm: 5 × Overall Diameter

OD>12mm: 6 × Overall Diameter

CONSTRUCTION PARAMETER

| Conductor | | FTX300 07RZ1-U/R | | | | |
|--|--------------------|------------------------------------|--------------------------------|--------------------------|--------------------------|-------------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Nominal Sheath Thickness | Min. Overall Diameter | Max. Overall Diameter | Approx. Weight |
| No. × mm ² | | mm | mm | mm | mm | kg/km |
| 1×1.0 | 1 | 0.7 | 0.8 | 3.9 | 4.8 | 26 |
| 1×1.5 | 1 | 0.7 | 0.8 | 4.2 | 5.0 | 34 |
| 1×2.5 | 1 | 0.7 | 0.8 | 4.6 | 5.5 | 46 |
| 1×4 | 1 | 0.7 | 0.8 | 5.2 | 6.3 | 65 |
| 1×6 | 1 | 0.7 | 0.8 | 5.7 | 6.8 | 90 |
| 1×1.0 | 2 | 0.7 | 0.8 | 4.0 | 4.9 | 31 |
| 1×1.5 | 2 | 0.7 | 0.8 | 4.3 | 5.2 | 39 |
| 1×2.5 | 2 | 0.7 | 0.8 | 4.7 | 5.6 | 51 |
| 1×4 | 2 | 0.7 | 0.9 | 5.3 | 6.4 | 72 |
| 1×6 | 2 | 0.7 | 0.9 | 5.9 | 7.1 | 99 |
| 1×10 | 2 | 0.7 | 0.9 | 6.7 | 8.1 | 141 |
| 1×16 | 2 | 0.7 | 0.9 | 7.6 | 9.2 | 205 |
| 1×25 | 2 | 0.9 | 1.0 | 9.4 | 11.4 | 318 |
| 1×35 | 2 | 0.9 | 1.1 | 10.6 | 12.8 | 482 |



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

ELECTRICAL PROPERTIES

Conductor operating temperature: 90°C

Ambient temperature: 30°C

Current-Carrying Capacities (Amp) according to BS 7671:2008 table 4E1A

| Conductor cross-sectional area | Ref. Method A (enclosed in conduit in thermally insulating wall etc) | | Ref. Method B (enclosed in conduit on a wall or in trunking etc) | | Ref. Method C (clipped direct) | | Ref. Method F (in free air or on a perforated cable tray, horizontal or vertical etc) Touching | | | Ref. Method G (in free air) Spaced by one cable diameter | |
|--------------------------------|--|---------------------------------|--|---------------------------------|---|--|--|---------------------------------|------------------------------------|---|----------|
| | 2 cables, single-phase a.c. or d.c. | 3 or 4 cables, three-phase a.c. | 2 cables, single-phase a.c. or d.c. | 3 or 4 cables, three-phase a.c. | 2 cables, single-phase a.c. or d.c. flat and touching | 3 or 4 cables, three-phase a.c. flat and touching or trefoil | 2 cables, single-phase a.c. or d.c. flat | 3 cables, three-phase a.c. flat | 3 cables, three-phase a.c. trefoil | 2 cables, single-phase a.c. or d.c. or 3 cables three-phase a.c. flat | |
| | | | | | | | | | | Horizontal | Vertical |
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 |
| mm ² | A | A | A | A | A | A | A | A | A | A | A |
| 1.0 | 14 | 13 | 17 | 15 | 19 | 17.5 | - | - | - | - | - |
| 1.5 | 19 | 17 | 23 | 20 | 25 | 23 | - | - | - | - | - |
| 2.5 | 26 | 23 | 31 | 28 | 34 | 31 | - | - | - | - | - |
| 4 | 35 | 31 | 42 | 37 | 46 | 41 | - | - | - | - | - |
| 6 | 45 | 40 | 54 | 48 | 59 | 54 | - | - | - | - | - |
| 10 | 61 | 54 | 75 | 66 | 81 | 74 | - | - | - | - | - |
| 16 | 81 | 73 | 100 | 88 | 109 | 99 | - | - | - | - | - |
| 25 | 106 | 95 | 133 | 117 | 143 | 130 | 161 | 141 | 135 | 182 | 161 |
| 35 | 131 | 117 | 164 | 144 | 176 | 161 | 200 | 176 | 169 | 226 | 201 |

Voltage Drop (Per Amp Per Meter) according to BS 7671:2008 table 4E1B

| Conductor cross-sectional area | 2 cables d.c. | 2 cables, single-phase a.c. | | | | | | 3 or 4 cables, three-phase a.c. | | | | | | | | | | | | | | | | | |
|--------------------------------|---------------|--|--------|------|---|--------|------|--|--------|------|---|--------|------|----------------------|--------|------|------|--------|------|------|--------|------|------|------|------|
| | | Ref. Methods A&B (enclosed in conduit or trunking) | | | Ref. Methods C, F&G (clipped direct, on trays or in free air) | | | Ref. Methods A&B (enclosed in conduit or trunking) | | | Ref. Methods C, F&G (clipped direct, on trays or in free air) | | | | | | | | | | | | | | |
| | | Cables touching | | | Cables spaced* | | | Cables touching, Trefoil | | | Cables touching, Flat | | | Cables spaced*, Flat | | | | | | | | | | | |
| 1 | 2 | 3 | | | 4 | | | 5 | | | 6 | | | 7 | | | 8 | | | 9 | | | | | |
| mm ² | mV/A/m | | mV/A/m | | | mV/A/m | | | mV/A/m | | | mV/A/m | | | mV/A/m | | | mV/A/m | | | mV/A/m | | | | |
| 1.0 | 46 | 46 | | 46 | | | 46 | | | 40 | | | 40 | | | 40 | | | 40 | | | 40 | | | |
| 1.5 | 31 | 31 | | 31 | | | 31 | | | 27 | | | 27 | | | 27 | | | 27 | | | 27 | | | |
| 2.5 | 19 | 19 | | 19 | | | 19 | | | 16 | | | 16 | | | 16 | | | 16 | | | 16 | | | |
| 4 | 12 | 12 | | 12 | | | 12 | | | 10 | | | 10 | | | 10 | | | 10 | | | 10 | | | |
| 6 | 7.9 | 7.9 | | 7.9 | | | 7.9 | | | 6.8 | | | 6.8 | | | 6.8 | | | 6.8 | | | 6.8 | | | |
| 10 | 4.7 | 4.7 | | 4.7 | | | 4.7 | | | 4.0 | | | 4.0 | | | 4.0 | | | 4.0 | | | 4.0 | | | |
| 16 | 2.9 | 2.9 | | 2.9 | | | 2.9 | | | 2.5 | | | 2.5 | | | 2.5 | | | 2.5 | | | 2.5 | | | |
| | | r | x | z | r | x | z | r | x | z | r | x | z | r | x | z | r | x | z | r | x | z | r | x | z |
| 25 | 1.85 | 1.85 | 0.31 | 1.90 | 1.85 | 0.190 | 1.85 | 1.85 | 0.28 | 1.85 | 1.60 | 0.27 | 1.65 | 1.60 | 0.165 | 1.60 | 1.60 | 0.190 | 1.60 | 1.60 | 0.27 | 1.65 | 1.60 | 0.27 | 1.65 |
| 35 | 1.35 | 1.35 | 0.29 | 1.35 | 1.35 | 0.180 | 1.35 | 1.35 | 0.27 | 1.35 | 1.15 | 0.25 | 1.15 | 1.15 | 0.155 | 1.15 | 1.15 | 0.180 | 1.15 | 1.15 | 0.26 | 1.20 | 1.15 | 0.26 | 1.20 |

Note: *Spacings larger than one cable diameter will result in a large voltage drop.

r = conductor resistance at operating temperature

x = reactance

z = impedance



Rated Voltage




Standard



Flame Retardancy
IEC 60332-1-2



Reduced Fire Propagation
IEC 60332-3-24



Halogen Free
IEC 60754-1



Low Corrosivity
IEC 60754-2



Low Smoke Emission
IEC 61034-2



Caledonian



FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

450/750V XLPE Insulated, LSZH Sheathed Power Cables to BS 7211 (2-5 Cores)

FTX200 07RZ1-U/R (CU/XLPE/LSZH 450/750V Class 1/2)

BS Code: 6182B/6183B/6184B/6185B

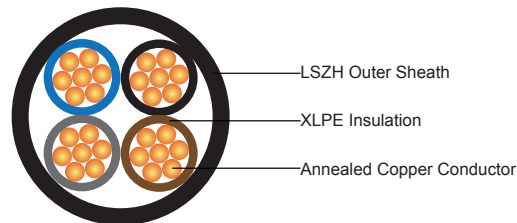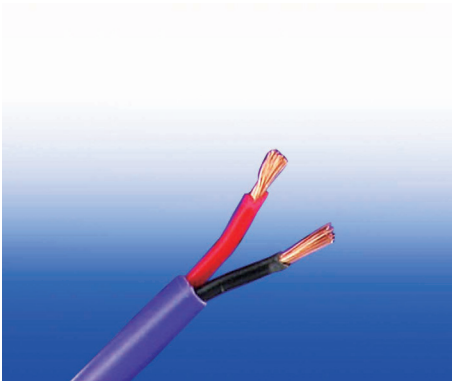

APPLICATION

The cables are mainly used in power stations, mass transit underground passenger systems, airports, petrochemical plants, hotels, hospitals and high-rise buildings.

STANDARDS

Basic design to BS 7211:2012

FIRE PERFORMANCE

| | |
|---|-------------------------------|
| Flame Retardance (Single vertical wire or cable test) | IEC 60332-1-2; EN 60332-1-2 |
| Reduced Fire Propagation (Vertically-mounted bundled wires & cables test) | IEC 60332-3-24; EN 60332-3-24 |
| Halogen Free | IEC 60754-1; EN 50267-2-1 |
| No Corrosive Gas Emission | IEC 60754-2; EN 50267-2-2 |
| Minimum Smoke Emission | IEC 61034-2; EN 61034-2 |

VOLTAGE RATING

450/750V

CABLE CONSTRUCTION

Conductor: Annealed copper conductor, solid or stranded according to BS EN 60228 class 1 or class 2.

Insulation: XLPE type GP8 according to BS 7655-1.3. Crosslinked polyolefin material type EI 5 according to EN 50363-5 can be offered as option.

Inner Covering Option: The optional inner covering, where used, shall consist of an extruded layer of synthetic polymeric material. It shall surround the laid-up two, three, four or five cores, giving the assembly a practically circular shape.

Outer Sheath: Extruded LSZH type LTS 4 according to BS 7655-6.1.

Outer Sheath Option: UV resistance, hydrocarbon resistance, oil resistance, anti-rodent and anti-termite

properties can be offered as option.

COLOUR CODE

Insulation Colour:

2-core: Brown and blue.

3-core: Brown, black and grey.

4-core: Blue, brown black and grey.

5-core: Green/yellow, blue, brown black and grey.

Sheath Colour: White; other colours can be offered upon request.

PHYSICAL AND THERMAL PROPERTIES

Maximum temperature range during operation: 90°C

Maximum short circuit temperature (5 Seconds): 250°C

Minimum bending radius

OD<8mm: 4 × Overall Diameter

8mm≤OD≤12mm: 5 × Overall Diameter

OD>12mm: 6 × Overall Diameter

CONSTRUCTION PARAMETER

| Conductor | | FTX200 07RZ1-U/R | | | | | |
|-------------------------------------|-----------------|------------------------------|----------------------------------|--------------------------|-----------------------|-----------------------|----------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Nominal Inner Covering Thickness | Nominal Sheath Thickness | Min. Overall Diameter | Max. Overall Diameter | Approx. Weight |
| No. ×mm ² | | mm | mm | mm | mm | mm | kg/km |
| 2×1.0 | 1 | 0.7 | 0.4 | 1.2 | 7.1 | 9.5 | 94 |
| 2×1.5 | 1 | 0.7 | 0.4 | 1.2 | 7.6 | 10.1 | 121 |
| 2×2.5 | 1 | 0.7 | 0.4 | 1.2 | 8.4 | 11.0 | 165 |
| 2×4 | 1 | 0.7 | 0.4 | 1.2 | 9.2 | 12.1 | 212 |
| 2×6 | 1 | 0.7 | 0.4 | 1.2 | 10.2 | 13.2 | 272 |
| 2×10 | 1 | 0.7 | 0.4 | 1.4 | 12.1 | 16.0 | 446 |
| 2×1.0 | 2 | 0.7 | 0.4 | 1.2 | 7.3 | 9.7 | 110 |
| 2×1.5 | 2 | 0.7 | 0.4 | 1.2 | 7.8 | 10.3 | 132 |
| 2×2.5 | 2 | 0.7 | 0.4 | 1.2 | 8.5 | 11.3 | 178 |
| 2×4 | 2 | 0.7 | 0.4 | 1.2 | 9.5 | 12.4 | 232 |
| 2×6 | 2 | 0.7 | 0.4 | 1.2 | 10.6 | 13.7 | 302 |
| 2×10 | 2 | 0.7 | 0.6 | 1.4 | 12.7 | 16.7 | 490 |
| 2×16 | 2 | 0.7 | 0.6 | 1.4 | 14.4 | 18.8 | 674 |
| 2×25 | 2 | 0.9 | 0.8 | 1.4 | 17.7 | 23.2 | 1040 |
| 2×35 | 2 | 0.9 | 0.8 | 1.6 | 20.0 | 26.0 | 1130 |
| 3×1.0 | 1 | 0.7 | 0.4 | 1.2 | 7.5 | 10.0 | 110 |
| 3×1.5 | 1 | 0.7 | 0.4 | 1.2 | 8.0 | 10.6 | 143 |
| 3×2.5 | 1 | 0.7 | 0.4 | 1.2 | 8.8 | 11.6 | 198 |
| 3×4 | 1 | 0.7 | 0.4 | 1.2 | 9.8 | 12.7 | 260 |
| 3×6 | 1 | 0.7 | 0.4 | 1.2 | 11.2 | 14.4 | 387 |
| 3×10 | 1 | 0.7 | 0.6 | 1.4 | 12.8 | 16.9 | 557 |



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

| Conductor | | FTX200 07RZ1-U/R | | | | | |
|-------------------------------------|-----------------|------------------------------|----------------------------------|--------------------------|-----------------------|-----------------------|----------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Nominal Inner Covering Thickness | Nominal Sheath Thickness | Min. Overall Diameter | Max. Overall Diameter | Approx. Weight |
| No. × mm ² | | mm | mm | mm | mm | mm | kg/km |
| 3×1.0 | 2 | 0.7 | 0.4 | 1.2 | 7.7 | 10.2 | 128 |
| 3×1.5 | 2 | 0.7 | 0.4 | 1.2 | 8.2 | 10.9 | 156 |
| 3×2.5 | 2 | 0.7 | 0.4 | 1.2 | 9.0 | 11.9 | 213 |
| 3×4 | 2 | 0.7 | 0.4 | 1.2 | 10.1 | 13.1 | 282 |
| 3×6 | 2 | 0.7 | 0.4 | 1.4 | 11.6 | 15.0 | 387 |
| 3×10 | 2 | 0.7 | 0.6 | 1.4 | 13.5 | 17.7 | 607 |
| 3×16 | 2 | 0.7 | 0.6 | 1.4 | 15.3 | 19.9 | 850 |
| 3×25 | 2 | 0.9 | 0.8 | 1.4 | 18.9 | 24.6 | 1315 |
| 3×35 | 2 | 0.9 | 0.8 | 1.6 | 21.3 | 27.6 | 1562 |
| 4×1.0 | 1 | 0.7 | 0.4 | 1.2 | 8.1 | 10.7 | 130 |
| 4×1.5 | 1 | 0.7 | 0.4 | 1.2 | 8.7 | 11.4 | 170 |
| 4×2.5 | 1 | 0.7 | 0.4 | 1.2 | 9.6 | 12.6 | 240 |
| 4×4 | 1 | 0.7 | 0.4 | 1.2 | 10.7 | 13.8 | 330 |
| 4×6 | 1 | 0.7 | 0.4 | 1.4 | 12.2 | 16.1 | 445 |
| 4×10 | 1 | 0.7 | 0.6 | 1.4 | 14.1 | 18.4 | 687 |
| 4×1.0 | 2 | 0.7 | 0.4 | 1.2 | 8.3 | 11.0 | 150 |
| 4×1.5 | 2 | 0.7 | 0.4 | 1.2 | 8.9 | 11.7 | 185 |
| 4×2.5 | 2 | 0.7 | 0.4 | 1.2 | 9.9 | 12.8 | 256 |
| 4×4 | 2 | 0.7 | 0.4 | 1.2 | 11.0 | 14.2 | 344 |
| 4×6 | 2 | 0.7 | 0.6 | 1.4 | 12.7 | 16.7 | 490 |
| 4×10 | 2 | 0.7 | 0.6 | 1.4 | 14.8 | 19.2 | 747 |
| 4×16 | 2 | 0.7 | 0.6 | 1.4 | 16.9 | 21.8 | 1055 |
| 4×25 | 2 | 0.9 | 0.8 | 1.6 | 21.2 | 27.5 | 1670 |
| 4×35 | 2 | 0.9 | 1.0 | 1.6 | 23.5 | 30.7 | 2044 |
| 5×1.0 | 1 | 0.7 | 0.4 | 1.2 | 8.8 | 11.5 | 157 |
| 5×1.5 | 1 | 0.7 | 0.4 | 1.2 | 9.4 | 12.3 | 208 |
| 5×2.5 | 1 | 0.7 | 0.4 | 1.2 | 10.5 | 13.6 | 295 |
| 5×4 | 1 | 0.7 | 0.4 | 1.4 | 12.0 | 15.9 | 422 |
| 5×6 | 1 | 0.7 | 0.6 | 1.4 | 13.3 | 17.5 | 551 |
| 5×10 | 1 | 0.7 | 0.6 | 1.4 | 15.4 | 20.0 | 858 |
| 5×1.0 | 2 | 0.7 | 0.4 | 1.2 | 9.0 | 11.9 | 183 |
| 5×1.5 | 2 | 0.7 | 0.4 | 1.2 | 9.7 | 12.6 | 227 |
| 5×2.5 | 2 | 0.7 | 0.4 | 1.2 | 10.7 | 13.9 | 317 |
| 5×4 | 2 | 0.7 | 0.6 | 1.4 | 12.4 | 16.4 | 460 |
| 5×6 | 2 | 0.7 | 0.6 | 1.4 | 13.8 | 18.1 | 610 |
| 5×10 | 2 | 0.7 | 0.6 | 1.4 | 16.2 | 20.9 | 937 |
| 5×16 | 2 | 0.7 | 0.8 | 1.4 | 18.5 | 24.2 | 1328 |
| 5×25 | 2 | 0.9 | 1.0 | 1.6 | 23.3 | 30.5 | 1860 |
| 5×35 | 2 | 0.9 | 1.0 | 1.6 | 25.9 | 33.6 | 2500 |

ELECTRICAL PROPERTIES**Conductor operating temperature:** 90°C**Ambient temperature:** 30°C**Current-Carrying Capacities (Amp) according to BS 7671:2008 table 4E2A**

| Conductor cross-sectional area | Ref. Method A (enclosed in conduit in thermally insulating wall etc.) | | Ref. Method B (enclosed in conduit on a wall or in trunking etc.) | | Ref. Method C (clipped direct) | | Ref. Method E (in free air or on a perforated cable tray etc. horizontal or vertical) | |
|--------------------------------|---|--|---|--|--|--|---|--|
| | 1 two-core cable*, single-phase a.c. or d.c. | 1 three- or four-core cable*, three-phase a.c. | 1 two-core cable*, single-phase a.c. or d.c. | 1 three- or four-core cable*, three-phase a.c. | 1 two-core cable*, single-phase a.c. or d.c. | 1 three- or four-core cable*, three-phase a.c. | 1 two-core cable*, single-phase a.c. or d.c. | 1 three- or four-core cable*, three-phase a.c. |
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 |
| mm ² | A | A | A | A | A | A | A | A |
| 1.0 | 14.5 | 13 | 17 | 15 | 19 | 17 | 21 | 18 |
| 1.5 | 18.5 | 16.5 | 22 | 19.5 | 24 | 22 | 26 | 23 |
| 2.5 | 25 | 22 | 30 | 26 | 33 | 30 | 36 | 32 |
| 4 | 33 | 30 | 40 | 35 | 45 | 40 | 49 | 42 |
| 6 | 42 | 38 | 51 | 44 | 58 | 52 | 63 | 54 |
| 10 | 57 | 51 | 69 | 60 | 80 | 71 | 86 | 75 |
| 16 | 76 | 68 | 91 | 80 | 107 | 96 | 115 | 100 |
| 25 | 99 | 89 | 119 | 105 | 138 | 119 | 149 | 127 |
| 35 | 121 | 109 | 146 | 128 | 171 | 147 | 185 | 158 |

Note: With or without a protective conductor.



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

Voltage Drop (Per Amp Per Meter) according to BS 7671:2008 table 4E2B

| Conductor cross-sectional area | Two-core cable, d.c. | Two-core cable, single-phase a.c. | | | Three- or four-core cable, three-phase a.c. | | |
|--------------------------------|----------------------|-----------------------------------|-------|------|---|-------|------|
| | | 2 | 3 | 4 | r | x | z |
| 1 | 2 | 3 | 4 | | | | |
| mm ² | mV/A/m | mV/A/m | | | mV/A/m | | |
| 1.0 | 46 | 46 | | | 40 | | |
| 1.5 | 31 | 31 | | | 27 | | |
| 2.5 | 19 | 19 | | | 16 | | |
| 4 | 12 | 12 | | | 10 | | |
| 6 | 7.9 | 7.9 | | | 6.8 | | |
| 10 | 4.7 | 4.7 | | | 4.0 | | |
| 16 | 2.9 | 2.9 | | | 2.5 | | |
| | | r | x | z | r | x | z |
| 25 | 1.85 | 1.85 | 0.160 | 1.90 | 1.60 | 0.140 | 1.65 |
| 35 | 1.35 | 1.35 | 0.155 | 1.35 | 1.15 | 0.135 | 1.15 |



Rated Voltage




Standard



Flame Retardancy
IEC 60332-1-2



Reduced Fire Propagation
IEC 60332-3-24



Halogen Free
IEC 60754-1





Low Corrosivity
IEC 60754-2



Low Smoke Emission
IEC 61034-2

600/1000V LSZH Insulated, Non-sheathed Power Cables to BS EN 50525-3-41 (Single Core)

FTX100 1Z-R (CU/LSZH 600/1000V Class 2)

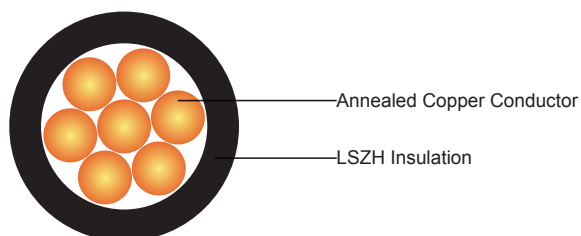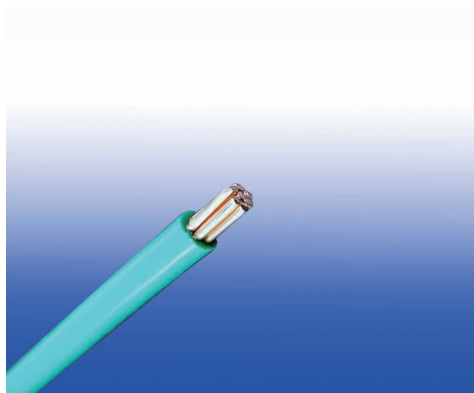

APPLICATION

The cables are mainly used in power stations, mass transit underground passenger systems, airports, petrochemical plants, hotels, hospitals and high-rise buildings.

STANDARDS

Basic design adapted to BS EN 50525-3-41

FIRE PERFORMANCE

| | |
|---|-----------------------------|
| Flame Retardance (Single vertical wire or cable test) | IEC 60332-1-2; EN 60332-1-2 |
| Halogen Free | IEC 60754-1; EN 50267-2-1 |
| No Corrosive Gas Emission | IEC 60754-2; EN 50267-2-2 |
| Minimum Smoke Emission | IEC 61034-2; EN 61034-2 |

VOLTAGE RATING

600/1000V

CABLE CONSTRUCTION

Conductor: Annealed copper conductor, stranded according to BS EN 60228 class 2.

Insulation: Crosslinked polyolefin material type EI 5 according to EN 50363-5.

Insulation Option: UV resistance, hydrocarbon resistance, oil resistance, anti-rodent and anti-termite properties can be offered as option.

COLOUR CODE

Black, Blue, Brown, Grey, Orange, Pink, Red, Turquoise, Violet, White, Green and Yellow. Bi-colours of any combination of the above mono-colours are permitted.



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

PHYSICAL AND THERMAL PROPERTIES

Maximum temperature range during operation: 90°C

Maximum short circuit temperature (5 Seconds): 250°C

Minimum bending radius

OD<8mm: 4 × Overall Diameter

8mm≤OD≤12mm: 5 × Overall Diameter

OD>12mm: 6 × Overall Diameter

CONSTRUCTION PARAMETERS

| Conductor | | FTX100 1Z-R | | |
|--|--------------------|------------------------------------|--------------------------------|-------------------|
| No. of Cores x Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Nominal Overall Diameter | Approx. Weight |
| No.xmm ² | | mm | mm | kg/km |
| 1x1.5 | 2 | 0.7 | 3.1 | 23 |
| 1x2.5 | 2 | 0.8 | 3.7 | 35 |
| 1x4.0 | 2 | 0.8 | 4.3 | 52 |
| 1x6.0 | 2 | 0.8 | 4.8 | 73 |
| 1x10 | 2 | 1.0 | 6.2 | 120 |
| 1x16 | 2 | 1.0 | 7.2 | 180 |
| 1x25 | 2 | 1.2 | 9.0 | 285 |
| 1x35 | 2 | 1.2 | 10.2 | 375 |
| 1x50 | 2 | 1.4 | 12.0 | 510 |
| 1x70 | 2 | 1.4 | 14.0 | 720 |
| 1x95 | 2 | 1.6 | 16.0 | 995 |
| 1x120 | 2 | 1.6 | 18.0 | 1230 |
| 1x150 | 2 | 1.8 | 20.0 | 1520 |
| 1x185 | 2 | 2.0 | 22.0 | 1900 |
| 1x240 | 2 | 2.2 | 25.0 | 2480 |
| 1x300 | 2 | 2.4 | 28.0 | 3100 |
| 1x400 | 2 | 2.6 | 31.5 | 3950 |
| 1x500 | 2 | 2.8 | 35.0 | 4950 |
| 1x630 | 2 | 2.8 | 39.0 | 6360 |

ELECTRICAL PROPERTIES**Conductor operating temperature: 90°C****Ambient temperature: 30°C****Current-Carrying Capacities (Amp) according to BS 7671:2008 table 4E1A**

| Conductor cross-sectional area | Ref. Method A (enclosed in conduit in thermally insulating wall etc.) | | Ref. Method B (enclosed in conduit on a wall or in trunking etc.) | | Ref. Method C (clipped direct) | | Ref. Method F (in free air or on a perforated cable tray, horizontal or vertical etc.) Touching | | | Ref. Method G (in free air) Spaced by one cable diameter | |
|--------------------------------|---|---------------------------------|---|---------------------------------|---|--|--|---------------------------------|------------------------------------|---|------|
| | 2 cables, single-phase a.c. or d.c. | 3 or 4 cables, three-phase a.c. | 2 cables, single-phase a.c. or d.c. | 3 or 4 cables, three-phase a.c. | 2 cables, single-phase a.c. or d.c. flat and touching | 3 or 4 cables, three-phase a.c. flat and touching or trefoil | 2 cables, single-phase a.c. or d.c. flat | 3 cables, three-phase a.c. flat | 3 cables, three-phase a.c. trefoil | 2 cables, single-phase a.c. or d.c. or 3 cables three-phase a.c. flat | |
| | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 |
| mm ² | A | A | A | A | A | A | A | A | A | A | A |
| 1.5 | 19 | 17 | 23 | 20 | 25 | 23 | - | - | - | - | - |
| 2.5 | 26 | 23 | 31 | 28 | 34 | 31 | - | - | - | - | - |
| 4.0 | 35 | 31 | 42 | 37 | 46 | 41 | - | - | - | - | - |
| 6.0 | 45 | 40 | 54 | 48 | 59 | 54 | - | - | - | - | - |
| 10 | 61 | 54 | 75 | 66 | 81 | 74 | - | - | - | - | - |
| 16 | 81 | 73 | 100 | 88 | 109 | 99 | - | - | - | - | - |
| 25 | 106 | 95 | 133 | 117 | 143 | 130 | 161 | 141 | 135 | 182 | 161 |
| 35 | 131 | 117 | 164 | 144 | 176 | 161 | 200 | 176 | 169 | 226 | 201 |
| 50 | 158 | 141 | 198 | 175 | 228 | 209 | 242 | 216 | 207 | 275 | 246 |
| 70 | 200 | 179 | 253 | 222 | 293 | 268 | 310 | 279 | 268 | 353 | 318 |
| 95 | 241 | 216 | 306 | 269 | 355 | 326 | 377 | 342 | 328 | 430 | 389 |
| 120 | 278 | 249 | 354 | 312 | 413 | 379 | 437 | 400 | 383 | 500 | 454 |
| 150 | 318 | 285 | 393 | 342 | 476 | 436 | 504 | 464 | 444 | 577 | 527 |
| 185 | 362 | 324 | 449 | 384 | 545 | 500 | 575 | 533 | 510 | 661 | 605 |
| 240 | 424 | 380 | 528 | 450 | 644 | 590 | 679 | 634 | 607 | 781 | 719 |
| 300 | 486 | 435 | 603 | 514 | 743 | 681 | 783 | 736 | 703 | 902 | 833 |
| 400 | - | - | 683 | 584 | 868 | 793 | 940 | 868 | 823 | 1085 | 1008 |
| 500 | - | - | 783 | 666 | 990 | 904 | 1083 | 998 | 946 | 1253 | 1169 |
| 630 | - | - | 900 | 764 | 1130 | 1033 | 1254 | 1151 | 1088 | 1454 | 1362 |



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

Voltage Drop (Per Amp Per Meter) according to BS 7671:2008 table 4E1B


| Conductor cross-sectional area | 2 cables d.c. | 2 cables, single-phase a.c. | | | | | | | | | 3 or 4 cables, three-phase a.c. | | | | | | | | | | | | |
|--------------------------------|---------------|--|--------|------|---|--------|-------|----------------|--------|------|--|--------|------|---|--------|-------|-----------------------|--------|-------|----------------------|--------|------|--|
| | | Ref. Methods A&B (enclosed in conduit or trunking) | | | Ref. Methods C, F&G (clipped direct, on trays or in free air) | | | | | | Ref. Methods A&B (enclosed in conduit or trunking) | | | Ref. Methods C, F&G (clipped direct, on trays or in free air) | | | | | | | | | |
| | | | | | Cables touching | | | Cables spaced* | | | | | | Cables touching, Trefoil | | | Cables touching, Flat | | | Cables spaced*, Flat | | | |
| 1 | 2 | 3 | | | 4 | | | 5 | | | 6 | | | 7 | | | 8 | | | 9 | | | |
| mm ² | mV/A/m | | mV/A/m | | | mV/A/m | | | mV/A/m | | | mV/A/m | | | mV/A/m | | | mV/A/m | | | mV/A/m | | |
| 1.5 | 31 | 31 | | 31 | | | 31 | | | 27 | | | 27 | | | 27 | | | 27 | | | | |
| 2.5 | 19 | 19 | | 19 | | | 19 | | | 16 | | | 16 | | | 16 | | | 16 | | | | |
| 4.0 | 12 | 12 | | 12 | | | 12 | | | 10 | | | 10 | | | 10 | | | 10 | | | | |
| 6.0 | 7.9 | 7.9 | | 7.9 | | | 7.9 | | | 6.8 | | | 6.8 | | | 6.8 | | | 6.8 | | | | |
| 10 | 4.7 | 4.7 | | 4.7 | | | 4.7 | | | 4.0 | | | 4.0 | | | 4.0 | | | 4.0 | | | | |
| 16 | 2.9 | 2.9 | | 2.9 | | | 2.9 | | | 2.5 | | | 2.5 | | | 2.5 | | | 2.5 | | | | |
| | | r | x | z | r | x | z | r | x | z | r | x | z | r | x | z | r | x | z | r | x | z | |
| 25 | 1.85 | 1.85 | 0.31 | 1.90 | 1.85 | 0.190 | 1.85 | 1.85 | 0.28 | 1.85 | 1.60 | 0.27 | 1.65 | 1.60 | 0.165 | 1.60 | 1.60 | 0.190 | 1.60 | 1.60 | 0.27 | 1.65 | |
| 35 | 1.35 | 1.35 | 0.29 | 1.35 | 1.35 | 0.180 | 1.35 | 1.35 | 0.27 | 1.35 | 1.15 | 0.25 | 1.15 | 1.15 | 0.155 | 1.15 | 1.15 | 0.180 | 1.15 | 1.15 | 0.26 | 1.20 | |
| 50 | 0.99 | 1.00 | 0.29 | 1.05 | 0.99 | 0.180 | 1.00 | 0.99 | 0.27 | 1.00 | 0.87 | 0.25 | 0.90 | 0.86 | 0.155 | 0.87 | 0.86 | 0.180 | 0.87 | 0.86 | 0.26 | 0.89 | |
| 70 | 0.68 | 0.70 | 0.28 | 0.75 | 0.68 | 0.175 | 0.71 | 0.68 | 0.26 | 0.73 | 0.60 | 0.24 | 0.65 | 0.59 | 0.150 | 0.61 | 0.59 | 0.175 | 0.62 | 0.59 | 0.25 | 0.65 | |
| 95 | 0.49 | 0.51 | 0.27 | 0.58 | 0.49 | 0.170 | 0.52 | 0.49 | 0.26 | 0.56 | 0.44 | 0.23 | 0.50 | 0.43 | 0.145 | 0.45 | 0.43 | 0.170 | 0.46 | 0.43 | 0.25 | 0.49 | |
| 120 | 0.39 | 0.41 | 0.26 | 0.48 | 0.39 | 0.165 | 0.43 | 0.39 | 0.25 | 0.47 | 0.35 | 0.23 | 0.42 | 0.34 | 0.140 | 0.37 | 0.34 | 0.165 | 0.38 | 0.34 | 0.24 | 0.42 | |
| 150 | 0.32 | 0.33 | 0.26 | 0.43 | 0.32 | 0.165 | 0.36 | 0.32 | 0.25 | 0.41 | 0.29 | 0.23 | 0.37 | 0.28 | 0.140 | 0.31 | 0.28 | 0.165 | 0.32 | 0.28 | 0.24 | 0.37 | |
| 185 | 0.25 | 0.27 | 0.26 | 0.37 | 0.26 | 0.165 | 0.30 | 0.25 | 0.25 | 0.36 | 0.23 | 0.23 | 0.32 | 0.22 | 0.140 | 0.26 | 0.22 | 0.165 | 0.28 | 0.22 | 0.24 | 0.33 | |
| 240 | 0.190 | 0.21 | 0.26 | 0.33 | 0.20 | 0.160 | 0.25 | 0.195 | 0.25 | 0.31 | 0.185 | 0.22 | 0.29 | 0.170 | 0.140 | 0.22 | 0.170 | 0.165 | 0.24 | 0.170 | 0.24 | 0.29 | |
| 300 | 0.155 | 0.175 | 0.25 | 0.31 | 0.160 | 0.160 | 0.22 | 0.155 | 0.25 | 0.29 | 0.150 | 0.22 | 0.27 | 0.140 | 0.140 | 0.195 | 0.135 | 0.160 | 0.21 | 0.135 | 0.24 | 0.27 | |
| 400 | 0.120 | 0.140 | 0.25 | 0.29 | 0.130 | 0.155 | 0.20 | 0.125 | 0.24 | 0.27 | 0.125 | 0.22 | 0.25 | 0.110 | 0.135 | 0.175 | 0.110 | 0.160 | 0.195 | 0.110 | 0.24 | 0.26 | |
| 500 | 0.093 | 0.120 | 0.25 | 0.28 | 0.105 | 0.155 | 0.185 | 0.098 | 0.24 | 0.26 | 0.100 | 0.22 | 0.24 | 0.090 | 0.135 | 0.160 | 0.088 | 0.160 | 0.180 | 0.085 | 0.24 | 0.25 | |
| 630 | 0.072 | 0.100 | 0.25 | 0.27 | 0.086 | 0.155 | 0.175 | 0.078 | 0.24 | 0.25 | 0.088 | 0.21 | 0.23 | 0.074 | 0.135 | 0.150 | 0.071 | 0.160 | 0.170 | 0.068 | 0.23 | 0.24 | |

Note: *Spacings larger than one cable diameter will result in a large voltage drop.

r = conductor resistance at operating temperature

x = reactance

z = impedance




Rated Voltage



Standard



Flame Retardancy
IEC 60332-1-2



Halogen Free
IEC 60754-1





Low Corrosivity
IEC 60754-2



Low Smoke Emission
IEC 61034-2

600/1000V XLPE Insulated, LSZH Sheathed Power Cables to BS 8573 (Single Core)

FTX300 1RZ1-R (CU/XLPE/LSZH 600/1000V Class 2)

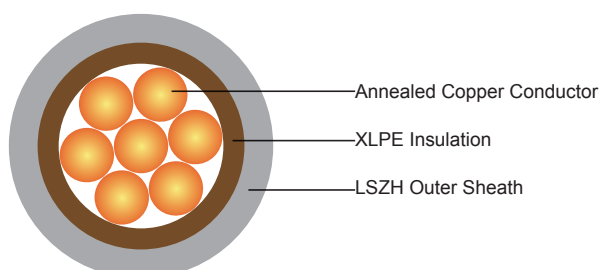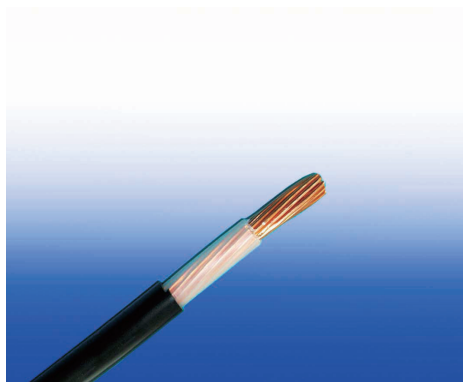

APPLICATION

These XLPE insulated and LSZH sheathed cables are generally used for fixed installation. Suitable for building wiring, especially in areas where smoke and fume emissions may cause a potential threat to life but not for burial in the ground, either directly or in ducts.

STANDARDS

Basic design to BS 8573:2012

FIRE PERFORMANCE

| | |
|---|-------------------------------|
| Flame Retardance (Single vertical wire or cable test) | IEC 60332-1-2; EN 60332-1-2 |
| Reduced Fire Propagation (Vertically-mounted bundled wires & cables test) | IEC 60332-3-24; EN 60332-3-24 |
| Halogen Free | IEC 60754-1; EN 50267-2-1 |
| No Corrosive Gas Emission | IEC 60754-2; EN 50267-2-2 |
| Minimum Smoke Emission | IEC 61034-2; EN 61034-2 |

VOLTAGE RATING

600/1000V

CABLE CONSTRUCTION

Conductor: Annealed copper conductor, stranded according to BS EN 60228 class 2.

Insulation: XLPE type GP8 according to BS 7655-1.3. HEPR type GP6 according to BS 7655-1.2 or crosslinked polyolefin material type EI 5 according to BS EN 50363-5 can be offered as option.

Inner Covering Option: The optional inner covering, where used, shall consist of an extruded layer of synthetic polymeric material. It shall surround the single core and the laid-up two, three, four or five cores, giving the assembly a practically circular shape.

Outer Sheath: Extruded layer of polymeric material LTS 4 according to BS 7655-6.1.

Outer Sheath Option: UV resistance, hydrocarbon resistance, oil resistance, anti-rodent and anti-termite



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

properties can be offered as option.

COLOUR CODE

Insulation Colour: Brown or blue.

Sheath Colour: Black; other colours can be offered upon request.

PHYSICAL AND THERMAL PROPERTIES

Maximum temperature range during operation: 90°C

Maximum short circuit temperature (5 Seconds): 250°C

Minimum bending radius

circular copper conductors OD≤25mm : 4 × Overall Diameter

circular copper conductors OD>25mm: 6 × Overall Diameter

shaped copper conductors: 8 × Overall Diameter

CONSTRUCTION PARAMETERS

| Conductor | | FTX300 1RZ1-R | | | | |
|-------------------------------------|-----------------|------------------------------|----------------------------------|--------------------------|--------------------------|----------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Nominal Inner Covering Thickness | Nominal Sheath Thickness | Approx. Overall Diameter | Approx. Weight |
| No.×mm ² | | mm | mm | mm | mm | kg/km |
| 1×1.5 | 2 | 0.7 | 0.4 | 1.4 | 5.8 | 54 |
| 1×2.5 | 2 | 0.7 | 0.4 | 1.4 | 6.2 | 67 |
| 1×4 | 2 | 0.7 | 0.4 | 1.4 | 6.8 | 87 |
| 1×6 | 2 | 0.7 | 0.4 | 1.4 | 7.3 | 113 |
| 1×10 | 2 | 0.7 | 0.4 | 1.4 | 8.3 | 163 |
| 1×16 | 2 | 0.7 | 0.4 | 1.4 | 9.3 | 232 |
| 1×25 | 2 | 0.9 | 0.4 | 1.4 | 11.0 | 346 |
| 1×35 | 2 | 0.9 | 0.4 | 1.4 | 12.2 | 456 |
| 1×50 | 2 | 1.0 | 0.6 | 1.4 | 13.7 | 599 |
| 1×70 | 2 | 1.1 | 0.6 | 1.4 | 15.7 | 835 |
| 1×95 | 2 | 1.1 | 0.6 | 1.5 | 17.8 | 1131 |
| 1×120 | 2 | 1.2 | 0.8 | 1.5 | 19.6 | 1407 |
| 1×150 | 2 | 1.4 | 0.8 | 1.6 | 21.8 | 1727 |
| 1×185 | 2 | 1.6 | 0.8 | 1.6 | 24.0 | 2144 |
| 1×240 | 2 | 1.7 | 1.0 | 1.7 | 27.1 | 2786 |
| 1×300 | 2 | 1.8 | 1.0 | 1.8 | 29.9 | 3466 |
| 1×400 | 2 | 2.0 | 1.2 | 1.9 | 33.5 | 4405 |
| 1×500 | 2 | 2.2 | 1.2 | 2.0 | 37.2 | 5520 |
| 1×630 | 2 | 2.4 | 1.4 | 2.2 | 42.0 | 7097 |
| 1×800 | 2 | 2.6 | 1.6 | 2.3 | 46.9 | 9010 |
| 1×1000 | 2 | 2.8 | 1.6 | 2.4 | 52.0 | 11286 |

ELECTRICAL PROPERTIES**Conductor operating temperature: 90°C****Ambient temperature: 30°C****Current-Carrying Capacities (Amp) according to BS 7671:2008 table 4E1A**

| Conductor cross-sectional area | Ref. Method A (enclosed in conduit in thermally insulating wall etc.) | | Ref. Method B (enclosed in conduit on a wall or in trunking etc.) | | Ref. Method C (clipped direct) | | Ref. Method F (in free air or on a perforated cable tray, horizontal or vertical etc.) Touching | | | Ref. Method G (in free air) Spaced by one cable diameter | |
|--------------------------------|---|---------------------------------|---|---------------------------------|---|--|--|---------------------------------|------------------------------------|---|----------|
| | 2 cables, single-phase a.c. or d.c. | 3 or 4 cables, three-phase a.c. | 2 cables, single-phase a.c. or d.c. | 3 or 4 cables, three-phase a.c. | 2 cables, single-phase a.c. or d.c. flat and touching | 3 or 4 cables, three-phase a.c. flat and touching or trefoil | 2 cables, single-phase a.c. or d.c. flat | 3 cables, three-phase a.c. flat | 3 cables, three-phase a.c. trefoil | 2 cables, single-phase a.c. or d.c. or 3 cables three-phase a.c. flat | |
| | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | Horizontal | Vertical |
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 |
| mm ² | A | A | A | A | A | A | A | A | A | A | A |
| 1.5 | 19 | 17 | 23 | 20 | 25 | 23 | - | - | - | - | - |
| 2.5 | 26 | 23 | 31 | 28 | 34 | 31 | - | - | - | - | - |
| 4 | 35 | 31 | 42 | 37 | 46 | 41 | - | - | - | - | - |
| 6 | 45 | 40 | 54 | 48 | 59 | 54 | - | - | - | - | - |
| 10 | 61 | 54 | 75 | 66 | 81 | 74 | - | - | - | - | - |
| 16 | 81 | 73 | 100 | 88 | 109 | 99 | - | - | - | - | - |
| 25 | 106 | 95 | 133 | 117 | 143 | 130 | 161 | 141 | 135 | 182 | 161 |
| 35 | 131 | 117 | 164 | 144 | 176 | 161 | 200 | 176 | 169 | 226 | 201 |
| 50 | 158 | 141 | 198 | 175 | 228 | 209 | 242 | 216 | 207 | 275 | 246 |
| 70 | 200 | 179 | 253 | 222 | 293 | 268 | 310 | 279 | 268 | 353 | 318 |
| 95 | 241 | 216 | 306 | 269 | 355 | 326 | 377 | 342 | 328 | 430 | 389 |
| 120 | 278 | 249 | 354 | 312 | 413 | 379 | 437 | 400 | 383 | 500 | 454 |
| 150 | 318 | 285 | 393 | 342 | 476 | 436 | 504 | 464 | 444 | 577 | 527 |
| 185 | 362 | 324 | 449 | 384 | 545 | 500 | 575 | 533 | 510 | 661 | 605 |
| 240 | 424 | 380 | 528 | 450 | 644 | 590 | 679 | 634 | 607 | 781 | 719 |
| 300 | 486 | 435 | 603 | 514 | 743 | 681 | 783 | 736 | 703 | 902 | 833 |
| 400 | - | - | 683 | 584 | 868 | 793 | 940 | 868 | 823 | 1085 | 1008 |
| 500 | - | - | 783 | 666 | 990 | 904 | 1083 | 998 | 946 | 1253 | 1169 |
| 630 | - | - | 900 | 764 | 1130 | 1033 | 1254 | 1151 | 1088 | 1454 | 1362 |
| 800 | - | - | - | - | 1288 | 1179 | 1358 | 1275 | 1214 | 1581 | 1485 |
| 1000 | - | - | - | - | 1443 | 1323 | 1520 | 1436 | 1349 | 1775 | 1671 |



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

Voltage Drop (Per Amp Per Meter) according to BS 7671:2008 table 4E1B


| Conductor cross-sectional area | 2 cables d.c. | 2 cables, single-phase a.c. | | | | | | 3 or 4 cables, three-phase a.c. | | | | | | | | | | | | | | |
|--------------------------------|---------------|--|------|----------------|---|-------|----------------|--|------|------|-----------------------|---|------|----------------------|-------|-------|--------|-------|-------|--------|------|------|
| | | Ref. Methods A&B (enclosed in conduit or trunking) | | | Ref. Methods C, F&G (clipped direct, on trays or in free air) | | | Ref. Methods A&B (enclosed in conduit or trunking) | | | | Ref. Methods C, F&G (clipped direct, on trays or in free air) | | | | | | | | | | |
| | | Cables touching | | Cables spaced* | Cables touching | | Cables spaced* | Cables touching, Trefoil | | | Cables touching, Flat | | | Cables spaced*, Flat | | | | | | | | |
| 1 | 2 | 3 | | | 4 | | | 5 | | | 6 | | | 7 | | | 8 | | | 9 | | |
| mm ² | | mV/A/m | | | mV/A/m | | | mV/A/m | | | mV/A/m | | | mV/A/m | | | mV/A/m | | | mV/A/m | | |
| 1.5 | 31 | 31 | | | 31 | | | 31 | | | 27 | | | 27 | | | 27 | | | 27 | | |
| 2.5 | 19 | 19 | | | 19 | | | 19 | | | 16 | | | 16 | | | 16 | | | 16 | | |
| 4 | 12 | 12 | | | 12 | | | 12 | | | 10 | | | 10 | | | 10 | | | 10 | | |
| 6 | 7.9 | 7.9 | | | 7.9 | | | 7.9 | | | 6.8 | | | 6.8 | | | 6.8 | | | 6.8 | | |
| 10 | 4.7 | 4.7 | | | 4.7 | | | 4.7 | | | 4.0 | | | 4.0 | | | 4.0 | | | 4.0 | | |
| 16 | 2.9 | 2.9 | | | 2.9 | | | 2.9 | | | 2.5 | | | 2.5 | | | 2.5 | | | 2.5 | | |
| | | r | x | z | r | x | z | r | x | z | r | x | z | r | x | z | r | x | z | r | x | z |
| 25 | 1.85 | 1.85 | 0.31 | 1.90 | 1.85 | 0.190 | 1.85 | 1.85 | 0.28 | 1.85 | 1.60 | 0.27 | 1.65 | 1.60 | 0.165 | 1.60 | 1.60 | 0.190 | 1.60 | 0.27 | 1.65 | |
| 35 | 1.35 | 1.35 | 0.29 | 1.35 | 1.35 | 0.180 | 1.35 | 1.35 | 0.27 | 1.35 | 1.15 | 0.25 | 1.15 | 1.15 | 0.155 | 1.15 | 1.15 | 0.180 | 1.15 | 0.26 | 1.20 | |
| 50 | 0.99 | 1.00 | 0.29 | 1.05 | 0.99 | 0.180 | 1.00 | 0.99 | 0.27 | 1.00 | 0.87 | 0.25 | 0.90 | 0.86 | 0.155 | 0.87 | 0.86 | 0.180 | 0.87 | 0.26 | 0.89 | |
| 70 | 0.68 | 0.70 | 0.28 | 0.75 | 0.68 | 0.175 | 0.71 | 0.68 | 0.26 | 0.73 | 0.60 | 0.24 | 0.65 | 0.59 | 0.150 | 0.61 | 0.59 | 0.175 | 0.62 | 0.59 | 0.25 | 0.65 |
| 95 | 0.49 | 0.51 | 0.27 | 0.58 | 0.49 | 0.170 | 0.52 | 0.49 | 0.26 | 0.56 | 0.44 | 0.23 | 0.50 | 0.43 | 0.145 | 0.45 | 0.43 | 0.170 | 0.46 | 0.43 | 0.25 | 0.49 |
| 120 | 0.39 | 0.41 | 0.26 | 0.48 | 0.39 | 0.165 | 0.43 | 0.39 | 0.25 | 0.47 | 0.35 | 0.23 | 0.42 | 0.34 | 0.140 | 0.37 | 0.34 | 0.165 | 0.38 | 0.34 | 0.24 | 0.42 |
| 150 | 0.32 | 0.33 | 0.26 | 0.43 | 0.32 | 0.165 | 0.36 | 0.32 | 0.25 | 0.41 | 0.29 | 0.23 | 0.37 | 0.28 | 0.140 | 0.31 | 0.28 | 0.165 | 0.32 | 0.28 | 0.24 | 0.37 |
| 185 | 0.25 | 0.27 | 0.26 | 0.37 | 0.26 | 0.165 | 0.30 | 0.25 | 0.25 | 0.36 | 0.23 | 0.23 | 0.32 | 0.22 | 0.140 | 0.26 | 0.22 | 0.165 | 0.28 | 0.22 | 0.24 | 0.33 |
| 240 | 0.190 | 0.21 | 0.26 | 0.33 | 0.20 | 0.160 | 0.25 | 0.195 | 0.25 | 0.31 | 0.185 | 0.22 | 0.29 | 0.170 | 0.140 | 0.22 | 0.170 | 0.165 | 0.24 | 0.170 | 0.24 | 0.29 |
| 300 | 0.155 | 0.175 | 0.25 | 0.31 | 0.160 | 0.160 | 0.22 | 0.155 | 0.25 | 0.29 | 0.150 | 0.22 | 0.27 | 0.140 | 0.140 | 0.195 | 0.135 | 0.160 | 0.21 | 0.135 | 0.24 | 0.27 |
| 400 | 0.120 | 0.140 | 0.25 | 0.29 | 0.130 | 0.155 | 0.20 | 0.125 | 0.24 | 0.27 | 0.125 | 0.22 | 0.25 | 0.110 | 0.135 | 0.175 | 0.110 | 0.160 | 0.195 | 0.110 | 0.24 | 0.26 |
| 500 | 0.093 | 0.120 | 0.25 | 0.28 | 0.105 | 0.155 | 0.185 | 0.098 | 0.24 | 0.26 | 0.100 | 0.22 | 0.24 | 0.090 | 0.135 | 0.160 | 0.088 | 0.160 | 0.180 | 0.085 | 0.24 | 0.25 |
| 630 | 0.072 | 0.100 | 0.25 | 0.27 | 0.086 | 0.155 | 0.175 | 0.078 | 0.24 | 0.25 | 0.088 | 0.21 | 0.23 | 0.074 | 0.135 | 0.150 | 0.071 | 0.160 | 0.170 | 0.068 | 0.23 | 0.24 |
| 800 | 0.056 | - | | | 0.072 | 0.150 | 0.170 | 0.064 | 0.24 | 0.25 | - | | | 0.062 | 0.130 | 0.145 | 0.059 | 0.155 | 0.165 | 0.055 | 0.23 | 0.24 |
| 1000 | 0.045 | - | | | 0.063 | 0.150 | 0.165 | 0.054 | 0.24 | 0.24 | - | | | 0.055 | 0.130 | 0.145 | 0.050 | 0.155 | 0.165 | 0.047 | 0.23 | 0.24 |

Note: *Spacings larger than one cable diameter will result in a large voltage drop.

r = conductor resistance at operating temperature

x = reactance

z = impedance



Rated Voltage




Standard



Flame Retardancy
IEC 60332-1-2



Reduced Fire Propagation
IEC 60332-3-24



Halogen Free
IEC 60754-1





Low Corrosivity
IEC 60754-2



Low Smoke Emission
IEC 61034-2

600/1000V XLPE Insulated, LSZH Sheathed Power Cables to IEC 60502-1 (Single Core)

FTX300 1RZ1-R (CU/XLPE/LSZH 600/1000V Class 2)

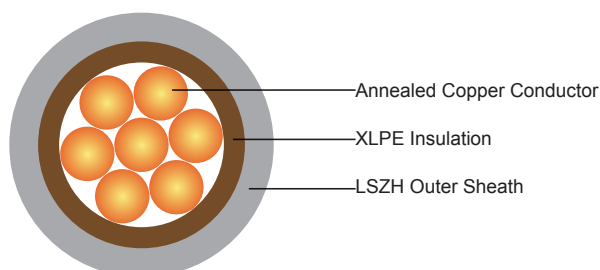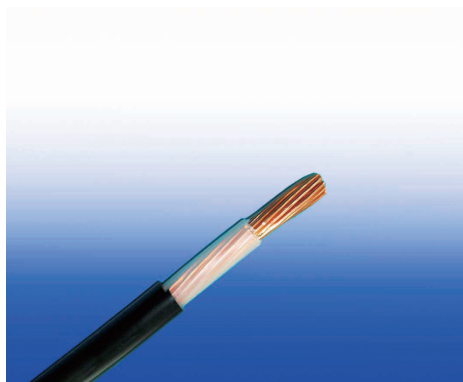

APPLICATION

These XLPE insulated and LSZH sheathed cables are generally used for fixed installation. Suitable for building wiring, especially in areas where smoke and fume emissions may cause a potential threat to life but not for burial in the ground, either directly or in ducts.

STANDARDS

Basic design to IEC 60502-1

FIRE PERFORMANCE

| | |
|---|-------------------------------|
| Flame Retardance (Single vertical wire or cable test) | IEC 60332-1-2; EN 60332-1-2 |
| Reduced Fire Propagation (Vertically-mounted bundled wires & cables test) | IEC 60332-3-24; EN 60332-3-24 |
| Halogen Free | IEC 60754-1; EN 50267-2-1 |
| No Corrosive Gas Emission | IEC 60754-2; EN 50267-2-2 |
| Minimum Smoke Emission | IEC 61034-2; EN 61034-2 |

VOLTAGE RATING

600/1000V

CABLE CONSTRUCTION

Conductor: The conductors shall be class 2 plain or metal-coated annealed copper in accordance with IEC 60228. Class 1 and class 5 conductor can be offered as option.

Insulation: Thermosetting XLPE compound as per IEC 60502-1.

Outer Sheath: Thermoplastic halogen free compound ST₈ as per IEC 60502-1.

Outer Sheath Option: UV resistance, hydrocarbon resistance, oil resistance, anti-rodent and anti-termite properties can be offered as option.



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

COLOUR CODE

Insulation Colour: Brown or blue; other colours can be offered upon request.

Sheath Colour: Black; other colours can be offered upon request.

PHYSICAL AND THERMAL PROPERTIES

Maximum temperature range during operation: 90°C

Maximum short circuit temperature (5 Seconds): 250°C

Minimum bending radius:

circular copper conductors OD≤25mm : 4 × Overall Diameter

circular copper conductors OD>25mm: 6 × Overall Diameter

shaped copper conductors: 8 × Overall Diameter

CONSTRUCTION PARAMETERS

| Conductor | | FTX300 1RZ1-R | | | |
|-------------------------------------|-----------------|------------------------------|--------------------------|--------------------------|----------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Nominal Sheath Thickness | Approx. Overall Diameter | Approx. Weight |
| No. × mm ² | | mm | mm | mm | kg/km |
| 1×1.5 | 2 | 0.7 | 1.4 | 5.8 | 54 |
| 1×2.5 | 2 | 0.7 | 1.4 | 6.2 | 67 |
| 1×4 | 2 | 0.7 | 1.4 | 6.8 | 87 |
| 1×6 | 2 | 0.7 | 1.4 | 7.3 | 113 |
| 1×10 | 2 | 0.7 | 1.4 | 8.3 | 163 |
| 1×16 | 2 | 0.7 | 1.4 | 9.3 | 232 |
| 1×25 | 2 | 0.9 | 1.4 | 11.0 | 346 |
| 1×35 | 2 | 0.9 | 1.4 | 12.2 | 456 |
| 1×50 | 2 | 1.0 | 1.4 | 13.7 | 599 |
| 1×70 | 2 | 1.1 | 1.4 | 15.7 | 835 |
| 1×95 | 2 | 1.1 | 1.5 | 17.8 | 1131 |
| 1×120 | 2 | 1.2 | 1.5 | 19.6 | 1407 |
| 1×150 | 2 | 1.4 | 1.6 | 21.8 | 1727 |
| 1×185 | 2 | 1.6 | 1.6 | 24.0 | 2144 |
| 1×240 | 2 | 1.7 | 1.7 | 27.1 | 2786 |
| 1×300 | 2 | 1.8 | 1.8 | 29.9 | 3466 |
| 1×400 | 2 | 2.0 | 1.9 | 33.5 | 4405 |
| 1×500 | 2 | 2.2 | 2.0 | 37.2 | 5520 |
| 1×630 | 2 | 2.4 | 2.2 | 42.0 | 7097 |
| 1×800 | 2 | 2.6 | 2.3 | 46.9 | 9010 |
| 1×1000 | 2 | 2.8 | 2.4 | 52.0 | 11286 |

ELECTRICAL PROPERTIES**Conductor operating temperature: 90°C****Ambient temperature: 30°C****Current-Carrying Capacities (Amp) according to BS 7671:2008 table 4E1A**

| Conductor cross-sectional area | Ref. Method A (enclosed in conduit in thermally insulating wall etc.) | | Ref. Method B (enclosed in conduit on a wall or in trunking etc.) | | Ref. Method C (clipped direct) | | Ref. Method F (in free air or on a perforated cable tray, horizontal or vertical etc.) Touching | | | Ref. Method G (in free air) Spaced by one cable diameter | |
|--------------------------------|---|---------------------------------|---|---------------------------------|---|--|---|---------------------------------|------------------------------------|---|----------|
| | 2 cables, single-phase a.c. or d.c. | 3 or 4 cables, three-phase a.c. | 2 cables, single-phase a.c. or d.c. | 3 or 4 cables, three-phase a.c. | 2 cables, single-phase a.c. or d.c. flat and touching | 3 or 4 cables, three-phase a.c. flat and touching or trefoil | 2 cables, single-phase a.c. or d.c. flat | 3 cables, three-phase a.c. flat | 3 cables, three-phase a.c. trefoil | 2 cables, single-phase a.c. or d.c. or 3 cables three-phase a.c. flat | |
| | | | | | | | | | | Horizontal | Vertical |
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 |
| mm ² | A | A | A | A | A | A | A | A | A | A | A |
| 1.5 | 19 | 17 | 23 | 20 | 25 | 23 | - | - | - | - | - |
| 2.5 | 26 | 23 | 31 | 28 | 34 | 31 | - | - | - | - | - |
| 4 | 35 | 31 | 42 | 37 | 46 | 41 | - | - | - | - | - |
| 6 | 45 | 40 | 54 | 48 | 59 | 54 | - | - | - | - | - |
| 10 | 61 | 54 | 75 | 66 | 81 | 74 | - | - | - | - | - |
| 16 | 81 | 73 | 100 | 88 | 109 | 99 | - | - | - | - | - |
| 25 | 106 | 95 | 133 | 117 | 143 | 130 | 161 | 141 | 135 | 182 | 161 |
| 35 | 131 | 117 | 164 | 144 | 176 | 161 | 200 | 176 | 169 | 226 | 201 |
| 50 | 158 | 141 | 198 | 175 | 228 | 209 | 242 | 216 | 207 | 275 | 246 |
| 70 | 200 | 179 | 253 | 222 | 293 | 268 | 310 | 279 | 268 | 353 | 318 |
| 95 | 241 | 216 | 306 | 269 | 355 | 326 | 377 | 342 | 328 | 430 | 389 |
| 120 | 278 | 249 | 354 | 312 | 413 | 379 | 437 | 400 | 383 | 500 | 454 |
| 150 | 318 | 285 | 393 | 342 | 476 | 436 | 504 | 464 | 444 | 577 | 527 |
| 185 | 362 | 324 | 449 | 384 | 545 | 500 | 575 | 533 | 510 | 661 | 605 |
| 240 | 424 | 380 | 528 | 450 | 644 | 590 | 679 | 634 | 607 | 781 | 719 |
| 300 | 486 | 435 | 603 | 514 | 743 | 681 | 783 | 736 | 703 | 902 | 833 |
| 400 | - | - | 683 | 584 | 868 | 793 | 940 | 868 | 823 | 1085 | 1008 |
| 500 | - | - | 783 | 666 | 990 | 904 | 1083 | 998 | 946 | 1253 | 1169 |
| 630 | - | - | 900 | 764 | 1130 | 1033 | 1254 | 1151 | 1088 | 1454 | 1362 |
| 800 | - | - | - | - | 1288 | 1179 | 1358 | 1275 | 1214 | 1581 | 1485 |
| 1000 | - | - | - | - | 1443 | 1323 | 1520 | 1436 | 1349 | 1775 | 1671 |



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

Voltage Drop (Per Amp Per Meter) according to BS 7671:2008 table 4E1B


| Conductor cross-sectional area | 2 cables d.c. | 2 cables, single-phase a.c. | | | | | | 3 or 4 cables, three-phase a.c. | | | | | | | | | | | | | | |
|--------------------------------|---------------|--|--------|------|---|--------|-------|--|---|------|-------|-----------------------|------|-------|----------------------|-------|-------|--------|-------|-------|------|------|
| | | Ref. Methods A&B (enclosed in conduit or trunking) | | | Ref. Methods C, F&G (clipped direct, on trays or in free air) | | | Ref. Methods A&B (enclosed in conduit or trunking) | Ref. Methods C, F&G (clipped direct, on trays or in free air) | | | | | | | | | | | | | |
| | | Cables touching | | | Cables spaced* | | | | Cables touching, Trefoil | | | Cables touching, Flat | | | Cables spaced*, Flat | | | | | | | |
| 1 | 2 | 3 | | | 4 | | | 5 | | | 6 | 7 | | | 8 | | | 9 | | | | |
| mm ² | mV/A/m | | mV/A/m | | | mV/A/m | | | mV/A/m | | | mV/A/m | | | mV/A/m | | | mV/A/m | | | | |
| 1.5 | 31 | 31 | | | 31 | | | 31 | | | 27 | 27 | | | 27 | | | 27 | | | | |
| 2.5 | 19 | 19 | | | 19 | | | 19 | | | 16 | 16 | | | 16 | | | 16 | | | | |
| 4 | 12 | 12 | | | 12 | | | 12 | | | 10 | 10 | | | 10 | | | 10 | | | | |
| 6 | 7.9 | 7.9 | | | 7.9 | | | 7.9 | | | 6.8 | 6.8 | | | 6.8 | | | 6.8 | | | | |
| 10 | 4.7 | 4.7 | | | 4.7 | | | 4.7 | | | 4.0 | 4.0 | | | 4.0 | | | 4.0 | | | | |
| 16 | 2.9 | 2.9 | | | 2.9 | | | 2.9 | | | 2.5 | 2.5 | | | 2.5 | | | 2.5 | | | | |
| | | r | x | z | r | x | z | r | x | z | r | x | z | r | x | z | r | x | z | r | x | z |
| 25 | 1.85 | 1.85 | 0.31 | 1.90 | 1.85 | 0.190 | 1.85 | 1.85 | 0.28 | 1.85 | 1.60 | 0.27 | 1.65 | 1.60 | 0.165 | 1.60 | 1.60 | 0.190 | 1.60 | 1.60 | 0.27 | 1.65 |
| 35 | 1.35 | 1.35 | 0.29 | 1.35 | 1.35 | 0.180 | 1.35 | 1.35 | 0.27 | 1.35 | 1.15 | 0.25 | 1.15 | 1.15 | 0.155 | 1.15 | 1.15 | 0.180 | 1.15 | 1.15 | 0.26 | 1.20 |
| 50 | 0.99 | 1.00 | 0.29 | 1.05 | 0.99 | 0.180 | 1.00 | 0.99 | 0.27 | 1.00 | 0.87 | 0.25 | 0.90 | 0.86 | 0.155 | 0.87 | 0.86 | 0.180 | 0.87 | 0.86 | 0.26 | 0.89 |
| 70 | 0.68 | 0.70 | 0.28 | 0.75 | 0.68 | 0.175 | 0.71 | 0.68 | 0.26 | 0.73 | 0.60 | 0.24 | 0.65 | 0.59 | 0.150 | 0.61 | 0.59 | 0.175 | 0.62 | 0.59 | 0.25 | 0.65 |
| 95 | 0.49 | 0.51 | 0.27 | 0.58 | 0.49 | 0.170 | 0.52 | 0.49 | 0.26 | 0.56 | 0.44 | 0.23 | 0.50 | 0.43 | 0.145 | 0.45 | 0.43 | 0.170 | 0.46 | 0.43 | 0.25 | 0.49 |
| 120 | 0.39 | 0.41 | 0.26 | 0.48 | 0.39 | 0.165 | 0.43 | 0.39 | 0.25 | 0.47 | 0.35 | 0.23 | 0.42 | 0.34 | 0.140 | 0.37 | 0.34 | 0.165 | 0.38 | 0.34 | 0.24 | 0.42 |
| 150 | 0.32 | 0.33 | 0.26 | 0.43 | 0.32 | 0.165 | 0.36 | 0.32 | 0.25 | 0.41 | 0.29 | 0.23 | 0.37 | 0.28 | 0.140 | 0.31 | 0.28 | 0.165 | 0.32 | 0.28 | 0.24 | 0.37 |
| 185 | 0.25 | 0.27 | 0.26 | 0.37 | 0.26 | 0.165 | 0.30 | 0.25 | 0.25 | 0.36 | 0.23 | 0.23 | 0.32 | 0.22 | 0.140 | 0.26 | 0.22 | 0.165 | 0.28 | 0.22 | 0.24 | 0.33 |
| 240 | 0.190 | 0.21 | 0.26 | 0.33 | 0.20 | 0.160 | 0.25 | 0.195 | 0.25 | 0.31 | 0.185 | 0.22 | 0.29 | 0.170 | 0.140 | 0.22 | 0.170 | 0.165 | 0.24 | 0.170 | 0.24 | 0.29 |
| 300 | 0.155 | 0.175 | 0.25 | 0.31 | 0.160 | 0.160 | 0.22 | 0.155 | 0.25 | 0.29 | 0.150 | 0.22 | 0.27 | 0.140 | 0.140 | 0.195 | 0.135 | 0.160 | 0.21 | 0.135 | 0.24 | 0.27 |
| 400 | 0.120 | 0.140 | 0.25 | 0.29 | 0.130 | 0.155 | 0.20 | 0.125 | 0.24 | 0.27 | 0.125 | 0.22 | 0.25 | 0.110 | 0.135 | 0.175 | 0.110 | 0.160 | 0.195 | 0.110 | 0.24 | 0.26 |
| 500 | 0.093 | 0.120 | 0.25 | 0.28 | 0.105 | 0.155 | 0.185 | 0.098 | 0.24 | 0.26 | 0.100 | 0.22 | 0.24 | 0.090 | 0.135 | 0.160 | 0.088 | 0.160 | 0.180 | 0.085 | 0.24 | 0.25 |
| 630 | 0.072 | 0.100 | 0.25 | 0.27 | 0.086 | 0.155 | 0.175 | 0.078 | 0.24 | 0.25 | 0.088 | 0.21 | 0.23 | 0.074 | 0.135 | 0.150 | 0.071 | 0.160 | 0.170 | 0.068 | 0.23 | 0.24 |
| 800 | 0.056 | - | | | 0.072 | 0.150 | 0.170 | 0.064 | 0.24 | 0.25 | - | | | 0.062 | 0.130 | 0.145 | 0.059 | 0.155 | 0.165 | 0.055 | 0.23 | 0.24 |
| 1000 | 0.045 | - | | | 0.063 | 0.150 | 0.165 | 0.054 | 0.24 | 0.24 | - | | | 0.055 | 0.130 | 0.145 | 0.050 | 0.155 | 0.165 | 0.047 | 0.23 | 0.24 |

Note: *Spacings larger than one cable diameter will result in a large voltage drop.

r = conductor resistance at operating temperature

x = reactance

z = impedance



Rated Voltage




Standard



Flame Retardancy
IEC 60332-1-2



Reduced Fire Propagation
IEC 60332-3-24



Halogen Free
IEC 60754-1





Low Corrosivity
IEC 60754-2



Low Smoke Emission
IEC 61034-2

600/1000V XLPE Insulated, LSZH Sheathed, Armoured Power Cables to BS 6724 (Single Core)

FTX300 1RZ1MAZ1-R (CU/XLPE/LSZH/AWA/LSZH 600/1000V Class 2)

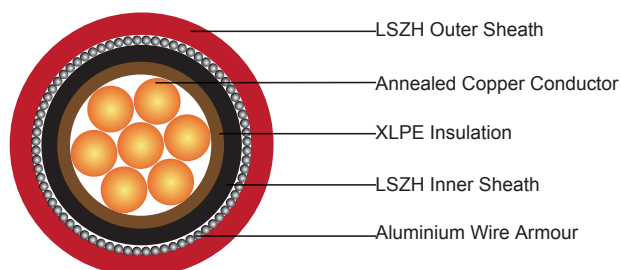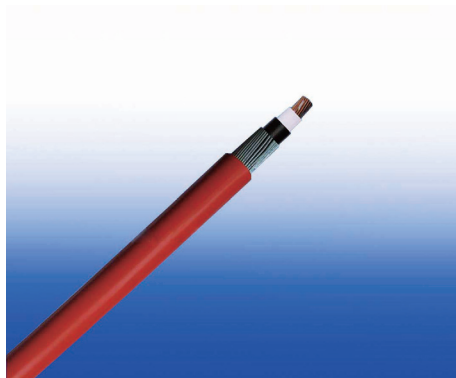

APPLICATION

The cables are mainly used in power stations, mass transit underground passenger systems, airports, petrochemical plants, hotels, hospitals and high-rise buildings.

STANDARDS

Basic design to BS 6724

FIRE PERFORMANCE

| | |
|---|-------------------------------|
| Flame Retardance (Single vertical wire or cable test) | IEC 60332-1-2; EN 60332-1-2 |
| Reduced Fire Propagation (Vertically-mounted bundled wires & cables test) | IEC 60332-3-24; EN 60332-3-24 |
| Halogen Free | IEC 60754-1; EN 50267-2-1 |
| No Corrosive Gas Emission | IEC 60754-2; EN 50267-2-2 |
| Minimum Smoke Emission | IEC 61034-2; EN 61034-2 |

VOLTAGE RATING

600/1000V

CABLE CONSTRUCTION

Conductor: Annealed copper wire, stranded according to BS EN 60228 class 2.

Insulation: XLPE type GP8 according to BS 7655-1.3. HEPR type GP6 according to BS 7655-1.2 or crosslinked polyolefin material type EI 5 according to BS EN 50363-5 can be offered as option.

Bedding: Extruded layer of polymeric material.

Armouring: Aluminium wire.

Outer Sheath: Extruded layer of polymeric material LTS 1 according to BS 7655-6.1.

Outer Sheath Option: UV resistance, hydrocarbon resistance, oil resistance, anti-rodent and anti-termite properties can be offered as option.



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

COLOUR CODE

Insulation Colour: Brown or blue; other colours can be offered upon request.

Sheath Colour: Black; other colours can be offered upon request.

PHYSICAL AND THERMAL PROPERTIES

Maximum temperature range during operation: 90°C

Maximum short circuit temperature (5 Seconds): 250°C

Minimum bending radius: 6 × Overall Diameter

CONSTRUCTION PARAMETERS

| Conductor | | FTX300 1RZ1MAZ1-R | | | | | |
|-------------------------------------|-----------------|------------------------------|---------------------------|---------------------------------|--------------------------|--------------------------|----------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Nominal Bedding Thickness | Nominal AL Wire Armour Diameter | Nominal Sheath Thickness | Approx. Overall Diameter | Approx. Weight |
| No. × mm ² | | mm | mm | mm | mm | mm | kg/km |
| 1×50 | 2 | 1.0 | 0.8 | 0.9 | 1.5 | 17.5 | 688 |
| 1×70 | 2 | 1.1 | 0.8 | 1.25 | 1.5 | 20.2 | 941 |
| 1×95 | 2 | 1.1 | 0.8 | 1.25 | 1.6 | 22.3 | 1244 |
| 1×120 | 2 | 1.2 | 0.8 | 1.25 | 1.6 | 24.2 | 1524 |
| 1×150 | 2 | 1.4 | 1.0 | 1.6 | 1.7 | 27.4 | 1853 |
| 1×185 | 2 | 1.6 | 1.0 | 1.6 | 1.8 | 30.0 | 2292 |
| 1×240 | 2 | 1.7 | 1.0 | 1.6 | 1.8 | 32.8 | 2925 |
| 1×300 | 2 | 1.8 | 1.0 | 1.6 | 1.9 | 35.6 | 3612 |
| 1×400 | 2 | 2.0 | 1.2 | 2.0 | 2.0 | 40.5 | 4653 |
| 1×500 | 2 | 2.2 | 1.2 | 2.0 | 2.1 | 44.2 | 5779 |
| 1×630 | 2 | 2.4 | 1.2 | 2.0 | 2.2 | 48.8 | 7341 |
| 1×800 | 2 | 2.6 | 1.4 | 2.5 | 2.4 | 55.4 | 9364 |
| 1×1000 | 2 | 2.8 | 1.4 | 2.5 | 2.5 | 60.6 | 11644 |

ELECTRICAL PROPERTIES**Conductor operating temperature: 90°C****Ambient temperature: 30°C****Current-Carrying Capacities (Amp) according to BS 7671:2008 table 4E3A**

| Conductor cross-sectional area | Ref. Method C (clipped direct) | | Ref. Method F (in free air or on a perforated cable tray, horizontal or vertical) | | | | | | | | |
|--------------------------------|--|--------------------------------------|--|--------------------------------------|-----------------------------------|-----------------------------|----------|-----------------------------|----------|---------------------------------|----------|
| | Touching | | Touching | | | Spaced by on cable diameter | | | | | |
| | 2 cables, single-phase a.c. or d.c. flat | 3 or 4 cables, three-phase a.c. flat | 2 cables, single-phase a.c. or d.c. flat | 3 or 4 cables, three-phase a.c. flat | 3 cables three-phase a.c. trefoil | 2 cables, d.c. | | 2 cables, single-phase a.c. | | 3 or 4 cables, three-phase a.c. | |
| | | | | | | Horizontal | Vertical | Horizontal | Vertical | Horizontal | Vertical |
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 |
| mm ² | A | A | A | A | A | A | A | A | A | A | A |
| 50 | 237 | 220 | 253 | 232 | 222 | 284 | 270 | 282 | 266 | 288 | 266 |
| 70 | 303 | 277 | 322 | 293 | 285 | 356 | 349 | 357 | 337 | 358 | 331 |
| 95 | 367 | 333 | 389 | 352 | 346 | 446 | 426 | 436 | 412 | 425 | 393 |
| 120 | 425 | 383 | 449 | 405 | 402 | 519 | 497 | 504 | 477 | 485 | 449 |
| 150 | 488 | 437 | 516 | 462 | 463 | 600 | 575 | 566 | 539 | 549 | 510 |
| 185 | 557 | 496 | 587 | 524 | 529 | 688 | 660 | 643 | 614 | 618 | 574 |
| 240 | 656 | 579 | 689 | 612 | 625 | 815 | 782 | 749 | 714 | 715 | 666 |
| 300 | 755 | 662 | 792 | 700 | 720 | 943 | 906 | 842 | 805 | 810 | 755 |
| 400 | 853 | 717 | 899 | 767 | 815 | 1137 | 1094 | 929 | 889 | 848 | 797 |
| 500 | 962 | 791 | 1016 | 851 | 918 | 1314 | 1266 | 1032 | 989 | 923 | 871 |
| 630 | 1082 | 861 | 1146 | 935 | 1027 | 1528 | 1474 | 1139 | 1092 | 992 | 940 |
| 800 | 1170 | 904 | 1246 | 987 | 1119 | 1809 | 1744 | 1204 | 1155 | 1042 | 978 |
| 1000 | 1261 | 961 | 1345 | 1055 | 1214 | 2100 | 2026 | 1289 | 1238 | 1110 | 1041 |



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

Voltage Drop (Per Amp Per Meter) according to BS 7671:2008 table 4E3B


| Conductor cross-sectional area | 2 cables d.c. | Ref. Methods C&F (clipped direct, on trays or in free air) | | | | | | | | | | | | | | |
|--------------------------------|---------------|--|-------|-------|---------|------|------|---------------------------------|-------|-------|-------------------|-------|------|------------------|-------|------|
| | | 2 cables, single-phase a.c. | | | | | | 3 or 4 cables, three-phase a.c. | | | | | | | | |
| | | Touching | | | Spaced* | | | Trefoil and touching | | | Flat and touching | | | Flat and spaced* | | |
| 1 | 2 | 3 | | | 4 | | | 5 | | | 6 | | | 7 | | |
| mm ² | mV/A/m | | | | mV/A/m | | | mV/A/m | | | mV/A/m | | | mV/A/m | | |
| | r | x | z | r | x | z | r | x | z | r | x | z | r | x | z | |
| 50 | 0.98 | 0.99 | 0.21 | 1.00 | 0.98 | 0.29 | 1.00 | 0.86 | 0.180 | 0.87 | 0.84 | 0.25 | 0.88 | 0.84 | 0.33 | 0.90 |
| 70 | 0.67 | 0.68 | 0.20 | 0.71 | 0.69 | 0.29 | 0.75 | 0.59 | 0.170 | 0.62 | 0.60 | 0.25 | 0.65 | 0.62 | 0.32 | 0.70 |
| 95 | 0.49 | 0.51 | 0.195 | 0.55 | 0.53 | 0.28 | 0.60 | 0.44 | 0.170 | 0.47 | 0.46 | 0.24 | 0.52 | 0.49 | 0.31 | 0.58 |
| 120 | 0.39 | 0.41 | 0.190 | 0.45 | 0.43 | 0.27 | 0.51 | 0.35 | 0.165 | 0.39 | 0.38 | 0.34 | 0.44 | 0.41 | 0.30 | 0.51 |
| 150 | 0.31 | 0.33 | 0.185 | 0.38 | 0.36 | 0.27 | 0.45 | 0.29 | 0.160 | 0.33 | 0.31 | 0.23 | 0.39 | 0.34 | 0.39 | 0.45 |
| 185 | 0.25 | 0.27 | 0.185 | 0.33 | 0.30 | 0.26 | 0.40 | 0.23 | 0.160 | 0.28 | 0.26 | 0.23 | 0.34 | 0.29 | 0.29 | 0.41 |
| 240 | 0.195 | 0.21 | 0.180 | 0.28 | 0.24 | 0.26 | 0.35 | 0.180 | 0.155 | 0.24 | 0.21 | 0.22 | 0.30 | 0.24 | 0.28 | 0.37 |
| 300 | 0.155 | 0.17 | 0.175 | 0.25 | 0.195 | 0.25 | 0.32 | 0.145 | 0.150 | 0.21 | 0.170 | 0.22 | 0.28 | 0.20 | 0.27 | 0.34 |
| 400 | 0.115 | 0.145 | 0.170 | 0.22 | 0.180 | 0.24 | 0.30 | 0.125 | 0.150 | 0.195 | 0.160 | 0.21 | 0.27 | 0.20 | 0.27 | 0.33 |
| 500 | 0.093 | 0.125 | 0.170 | 0.21 | 0.165 | 0.24 | 0.29 | 0.105 | 0.145 | 0.180 | 0.145 | 0.20 | 0.25 | 0.190 | 0.24 | 0.31 |
| 630 | 0.073 | 0.105 | 0.165 | 0.195 | 0.150 | 0.23 | 0.27 | 0.092 | 0.145 | 0.170 | 0.135 | 0.195 | 0.24 | 0.175 | 0.23 | 0.29 |
| 800 | 0.056 | 0.090 | 0.160 | 0.190 | 0.145 | 0.23 | 0.27 | 0.086 | 0.140 | 0.165 | 0.130 | 0.180 | 0.23 | 0.175 | 0.195 | 0.26 |
| 1000 | 0.045 | 0.092 | 0.155 | 0.180 | 0.140 | 0.21 | 0.25 | 0.080 | 0.135 | 0.155 | 0.125 | 0.170 | 0.21 | 0.165 | 0.180 | 0.24 |

Note: *Spacings larger than one cable diameter will result in a large voltage drop.

r = conductor resistance at operating temperature

x = reactance

z = impedance



Rated Voltage




Standard



Flame Retardancy
IEC 60332-1-2



Reduced Fire Propagation
IEC 60332-3-24



Halogen Free
IEC 60754-1





Low Corrosivity
IEC 60754-2



Low Smoke Emission
IEC 61034-2

600/1000V XLPE Insulated, LSZH Sheathed, Armoured Power Cables to IEC 60502-1 (Single Core)

FTX300 1RZ1MAZ1-R (CU/XLPE/LSZH/AWA/LSZH 600/1000V Class 2)

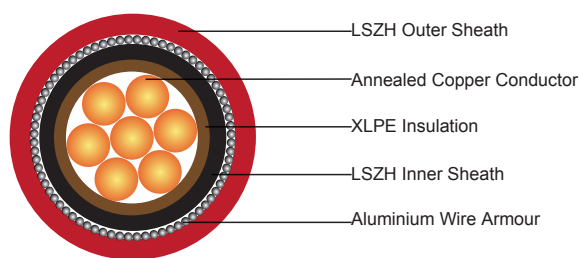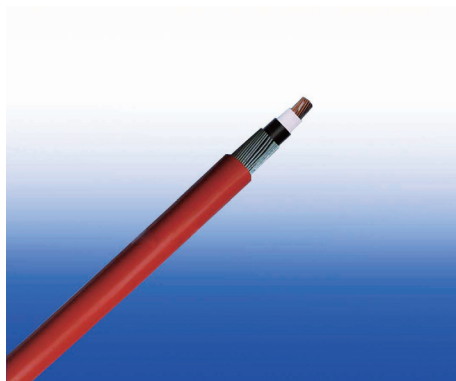

APPLICATION

The cables are mainly used in power stations, mass transit underground passenger systems, airports, petrochemical plants, hotels, hospitals and high-rise buildings.

STANDARDS

Basic design to IEC 60502-1

FIRE PERFORMANCE

| | |
|---|-------------------------------|
| Flame Retardance (Single vertical wire or cable test) | IEC 60332-1-2; EN 60332-1-2 |
| Reduced Fire Propagation (Vertically-mounted bundled wires & cables test) | IEC 60332-3-24; EN 60332-3-24 |
| Halogen Free | IEC 60754-1; EN 50267-2-1 |
| No Corrosive Gas Emission | IEC 60754-2; EN 50267-2-2 |
| Minimum Smoke Emission | IEC 61034-2; EN 61034-2 |

VOLTAGE RATING

600/1000V

CABLE CONSTRUCTION

Conductor: The conductors shall be class 2 plain or metal-coated annealed copper in accordance with IEC 60228. Class 1 and class 5 conductor can be offered as option.

Insulation: Thermosetting XLPE compound as per IEC 60502-1.

Inner Covering Option: Thermoplastic halogen free compound ST₈ as per IEC 60502-1.

Armouring: Aluminium wire.

Outer Sheath: Thermoplastic halogen free compound ST₈ as per IEC 60502-1.

Outer Sheath Option: UV resistance, hydrocarbon resistance, oil resistance, anti-rodent and anti-termite properties can be offered as option.



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

COLOUR CODE

Insulation Colour: Brown or blue; other colours can be offered upon request.

Sheath Colour: Black; other colours can be offered upon request.

PHYSICAL AND THERMAL PROPERTIES

Maximum temperature range during operation: 90°C

Maximum short circuit temperature (5 Seconds): 250°C

Minimum bending radius: 6 × Overall Diameter

CONSTRUCTION PARAMETERS

| Conductor | | FTX300 1RZ1MAZ1-R | | | | | |
|-------------------------------------|-----------------|------------------------------|----------------------------------|--------------------------|--------------------------|--------------------------|----------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Nominal Inner Covering Thickness | Nominal AL Wire Diameter | Nominal Sheath Thickness | Approx. Overall Diameter | Approx. Weight |
| No. × mm ² | | mm | mm | mm | mm | mm | kg/km |
| 1×4 | 2 | 0.7 | 1.0 | 0.8 | 1.8 | 11.2 | 200 |
| 1×6 | 2 | 0.7 | 1.0 | 0.8 | 1.8 | 11.7 | 233 |
| 1×10 | 2 | 0.7 | 1.0 | 0.8 | 1.8 | 12.7 | 294 |
| 1×16 | 2 | 0.7 | 1.0 | 0.8 | 1.8 | 13.7 | 377 |
| 1×25 | 2 | 0.9 | 1.0 | 0.8 | 1.8 | 15.4 | 513 |
| 1×35 | 2 | 0.9 | 1.0 | 1.25 | 1.8 | 17.5 | 688 |
| 1×50 | 2 | 1.0 | 1.0 | 1.25 | 1.8 | 19.0 | 856 |
| 1×70 | 2 | 1.1 | 1.0 | 1.25 | 1.8 | 21.0 | 1124 |
| 1×95 | 2 | 1.1 | 1.0 | 1.6 | 1.8 | 24.0 | 1521 |
| 1×120 | 2 | 1.2 | 1.0 | 1.6 | 1.8 | 25.8 | 1831 |
| 1×150 | 2 | 1.4 | 1.0 | 1.6 | 1.8 | 27.8 | 2176 |
| 1×185 | 2 | 1.6 | 1.0 | 1.6 | 1.8 | 30.4 | 2668 |
| 1×240 | 2 | 1.7 | 1.0 | 1.6 | 1.9 | 33.5 | 3367 |
| 1×300 | 2 | 1.8 | 1.0 | 2.0 | 2.0 | 37.5 | 4241 |
| 1×400 | 2 | 2.0 | 1.2 | 2.0 | 2.2 | 41.3 | 5283 |
| 1×500 | 2 | 2.2 | 1.2 | 2.0 | 2.3 | 45.4 | 6535 |

ELECTRICAL PROPERTIES**Conductor operating temperature:** 90°C**Ambient temperature:** 30°C**Current-Carrying Capacities (Amp) according to BS 7671:2008 table 4E3A**

| Conductor cross-sectional area | Ref. Method C (clipped direct) | | Ref. Method F (in free air or on a perforated cable tray, horizontal or vertical) | | | | | | | | |
|--------------------------------|--|--------------------------------------|--|--------------------------------------|-----------------------------------|-----------------------------|----------|-----------------------------|----------|---------------------------------|----------|
| | Touching | | Touching | | | Spaced by on cable diameter | | | | | |
| | 2 cables, single-phase a.c. or d.c. flat | 3 or 4 cables, three-phase a.c. flat | 2 cables, single-phase a.c. or d.c. flat | 3 or 4 cables, three-phase a.c. flat | 3 cables three-phase a.c. trefoil | 2 cables, d.c. | | 2 cables, single-phase a.c. | | 3 or 4 cables, three-phase a.c. | |
| | | | | | | Horizontal | Vertical | Horizontal | Vertical | Horizontal | Vertical |
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 |
| mm ² | A | A | A | A | A | A | A | A | A | A | A |
| 50 | 237 | 220 | 253 | 232 | 222 | 284 | 270 | 282 | 266 | 288 | 266 |
| 70 | 303 | 277 | 322 | 293 | 285 | 356 | 349 | 357 | 337 | 358 | 331 |
| 95 | 367 | 333 | 389 | 352 | 346 | 446 | 426 | 436 | 412 | 425 | 393 |
| 120 | 425 | 383 | 449 | 405 | 402 | 519 | 497 | 504 | 477 | 485 | 449 |
| 150 | 488 | 437 | 516 | 462 | 463 | 600 | 575 | 566 | 539 | 549 | 510 |
| 185 | 557 | 496 | 587 | 524 | 529 | 688 | 660 | 643 | 614 | 618 | 574 |
| 240 | 656 | 579 | 689 | 612 | 625 | 815 | 782 | 749 | 714 | 715 | 666 |
| 300 | 755 | 662 | 792 | 700 | 720 | 943 | 906 | 842 | 805 | 810 | 755 |
| 400 | 853 | 717 | 899 | 767 | 815 | 1137 | 1094 | 929 | 889 | 848 | 797 |
| 500 | 962 | 791 | 1016 | 851 | 918 | 1314 | 1266 | 1032 | 989 | 923 | 871 |



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

Voltage Drop (Per Amp Per Meter) according to BS 7671:2008 table 4E3B


| Conductor cross-sectional area | 2 cables d.c. | Ref. Methods C&F (clipped direct, on trays or in free air) | | | | | | | | | | | | | | |
|--------------------------------|---------------|--|-------|------|---------|------|------|---------------------------------|-------|-------|-------------------|------|------|------------------|------|------|
| | | 2 cables, single-phase a.c. | | | | | | 3 or 4 cables, three-phase a.c. | | | | | | | | |
| | | Touching | | | Spaced* | | | Trefoil and touching | | | Flat and touching | | | Flat and spaced* | | |
| 1 | 2 | 3 | | | 4 | | | 5 | | | 6 | | | 7 | | |
| mm ² | mV/A/m | mV/A/m | | | mV/A/m | | | mV/A/m | | | mV/A/m | | | mV/A/m | | |
| | | r | x | z | r | x | z | r | x | z | r | x | z | r | x | z |
| 50 | 0.98 | 0.99 | 0.21 | 1.00 | 0.98 | 0.29 | 1.00 | 0.86 | 0.180 | 0.87 | 0.84 | 0.25 | 0.88 | 0.84 | 0.33 | 0.90 |
| 70 | 0.67 | 0.68 | 0.20 | 0.71 | 0.69 | 0.29 | 0.75 | 0.59 | 0.170 | 0.62 | 0.60 | 0.25 | 0.65 | 0.62 | 0.32 | 0.70 |
| 95 | 0.49 | 0.51 | 0.195 | 0.55 | 0.53 | 0.28 | 0.60 | 0.44 | 0.170 | 0.47 | 0.46 | 0.24 | 0.52 | 0.49 | 0.31 | 0.58 |
| 120 | 0.39 | 0.41 | 0.190 | 0.45 | 0.43 | 0.27 | 0.51 | 0.35 | 0.165 | 0.39 | 0.38 | 0.34 | 0.44 | 0.41 | 0.30 | 0.51 |
| 150 | 0.31 | 0.33 | 0.185 | 0.38 | 0.36 | 0.27 | 0.45 | 0.29 | 0.160 | 0.33 | 0.31 | 0.23 | 0.39 | 0.34 | 0.39 | 0.45 |
| 185 | 0.25 | 0.27 | 0.185 | 0.33 | 0.30 | 0.26 | 0.40 | 0.23 | 0.160 | 0.28 | 0.26 | 0.23 | 0.34 | 0.29 | 0.29 | 0.41 |
| 240 | 0.195 | 0.21 | 0.180 | 0.28 | 0.24 | 0.26 | 0.35 | 0.180 | 0.155 | 0.24 | 0.21 | 0.22 | 0.30 | 0.24 | 0.28 | 0.37 |
| 300 | 0.155 | 0.17 | 0.175 | 0.25 | 0.195 | 0.25 | 0.32 | 0.145 | 0.150 | 0.21 | 0.170 | 0.22 | 0.28 | 0.20 | 0.27 | 0.34 |
| 400 | 0.115 | 0.145 | 0.170 | 0.22 | 0.180 | 0.24 | 0.30 | 0.125 | 0.150 | 0.195 | 0.160 | 0.21 | 0.27 | 0.20 | 0.27 | 0.33 |
| 500 | 0.093 | 0.125 | 0.170 | 0.21 | 0.165 | 0.24 | 0.29 | 0.105 | 0.145 | 0.180 | 0.145 | 0.20 | 0.25 | 0.190 | 0.24 | 0.31 |

Note: *Spacings larger than one cable diameter will result in a large voltage drop.

r = conductor resistance at operating temperature

x = reactance

z = impedance



Rated Voltage




Standard



Flame Retardancy
IEC 60332-1-2



Reduced Fire Propagation
IEC 60332-3-24



Halogen Free
IEC 60754-1




Low Corrosivity
IEC 60754-2



Low Smoke Emission
IEC 61034-2

600/1000V XLPE Insulated, LSZH Sheathed Power Cables to BS 8573 (2-5 Cores)

FTX400 1RZ1-R (CU/XLPE/LSZH 600/1000V Class 2)

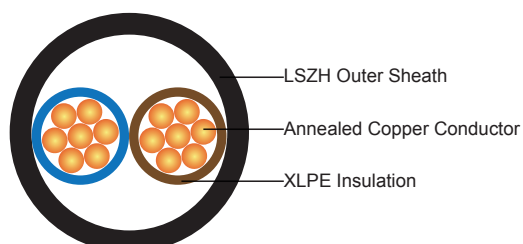

APPLICATION

The cables are mainly used in power stations, mass transit underground passenger systems, airports, petrochemical plants, hotels, hospitals and high-rise buildings.

STANDARDS

Basic design to BS 8573:2012

FIRE PERFORMANCE

| | |
|---|-------------------------------|
| Flame Retardance (Single vertical wire or cable test) | IEC 60332-1-2; EN 60332-1-2 |
| Reduced Fire Propagation (Vertically-mounted bundled wires & cables test) | IEC 60332-3-24; EN 60332-3-24 |
| Halogen Free | IEC 60754-1; EN 50267-2-1 |
| No Corrosive Gas Emission | IEC 60754-2; EN 50267-2-2 |
| Minimum Smoke Emission | IEC 61034-2; EN 61034-2 |

VOLTAGE RATING

600/1000V

CABLE CONSTRUCTION

Conductor: Annealed copper conductor, stranded according to BS EN 60228 class 2.

Insulation: Thermosetting insulation XLPE Type GP8 according to BS 7655-1.3. HEPR Type GP6 according to BS 7655-1.2 or crosslinked polyolefin material type EI 5 according to BS EN 50363-5 can be offered as option.

Inner Covering Option: The optional inner covering, where used, shall consist of an extruded layer of synthetic polymeric material. It shall surround the single core and the laid-up two, three, four or five cores, giving the assembly a practically circular shape.

Outer Sheath: Extruded layer of polymeric material LTS 4 according to BS 7655-6.1.

Outer Sheath Option: UV resistance, hydrocarbon resistance, oil resistance, anti-rodent and anti-termite properties can be offered as option.

COLOUR CODE

Insulation Colour



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

2-core: Brown and blue.

3-core: Brown, black and grey.

Alternatively, green-and-yellow, blue, brown.

4-core: Blue, brown black and grey.

Alternatively, green-and-yellow, brown, black, grey.

5-core: Green and yellow, blue, brown black, grey.

Sheath Colour: Black; other colours can be offered upon request.

PHYSICAL AND THERMAL PROPERTIES

Maximum temperature range during operation: 90°C

Maximum short circuit temperature (5 Seconds): 250°C

Minimum bending radius

circular copper conductors OD≤25mm : 4 × Overall Diameter

circular copper conductors OD>25mm: 6 × Overall Diameter

shaped copper conductors: 8 × Overall Diameter

CONSTRUCTION PARAMETERS

| Conductor | | FTX400 1RZ1-R | | | | |
|-------------------------------------|-----------------|------------------------------|----------------------------------|--------------------------|--------------------------|----------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Nominal Inner Covering Thickness | Nominal Sheath Thickness | Approx. Overall Diameter | Approx. Weight |
| No. × mm ² | | mm | mm | mm | mm | kg/km |
| 2×1.5 ^a | 2 | 0.7 | 0.4 | 1.8 | 9.6 | 117 |
| 2×2.5 ^a | 2 | 0.7 | 0.4 | 1.8 | 10.4 | 146 |
| 2×4 ^a | 2 | 0.7 | 0.4 | 1.8 | 11.5 | 190 |
| 2×6 ^a | 2 | 0.7 | 0.4 | 1.8 | 12.6 | 244 |
| 2×10 ^a | 2 | 0.7 | 0.6 | 1.8 | 14.5 | 349 |
| 2×16 ^a | 2 | 0.7 | 0.6 | 1.8 | 16.6 | 495 |
| 2×25 ^a | 2 | 0.9 | 0.8 | 1.8 | 20.0 | 735 |
| 2×35 ^a | 2 | 0.9 | 0.8 | 1.8 | 22.3 | 963 |
| 2×50 ^a | 2 | 1.0 | 1.0 | 1.8 | 25.4 | 1261 |
| 2×70 ^a | 2 | 1.1 | 1.0 | 1.8 | 29.4 | 1751 |
| 2×95 ^a | 2 | 1.1 | 1.2 | 1.9 | 33.4 | 2359 |
| 2×120 ^a | 2 | 1.2 | 1.2 | 2.0 | 37.2 | 2950 |
| 2×25 ^b | 2 | 0.9 | 0.6 | 1.8 | 16.1 | 692 |
| 2×35 ^b | 2 | 0.9 | 0.6 | 1.8 | 17.9 | 913 |
| 2×50 ^b | 2 | 1.0 | 0.8 | 1.8 | 20.6 | 1205 |
| 2×70 ^b | 2 | 1.1 | 0.8 | 1.8 | 23.5 | 1680 |
| 2×95 ^b | 2 | 1.1 | 1.0 | 1.9 | 26.2 | 2268 |
| 2×120 ^b | 2 | 1.2 | 1.0 | 2.0 | 29.0 | 2838 |
| 3×1.5 ^a | 2 | 0.7 | 0.4 | 1.8 | 10.0 | 143 |
| 3×2.5 ^a | 2 | 0.7 | 0.4 | 1.8 | 10.9 | 183 |
| 3×4 ^a | 2 | 0.7 | 0.4 | 1.8 | 12.1 | 244 |
| 3×6 ^a | 2 | 0.7 | 0.4 | 1.8 | 13.3 | 321 |
| 3×10 ^a | 2 | 0.7 | 0.6 | 1.8 | 15.3 | 472 |

| Conductor | | FTX400 1RZ1-R | | | | |
|-------------------------------------|-----------------|------------------------------|----------------------------------|--------------------------|--------------------------|----------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Nominal Inner Covering Thickness | Nominal Sheath Thickness | Approx. Overall Diameter | Approx. Weight |
| No. × mm ² | | mm | mm | mm | mm | kg/km |
| 3×16 ^a | 2 | 0.7 | 0.6 | 1.8 | 17.6 | 681 |
| 3×25 ^a | 2 | 0.9 | 0.8 | 1.8 | 21.3 | 1027 |
| 3×35 ^a | 2 | 0.9 | 0.8 | 1.8 | 23.8 | 1360 |
| 3×50 ^a | 2 | 1.0 | 1.0 | 1.8 | 27.1 | 1795 |
| 3×70 ^a | 2 | 1.1 | 1.2 | 1.9 | 31.6 | 2530 |
| 3×95 ^a | 2 | 1.1 | 1.2 | 2.0 | 36.1 | 3441 |
| 3×120 ^a | 2 | 1.2 | 1.2 | 2.1 | 40.2 | 4307 |
| 3×25 ^b | 2 | 0.9 | 0.6 | 1.8 | 18.5 | 993 |
| 3×35 ^b | 2 | 0.9 | 0.8 | 1.8 | 21.1 | 1327 |
| 3×50 ^b | 2 | 1.0 | 0.8 | 1.8 | 23.7 | 1751 |
| 3×70 ^b | 2 | 1.1 | 1.0 | 1.9 | 27.6 | 2474 |
| 3×95 ^b | 2 | 1.1 | 1.2 | 2.0 | 31.0 | 3364 |
| 3×120 ^b | 2 | 1.2 | 1.2 | 2.1 | 33.8 | 4205 |
| 4×1.5 ^a | 2 | 0.7 | 0.4 | 1.8 | 10.8 | 172 |
| 4×2.5 ^a | 2 | 0.7 | 0.4 | 1.8 | 11.8 | 223 |
| 4×4 ^a | 2 | 0.7 | 0.4 | 1.8 | 13.1 | 303 |
| 4×6 ^a | 2 | 0.7 | 0.6 | 1.8 | 14.5 | 402 |
| 4×10 ^a | 2 | 0.7 | 0.6 | 1.8 | 16.8 | 599 |
| 4×16 ^a | 2 | 0.7 | 0.6 | 1.8 | 19.3 | 873 |
| 4×25 ^a | 2 | 0.9 | 0.8 | 1.8 | 23.4 | 1328 |
| 4×35 ^a | 2 | 0.9 | 1.0 | 1.8 | 26.2 | 1767 |
| 4×50 ^a | 2 | 1.0 | 1.0 | 1.8 | 29.9 | 2339 |
| 4×70 ^a | 2 | 1.1 | 1.2 | 2.0 | 35.1 | 3326 |
| 4×95 ^a | 2 | 1.1 | 1.2 | 2.1 | 39.9 | 4505 |
| 4×120 ^a | 2 | 1.2 | 1.2 | 2.3 | 44.7 | 5669 |
| 4×25 ^b | 2 | 0.9 | 0.8 | 1.8 | 18.8 | 1293 |
| 4×35 ^b | 2 | 0.9 | 0.8 | 1.8 | 21.1 | 1727 |
| 4×50 ^b | 2 | 1.0 | 1.0 | 1.8 | 24.2 | 2296 |
| 4×70 ^b | 2 | 1.1 | 1.2 | 2.0 | 27.6 | 3258 |
| 4×95 ^b | 2 | 1.1 | 1.2 | 2.1 | 30.7 | 4409 |
| 4×120 ^b | 2 | 1.2 | 1.2 | 2.3 | 34.0 | 5549 |
| 5×1.5 ^a | 2 | 0.7 | 0.4 | 1.8 | 10.8 | 172 |
| 5×2.5 ^a | 2 | 0.7 | 0.4 | 1.8 | 11.8 | 223 |
| 5×4 ^a | 2 | 0.7 | 0.6 | 1.8 | 14.2 | 367 |
| 5×6 ^a | 2 | 0.7 | 0.6 | 1.8 | 15.8 | 492 |
| 5×10 ^b | 2 | 0.7 | 0.6 | 1.8 | 17.5 | 754 |
| 5×16 ^b | 2 | 0.7 | 0.8 | 1.8 | 21.6 | 1141 |
| 5×25 ^b | 2 | 0.9 | 1.0 | 1.8 | 24.6 | 1678 |
| 5×35 ^b | 2 | 0.9 | 1.0 | 1.8 | 28.2 | 2273 |
| 5×50 ^b | 2 | 1.0 | 1.2 | 1.9 | 31.9 | 3000 |
| 5×70 ^b | 2 | 1.1 | 1.2 | 2.1 | 35.7 | 4187 |
| 5×95 ^b | 2 | 1.1 | 1.4 | 2.2 | 41.0 | 5748 |
| 5×120 ^b | 2 | 1.2 | 1.4 | 2.4 | 44.2 | 7142 |

^a Circular or compacted circular stranded conductors (class 2).

^b Shaped stranded conductor (class 2).



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

ELECTRICAL PROPERTIES

Conductor operating temperature: 90°C

Ambient temperature: 30°C


Current-Carrying Capacities (Amp) according to BS 7671:2008 table 4E2A

| Conductor cross-sectional area | Ref. Method A (enclosed in conduit in thermally insulating wall etc.) | | Ref. Method B (enclosed in conduit on a wall or in trunking etc.) | | Ref. Method C (clipped direct) | | Ref. Method E (in free air or on a perforated cable tray tec. horizontal or vertical) | |
|--------------------------------|---|--|---|--|--|--|---|--|
| | 1 two-core cable*, single-phase a.c. or d.c. | 1 three- or four-core cable*, three-phase a.c. | 1 two-core cable*, single-phase a.c. or d.c. | 1 three- or four-core cable*, three-phase a.c. | 1 two-core cable*, single-phase a.c. or d.c. | 1 three- or four-core cable*, three-phase a.c. | 1 two-core cable*, single-phase a.c. or d.c. | 1 three- or four-core cable*, three-phase a.c. |
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 |
| mm ² | A | A | A | A | A | A | A | A |
| 1.5 | 18.5 | 16.5 | 22 | 19.5 | 24 | 22 | 26 | 23 |
| 2.5 | 25 | 22 | 30 | 26 | 33 | 30 | 36 | 32 |
| 4 | 33 | 30 | 40 | 35 | 45 | 40 | 49 | 42 |
| 6 | 42 | 38 | 51 | 44 | 58 | 52 | 63 | 54 |
| 10 | 57 | 51 | 69 | 60 | 80 | 71 | 86 | 75 |
| 16 | 76 | 68 | 91 | 80 | 107 | 96 | 115 | 100 |
| 25 | 99 | 89 | 119 | 105 | 138 | 119 | 149 | 127 |
| 35 | 121 | 109 | 146 | 128 | 171 | 147 | 185 | 158 |
| 50 | 145 | 130 | 175 | 154 | 209 | 179 | 225 | 192 |
| 70 | 183 | 164 | 221 | 194 | 269 | 229 | 289 | 246 |
| 95 | 220 | 197 | 265 | 233 | 328 | 278 | 352 | 298 |
| 120 | 253 | 227 | 305 | 268 | 382 | 322 | 410 | 346 |

Note: With or without a protective conductor.

Voltage Drop (Per Amp Per Meter) according to BS 7671:2008 table 4E2B


| Conductor cross-sectional area | Two-core cable, d.c. | Two-core cable, single-phase a.c. | | | Three- or four-core cable, three-phase a.c. | | |
|--------------------------------|----------------------|-----------------------------------|-------|------|---|-------|------|
| 1 | 2 | 3 | | | 4 | | |
| mm ² | mV/A/m | mV/A/m | | | mV/A/m | | |
| 1.5 | 31 | 31 | | | 27 | | |
| 2.5 | 19 | 19 | | | 16 | | |
| 4 | 12 | 12 | | | 10 | | |
| 6 | 7.9 | 7.9 | | | 6.8 | | |
| 10 | 4.7 | 4.7 | | | 4.0 | | |
| 16 | 2.9 | 2.9 | | | 2.5 | | |
| | | r | x | z | r | x | z |
| 25 | 1.85 | 1.85 | 0.160 | 1.90 | 1.60 | 0.140 | 1.65 |
| 35 | 1.35 | 1.35 | 0.155 | 1.35 | 1.15 | 0.135 | 1.15 |
| 50 | 0.98 | 0.99 | 0.155 | 1.00 | 0.86 | 0.135 | 0.87 |
| 70 | 0.67 | 0.67 | 0.150 | 0.69 | 0.59 | 0.130 | 0.60 |
| 95 | 0.49 | 0.50 | 0.150 | 0.52 | 0.43 | 0.130 | 0.45 |
| 120 | 0.39 | 0.40 | 0.145 | 0.42 | 0.34 | 0.130 | 0.37 |



Rated Voltage



Standard

Flame Retardancy
IEC 60332-1-2Reduced Fire Propagation
IEC 60332-3-24Halogen Free
IEC 60754-1Low Corrosivity
IEC 60754-2Low Smoke Emission
IEC 61034-2





Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

600/1000V XLPE Insulated, LSZH Sheathed Power Cables to IEC 60502-1 (2-5 Cores & Multicore)

FTX400 1RZ1-R (CU/XLPE/LSZH 600/1000V Class 2)

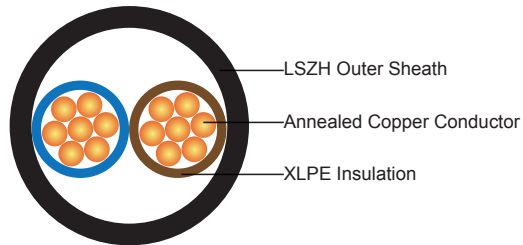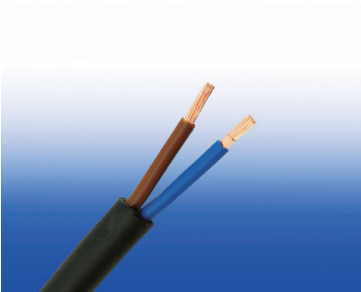

APPLICATION

The cables are mainly used in power stations, mass transit underground passenger systems, airports, petrochemical plants, hotels, hospitals and high-rise buildings.

STANDARDS

Basic design to IEC 60502-1

FIRE PERFORMANCE

| | |
|---|-------------------------------|
| Flame Retardance (Single vertical wire or cable test) | IEC 60332-1-2; EN 60332-1-2 |
| Reduced Fire Propagation (Vertically-mounted bundled wires & cables test) | IEC 60332-3-24; EN 60332-3-24 |
| Halogen Free | IEC 60754-1; EN 50267-2-1 |
| No Corrosive Gas Emission | IEC 60754-2; EN 50267-2-2 |
| Minimum Smoke Emission | IEC 61034-2; EN 61034-2 |

VOLTAGE RATING

600/1000V

CABLE CONSTRUCTION

Conductor: The conductors shall be class 2 plain or metal-coated annealed copper in accordance with IEC 60228. Class 1 and class 5 conductor can be offered as option.

Insulation: Thermosetting XLPE material and thickness shall be as per IEC 60502-1.

Outer Sheath: Thermoplastic halogen free compound ST₈ as per IEC 60502-1.

Outer Sheath Option: UV resistance, hydrocarbon resistance, oil resistance, anti-rodent and anti-termite properties can be offered as option.

COLOUR CODE

Insulation Colour

2-core: Brown and blue.

3-core: Brown, black and grey.

4-core: Blue, brown, black and grey.

5-core: Green and yellow, blue, brown, black, grey.

Above 5 Cores: Black cores with white numerals.

Other colours can be offered upon request.

Sheath Colour: Black; other colours can be offered upon request.

PHYSICAL AND THERMAL PROPERTIES

Maximum temperature range during operation: 90°C

Maximum short circuit temperature (5 Seconds): 250°C

Minimum bending radius

circular copper conductors OD≤25mm : 4 × Overall Diameter

circular copper conductors OD>25mm: 6 × Overall Diameter

shaped copper conductors: 8 × Overall Diameter

CONSTRUCTION PARAMETERS

| Conductor | | FTX400 1RZ1-R | | | |
|--|--------------------|------------------------------------|--------------------------------|--------------------------------|-------------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Nominal Sheath Thickness | Approx. Overall Diameter | Approx. Weight |
| No.×mm ² | | mm | mm | mm | kg/km |
| 2 Cores | | | | | |
| 2×1.5 | 2 | 0.7 | 1.8 | 9.6 | 117 |
| 2×2.5 | 2 | 0.7 | 1.8 | 10.4 | 146 |
| 2×4 | 2 | 0.7 | 1.8 | 11.5 | 190 |
| 2×6 | 2 | 0.7 | 1.8 | 12.6 | 244 |
| 2×10 | 2 | 0.7 | 1.8 | 14.5 | 349 |
| 2×16 | 2 | 0.7 | 1.8 | 16.6 | 495 |
| 2×25 | 2 | 0.9 | 1.8 | 20.0 | 735 |
| 2×35 | 2 | 0.9 | 1.8 | 22.3 | 963 |
| 2×50 | 2 | 1.0 | 1.8 | 25.4 | 1261 |
| 2×70 | 2 | 1.1 | 1.8 | 29.4 | 1751 |
| 2×95 | 2 | 1.1 | 1.9 | 33.4 | 2359 |
| 2×120 | 2 | 1.2 | 2.0 | 37.2 | 2950 |
| 2×150 | 2 | 1.4 | 2.2 | 41.5 | 3633 |
| 2×185 | 2 | 1.6 | 2.3 | 46.3 | 4523 |
| 2×240 | 2 | 1.7 | 2.5 | 52.3 | 5877 |
| 2×300 | 2 | 1.8 | 2.6 | 57.8 | 7285 |
| 2×400 | 2 | 2 | 2.9 | 65.1 | 9294 |
| 3 Cores | | | | | |
| 3×1.5 | 2 | 0.7 | 1.8 | 10.0 | 143 |
| 3×2.5 | 2 | 0.7 | 1.8 | 10.9 | 183 |
| 3×4 | 2 | 0.7 | 1.8 | 12.1 | 244 |
| 3×6 | 2 | 0.7 | 1.8 | 13.3 | 321 |
| 3×10 | 2 | 0.7 | 1.8 | 15.3 | 472 |
| 3×16 | 2 | 0.7 | 1.8 | 17.6 | 681 |



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

| Conductor | | FTX400 1RZ1-R | | | |
|-------------------------------------|-----------------|------------------------------|--------------------------|--------------------------|----------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Nominal Sheath Thickness | Approx. Overall Diameter | Approx. Weight |
| No. × mm ² | | mm | mm | mm | kg/km |
| 3×25 | 2 | 0.9 | 1.8 | 21.3 | 1027 |
| 3×35 | 2 | 0.9 | 1.8 | 23.8 | 1360 |
| 3×50 | 2 | 1.0 | 1.8 | 27.1 | 1795 |
| 3×70 | 2 | 1.1 | 1.9 | 31.6 | 2530 |
| 3×95 | 2 | 1.1 | 2.0 | 36.1 | 3441 |
| 3×120 | 2 | 1.2 | 2.1 | 40.2 | 4307 |
| 3×150 | 2 | 1.4 | 2.3 | 44.6 | 5276 |
| 3×185 | 2 | 1.6 | 2.4 | 49.9 | 6607 |
| 3×240 | 2 | 1.7 | 2.6 | 56.3 | 8593 |
| 3×300 | 2 | 1.8 | 2.7 | 62.2 | 10668 |
| 3×400 | 2 | 2.0 | 3.0 | 69.9 | 13570 |
| 3 Cores + 1 Core Earth Conductor | | | | | |
| | | 3 Cores | 1 Core | | |
| 3×16/10 | 2 | 0.7 | 0.7 | 1.8 | 792 |
| 3×25/16 | 2 | 0.9 | 0.7 | 1.8 | 1201 |
| 3×35/16 | 2 | 0.9 | 0.7 | 1.8 | 1533 |
| 3×50/25 | 2 | 1.0 | 0.9 | 1.8 | 2069 |
| 3×70/35 | 2 | 1.1 | 0.9 | 2.0 | 2906 |
| 3×95/50 | 2 | 1.1 | 1.0 | 2.1 | 3949 |
| 3×120/70 | 2 | 1.2 | 1.1 | 2.3 | 5036 |
| 3×150/70 | 2 | 1.4 | 1.1 | 2.4 | 6005 |
| 3×185/95 | 2 | 1.6 | 1.1 | 2.6 | 7608 |
| 3×240/120 | 2 | 1.7 | 1.2 | 2.8 | 9856 |
| 3×300/150 | 2 | 1.8 | 1.4 | 3.0 | 12224 |
| 3×400/185 | 2 | 2.0 | 1.6 | 3.2 | 15523 |
| 4 Cores | | | | | |
| 4×1.5 | 2 | 0.7 | 1.8 | 10.8 | 172 |
| 4×2.5 | 2 | 0.7 | 1.8 | 11.8 | 223 |
| 4×4 | 2 | 0.7 | 1.8 | 13.1 | 303 |
| 4×6 | 2 | 0.7 | 1.8 | 14.5 | 402 |
| 4×10 | 2 | 0.7 | 1.8 | 16.8 | 599 |
| 4×16 | 2 | 0.7 | 1.8 | 19.3 | 873 |
| 4×25 | 2 | 0.9 | 1.8 | 23.4 | 1328 |
| 4×35 | 2 | 0.9 | 1.8 | 26.2 | 1767 |
| 4×50 | 2 | 1.0 | 1.8 | 29.9 | 2339 |
| 4×70 | 2 | 1.1 | 2.0 | 35.1 | 3326 |
| 4×95 | 2 | 1.1 | 2.1 | 39.9 | 4505 |
| 4×120 | 2 | 1.2 | 2.3 | 44.7 | 5669 |
| 4×150 | 2 | 1.4 | 2.4 | 49.6 | 6948 |
| 4×185 | 2 | 1.6 | 2.6 | 55.5 | 8701 |
| 4×240 | 2 | 1.7 | 2.8 | 62.7 | 11322 |
| 4×300 | 2 | 1.8 | 3.0 | 69.4 | 14105 |
| 4×400 | 2 | 2.0 | 3.2 | 78.0 | 17943 |

| Conductor | | FTX400 1RZ1-R | | | |
|--|--------------------|------------------------------------|--------------------------------|--------------------------------|-------------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Nominal Sheath Thickness | Approx. Overall Diameter | Approx. Weight |
| No.×mm ² | | mm | mm | mm | kg/km |
| Multicore | | | | | |
| 5×1.5 | 2 | 0.7 | 1.8 | 10.8 | 172 |
| 5×2.5 | 2 | 0.7 | 1.8 | 11.8 | 223 |
| 7×1.5 | 2 | 0.7 | 1.8 | 13.1 | 303 |
| 7×2.5 | 2 | 0.7 | 1.8 | 14.5 | 402 |
| 10×1.5 | 2 | 0.7 | 1.8 | 16.8 | 599 |
| 10×2.5 | 2 | 0.7 | 1.8 | 19.3 | 873 |
| 12×1.5 | 2 | 0.7 | 1.8 | 23.4 | 1328 |
| 12×2.5 | 2 | 0.7 | 1.8 | 26.2 | 1767 |
| 14×1.5 | 2 | 0.7 | 1.8 | 29.9 | 2339 |
| 14×2.5 | 2 | 0.7 | 1.8 | 35.1 | 3326 |
| 19×1.5 | 2 | 0.7 | 1.8 | 39.9 | 4505 |
| 19×2.5 | 2 | 0.7 | 1.8 | 44.7 | 5669 |
| 21×1.5 | 2 | 0.7 | 1.8 | 19.4 | 628 |
| 21×2.5 | 2 | 0.7 | 1.8 | 21.7 | 873 |
| 24×1.5 | 2 | 0.7 | 1.8 | 21.5 | 713 |
| 24×2.5 | 2 | 0.7 | 1.8 | 24.1 | 994 |
| 30×1.5 | 2 | 0.7 | 1.8 | 22.8 | 856 |
| 30×2.5 | 2 | 0.7 | 1.8 | 25.5 | 1203 |
| 40×1.5 | 2 | 0.7 | 1.8 | 25.4 | 1100 |
| 40×2.5 | 2 | 0.7 | 1.9 | 28.7 | 1572 |
| 48×1.5 | 2 | 0.7 | 1.8 | 28.0 | 1300 |
| 48×2.5 | 2 | 0.7 | 1.9 | 31.6 | 1862 |
| 61×1.5 | 2 | 0.7 | 1.9 | 30.7 | 1624 |
| 61×2.5 | 2 | 0.7 | 2.0 | 34.7 | 2332 |



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

ELECTRICAL PROPERTIES

Conductor operating temperature: 90°C

Ambient temperature: 30°C


Current-Carrying Capacities (Amp) according to BS 7671:2008 table 4E2A

| Conductor cross-sectional area | Ref. Method A (enclosed in conduit in thermally insulating wall etc.) | | Ref. Method B (enclosed in conduit on a wall or in trunking etc.) | | Ref. Method C (clipped direct) | | Ref. Method E (in free air or on a perforated cable tray etc. horizontal or vertical) | |
|--------------------------------|---|--|---|--|--|--|---|--|
| | 1 two-core cable*, single-phase a.c. or d.c. | 1 three- or four-core cable*, three-phase a.c. | 1 two-core cable*, single-phase a.c. or d.c. | 1 three- or four-core cable*, three-phase a.c. | 1 two-core cable*, single-phase a.c. or d.c. | 1 three- or four-core cable*, three-phase a.c. | 1 two-core cable*, single-phase a.c. or d.c. | 1 three- or four-core cable*, three-phase a.c. |
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 |
| mm ² | A | A | A | A | A | A | A | A |
| 1.5 | 18.5 | 16.5 | 22 | 19.5 | 24 | 22 | 26 | 23 |
| 2.5 | 25 | 22 | 30 | 26 | 33 | 30 | 36 | 32 |
| 4 | 33 | 30 | 40 | 35 | 45 | 40 | 49 | 42 |
| 6 | 42 | 38 | 51 | 44 | 58 | 52 | 63 | 54 |
| 10 | 57 | 51 | 69 | 60 | 80 | 71 | 86 | 75 |
| 16 | 76 | 68 | 91 | 80 | 107 | 96 | 115 | 100 |
| 25 | 99 | 89 | 119 | 105 | 138 | 119 | 149 | 127 |
| 35 | 121 | 109 | 146 | 128 | 171 | 147 | 185 | 158 |
| 50 | 145 | 130 | 175 | 154 | 209 | 179 | 225 | 192 |
| 70 | 183 | 164 | 221 | 194 | 269 | 229 | 289 | 246 |
| 95 | 220 | 197 | 265 | 233 | 328 | 278 | 352 | 298 |
| 120 | 253 | 227 | 305 | 268 | 382 | 322 | 410 | 346 |
| 150 | 290 | 259 | 334 | 300 | 441 | 371 | 473 | 399 |
| 185 | 329 | 295 | 384 | 340 | 506 | 424 | 542 | 456 |
| 240 | 386 | 346 | 459 | 398 | 599 | 500 | 641 | 538 |
| 300 | 442 | 396 | 532 | 455 | 693 | 576 | 741 | 621 |
| 400 | - | - | 625 | 536 | 803 | 667 | 865 | 741 |

Note: With or without a protective conductor.

Voltage Drop (Per Amp Per Meter) according to BS 7671:2008 table 4E2B


| Conductor cross-sectional area | Two-core cable, d.c. | Two-core cable, single-phase a.c. | | | Three- or four-core cable, three-phase a.c. | | |
|--------------------------------|----------------------|-----------------------------------|-------|-------|---|-------|-------|
| 1 | 2 | 3 | | | 4 | | |
| mm ² | mV/A/m | mV/A/m | | | mV/A/m | | |
| 1.5 | 31 | 31 | | | 27 | | |
| 2.5 | 19 | 19 | | | 16 | | |
| 4 | 12 | 12 | | | 10 | | |
| 6 | 7.9 | 7.9 | | | 6.8 | | |
| 10 | 4.7 | 4.7 | | | 4.0 | | |
| 16 | 2.9 | 2.9 | | | 2.5 | | |
| | | r | x | z | r | x | z |
| 25 | 1.85 | 1.85 | 0.160 | 1.90 | 1.60 | 0.140 | 1.65 |
| 35 | 1.35 | 1.35 | 0.155 | 1.35 | 1.15 | 0.135 | 1.15 |
| 50 | 0.98 | 0.99 | 0.155 | 1.00 | 0.86 | 0.135 | 0.87 |
| 70 | 0.67 | 0.67 | 0.150 | 0.69 | 0.59 | 0.130 | 0.60 |
| 95 | 0.49 | 0.50 | 0.150 | 0.52 | 0.43 | 0.130 | 0.45 |
| 120 | 0.39 | 0.40 | 0.145 | 0.42 | 0.34 | 0.130 | 0.37 |
| 150 | 0.31 | 0.32 | 0.145 | 0.35 | 0.38 | 0.125 | 0.30 |
| 185 | 0.25 | 0.26 | 0.145 | 0.29 | 0.22 | 0.125 | 0.26 |
| 240 | 0.195 | 0.200 | 0.140 | 0.24 | 0.175 | 0.125 | 0.21 |
| 300 | 0.155 | 0.160 | 0.140 | 0.21 | 0.140 | 0.120 | 0.185 |
| 400 | 0.120 | 0.130 | 0.140 | 0.190 | 0.115 | 0.120 | 0.165 |



Rated Voltage



Standard

Flame Retardancy
IEC 60332-1-2Reduced Fire Propagation
IEC 60332-3-24Halogen Free
IEC 60754-1Low Corrosivity
IEC 60754-2Low Smoke Emission
IEC 61034-2




Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

600/1000V XLPE Insulated, LSZH Sheathed, Armoured Power Cables to BS 6724 (2-5 Cores)

FTX400 1RZ1MZ1-R (CU/XLPE/LSZH/SWA/LSZH 600/1000V Class 2)

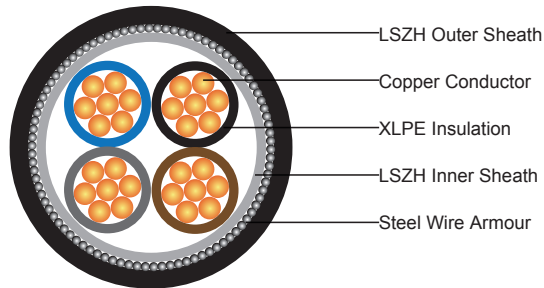

APPLICATION

The cables are mainly used in power stations, mass transit underground passenger systems, airports, petrochemical plants, hotels, hospitals and high-rise buildings.

STANDARDS

Basic design to BS 6724

FIRE PERFORMANCE

| | |
|---|-------------------------------|
| Flame Retardance (Single vertical wire or cable test) | IEC 60332-1-2; EN 60332-1-2 |
| Reduced Fire Propagation (Vertically-mounted bundled wires & cables test) | IEC 60332-3-24; EN 60332-3-24 |
| Halogen Free | IEC 60754-1; EN 50267-2-1 |
| No Corrosive Gas Emission | IEC 60754-2; EN 50267-2-2 |
| Minimum Smoke Emission | IEC 61034-2; EN 61034-2 |

VOLTAGE RATING

600/1000V

CABLE CONSTRUCTION

Conductor: Annealed copper wire, stranded according to BS EN 60228 class 2.

Insulation: XLPE type GP8 according to BS 7655-1.3. HEPR type GP6 according to BS 7655-1.2 or crosslinked polyolefin material type EI 5 according to BS EN 50363-5 can be offered as option.

Bedding: Extruded layer of polymeric material.

Armouring: Galvanized steel wire.

Outer Sheath: Extruded layer of polymeric material LTS 1 according to BS 7655-6.1.

Outer Sheath Option: UV resistance, hydrocarbon resistance, oil resistance, anti-rodent and anti-termite properties can be offered as option.

COLOUR CODE**Insulation Colour**

2-core: Brown and blue.

3-core: Brown, black and grey.

4-core: Blue, brown, black and grey.

5-core: Green and yellow, blue, brown, black, grey.

Sheath Colour: Black; other colours can be offered upon request.

PHYSICAL AND THERMAL PROPERTIES

Maximum temperature range during operation: 90°C

Maximum short circuit temperature (5 Seconds): 250°C

Minimum bending radius

circular copper conductors: 6 × Overall Diameter

shaped copper conductors: 8 × Overall Diameter

CONSTRUCTION PARAMETERS

| Conductor | | FTX400 1RZ1MZ1-R | | | | | |
|-------------------------------------|-----------------|------------------------------|---------------------------|------------------------------------|--------------------------|--------------------------|----------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Nominal Bedding Thickness | Nominal Steel Wire Armour Diameter | Nominal Sheath Thickness | Approx. Overall Diameter | Approx. Weight |
| No. × mm ² | | mm | mm | mm | mm | mm | kg/km |
| 2 Cores | | | | | | | |
| 2×1.5 ^a | 2 | 0.6 | 0.8 | 0.9 | 1.3 | 12.1 | 294 |
| 2×2.5 ^a | 2 | 0.7 | 0.8 | 0.9 | 1.4 | 13.6 | 354 |
| 2×4 ^a | 2 | 0.7 | 0.8 | 0.9 | 1.4 | 14.7 | 420 |
| 2×6 ^a | 2 | 0.7 | 0.8 | 0.9 | 1.4 | 15.9 | 497 |
| 2×10 ^a | 2 | 0.7 | 0.8 | 0.9 | 1.5 | 18.0 | 650 |
| 2×16 ^a | 2 | 0.7 | 0.8 | 1.25 | 1.5 | 20.4 | 964 |
| 2×25 ^a | 2 | 0.9 | 0.8 | 1.25 | 1.6 | 24.1 | 1314 |
| 2×25 ^b | 2 | 0.9 | 0.8 | 1.25 | 1.6 | 20.4 | 1254 |
| 2×35 ^a | 2 | 0.9 | 1.0 | 1.6 | 1.7 | 27.7 | 1832 |
| 2×35 ^b | 2 | 0.9 | 1.0 | 1.6 | 1.7 | 23.3 | 1736 |
| 2×50 ^b | 2 | 1.0 | 1.0 | 1.6 | 1.8 | 25.8 | 2261 |
| 2×70 ^b | 2 | 1.1 | 1.0 | 1.6 | 1.9 | 29.0 | 2922 |
| 2×95 ^b | 2 | 1.1 | 1.2 | 2.0 | 2.0 | 33.1 | 4029 |
| 2×120 ^b | 2 | 1.2 | 1.2 | 2.0 | 2.1 | 36.1 | 4796 |
| 2×150 ^b | 2 | 1.4 | 1.2 | 2.0 | 2.2 | 39.3 | 5646 |
| 2×185 ^b | 2 | 1.6 | 1.4 | 2.5 | 2.4 | 44.7 | 7365 |
| 2×240 ^b | 2 | 1.7 | 1.4 | 2.5 | 2.5 | 49.0 | 9027 |
| 2×300 ^b | 2 | 1.8 | 1.6 | 2.5 | 2.6 | 53.5 | 10832 |
| 2×400 ^b | 2 | 2.0 | 1.6 | 2.5 | 2.8 | 59.0 | 13216 |
| 3 Cores | | | | | | | |
| 3×1.5 ^a | 2 | 0.6 | 0.8 | 0.9 | 1.3 | 12.6 | 320 |
| 3×2.5 ^a | 2 | 0.7 | 0.8 | 0.9 | 1.4 | 14.1 | 401 |
| 3×4 ^a | 2 | 0.7 | 0.8 | 0.9 | 1.4 | 15.3 | 487 |
| 3×6 ^a | 2 | 0.7 | 0.8 | 0.9 | 1.4 | 16.6 | 588 |



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

| Conductor | | FTX400 1RZ1MZ1-R | | | | | |
|-------------------------------------|-----------------|------------------------------|---------------------------|------------------------------------|--------------------------|--------------------------|----------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Nominal Bedding Thickness | Nominal Steel Wire Armour Diameter | Nominal Sheath Thickness | Approx. Overall Diameter | Approx. Weight |
| No. × mm ² | | mm | mm | mm | mm | mm | kg/km |
| 3×10 ^a | 2 | 0.7 | 0.8 | 1.25 | 1.5 | 19.5 | 906 |
| 3×16 ^a | 2 | 0.7 | 0.8 | 1.25 | 1.6 | 21.6 | 1190 |
| 3×25 ^a | 2 | 0.9 | 1.0 | 1.6 | 1.7 | 26.7 | 1858 |
| 3×25 ^b | 2 | 0.9 | 1.0 | 1.6 | 1.7 | 23.6 | 1755 |
| 3×35 ^a | 2 | 0.9 | 1.0 | 1.6 | 1.8 | 29.4 | 2298 |
| 3×35 ^b | 2 | 0.9 | 1.0 | 1.6 | 1.8 | 25.7 | 2154 |
| 3×50 ^b | 2 | 1.0 | 1.0 | 1.6 | 1.8 | 28.5 | 2858 |
| 3×70 ^b | 2 | 1.1 | 1.0 | 1.6 | 1.9 | 32.2 | 3761 |
| 3×95 ^b | 2 | 1.1 | 1.2 | 2.0 | 2.1 | 37.0 | 5204 |
| 3×120 ^b | 2 | 1.2 | 1.2 | 2.0 | 2.2 | 40.4 | 6258 |
| 3×150 ^b | 2 | 1.4 | 1.4 | 2.5 | 2.3 | 45.5 | 7989 |
| 3×185 ^b | 2 | 1.6 | 1.4 | 2.5 | 2.4 | 49.8 | 9586 |
| 3×240 ^b | 2 | 1.7 | 1.4 | 2.5 | 2.6 | 55.1 | 11930 |
| 3×300 ^b | 2 | 1.8 | 1.6 | 2.5 | 2.7 | 60.2 | 14427 |
| 3×400 ^b | 2 | 2.0 | 1.6 | 2.5 | 2.9 | 66.6 | 17765 |
| 4 Cores | | | | | | | |
| 4×1.5 ^a | 2 | 0.6 | 0.8 | 0.9 | 1.3 | 13.3 | 388 |
| 4×2.5 ^a | 2 | 0.7 | 0.8 | 0.9 | 1.4 | 15.0 | 460 |
| 4×4 ^a | 2 | 0.7 | 0.8 | 0.9 | 1.4 | 16.4 | 566 |
| 4×6 ^a | 2 | 0.7 | 0.8 | 1.25 | 1.5 | 18.7 | 813 |
| 4×10 ^a | 2 | 0.7 | 0.8 | 1.25 | 1.5 | 21.1 | 1073 |
| 4×16 ^a | 2 | 0.7 | 0.8 | 1.25 | 1.6 | 23.4 | 1431 |
| 4×25 ^a | 2 | 0.9 | 1.0 | 1.6 | 1.7 | 28.9 | 2239 |
| 4×25 ^b | 2 | 0.9 | 1.0 | 1.6 | 1.7 | 26.1 | 2102 |
| 4×35 ^a | 2 | 0.9 | 1.0 | 1.6 | 1.8 | 31.9 | 2797 |
| 4×35 ^b | 2 | 0.9 | 1.0 | 1.6 | 1.8 | 28.6 | 2606 |
| 4×50 ^b | 2 | 1.0 | 1.0 | 1.6 | 1.9 | 32.0 | 3530 |
| 4×70 ^b | 2 | 1.1 | 1.2 | 2.0 | 2.1 | 37.7 | 5074 |
| 4×95 ^b | 2 | 1.1 | 1.2 | 2.0 | 2.2 | 41.7 | 6474 |
| 4×120 ^b | 2 | 1.2 | 1.4 | 2.5 | 2.3 | 47.1 | 8390 |
| 4×150 ^b | 2 | 1.4 | 1.4 | 2.5 | 2.4 | 51.4 | 9947 |
| 4×185 ^b | 2 | 1.6 | 1.4 | 2.5 | 2.6 | 56.6 | 12096 |
| 4×240 ^b | 2 | 1.7 | 1.6 | 2.5 | 2.7 | 63.0 | 15109 |
| 4×300 ^b | 2 | 1.8 | 1.6 | 2.5 | 2.9 | 68.8 | 18276 |
| 4×400 ^b | 2 | 2.0 | 1.8 | 3.15 | 3.2 | 78.1 | 23849 |
| 5 Cores | | | | | | | |
| 5×1.5 ^a | 2 | 0.6 | 0.8 | 0.9 | 1.4 | 14.3 | 413 |
| 5×2.5 ^a | 2 | 0.7 | 0.8 | 0.9 | 1.4 | 16.1 | 521 |
| 5×4 ^a | 2 | 0.7 | 0.8 | 0.9 | 1.5 | 17.8 | 658 |
| 5×6 ^a | 2 | 0.7 | 0.8 | 1.25 | 1.5 | 20 | 932 |
| 5×10 ^a | 2 | 0.7 | 0.8 | 1.25 | 1.6 | 22.9 | 1258 |
| 5×16 ^a | 2 | 0.7 | 1.0 | 1.6 | 1.7 | 26.6 | 1893 |
| 5×25 ^a | 2 | 0.9 | 1.0 | 1.6 | 1.8 | 31.5 | 2646 |
| 5×35 ^a | 2 | 0.9 | 1.0 | 1.6 | 1.9 | 34.8 | 3326 |

| Conductor | | FTX400 1RZ1MZ1-R | | | | | |
|-------------------------------------|-----------------|------------------------------|---------------------------|------------------------------------|--------------------------|--------------------------|----------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Nominal Bedding Thickness | Nominal Steel Wire Armour Diameter | Nominal Sheath Thickness | Approx. Overall Diameter | Approx. Weight |
| No. × mm ² | | mm | mm | mm | mm | mm | kg/km |
| 5×50 ^a | 2 | 1.0 | 1.2 | 2 | 2 | 40.4 | 4567 |
| 5×70 ^a | 2 | 1.1 | 1.2 | 2 | 2.2 | 46.3 | 6056 |

^a Circular or compacted circular stranded conductors (class 2).

^b Shaped stranded conductor (class 2).

ELECTRICAL PROPERTIES

Conductor operating temperature: 90°C

Air ambient temperature: 30°C

Ground ambient temperature: 20°C

Current-Carrying Capacities (Amp) according to BS 7671:2008 table 4E4A

| Conductor cross-sectional area | Ref. Method C (clipped direct) | | Ref. Method E (in free air or on a perforated cable tray etc. horizontal or vertical) | | Ref. Method D (direct in in groud or in ducting in groud. in or around buildings) | |
|--------------------------------|---|---|---|---|---|---|
| | 1 two-core cable, single-phase a.c. or d.c. | 1 three- or four-core cable, three-phase a.c. | 1 two-core cable, single-phase a.c. or d.c. | 1 three- or four-core cable, three-phase a.c. | 1 two-core cable, single-phase a.c. or d.c. | 1 three- or four-core cable, three-phase a.c. |
| 1 | 2 | 3 | 4 | 5 | 6 | 7 |
| mm ² | A | A | A | A | A | A |
| 1.5 | 27 | 23 | 29 | 25 | 25 | 21 |
| 2.5 | 36 | 31 | 39 | 33 | 33 | 28 |
| 4 | 49 | 42 | 52 | 44 | 43 | 36 |
| 6 | 62 | 53 | 66 | 56 | 53 | 44 |
| 10 | 85 | 73 | 90 | 78 | 71 | 58 |
| 16 | 110 | 94 | 115 | 99 | 91 | 75 |
| 25 | 146 | 124 | 152 | 131 | 116 | 96 |
| 35 | 180 | 154 | 188 | 162 | 139 | 115 |
| 50 | 219 | 187 | 228 | 197 | 164 | 135 |
| 70 | 279 | 238 | 291 | 251 | 203 | 167 |
| 95 | 338 | 289 | 354 | 304 | 239 | 197 |
| 120 | 392 | 335 | 410 | 353 | 271 | 223 |
| 150 | 451 | 386 | 472 | 406 | 306 | 251 |
| 185 | 515 | 441 | 539 | 463 | 343 | 281 |
| 240 | 607 | 520 | 636 | 546 | 395 | 324 |
| 300 | 698 | 599 | 732 | 628 | 446 | 365 |
| 400 | 787 | 673 | 847 | 728 | - | - |



Caledonian


FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

Voltage Drop (Per Amp Per Meter) according to BS 7671:2008 table 4E4B

| Conductor cross-sectional area | Two-core cable, d.c. | Two-core cable, single-phase a.c. | | | Three- or four-core cable, three-phase a.c. | | |
|--------------------------------|----------------------|-----------------------------------|-------|-------|---|-------|-------|
| 1 | 2 | 3 | | | 4 | | |
| mm ² | mV/A/m | mV/A/m | | | mV/A/m | | |
| 1.5 | 31 | 31 | | | 27 | | |
| 2.5 | 19 | 19 | | | 16 | | |
| 4 | 12 | 12 | | | 10 | | |
| 6 | 7.9 | 7.9 | | | 6.8 | | |
| 10 | 4.7 | 4.7 | | | 4.0 | | |
| 16 | 2.9 | 2.9 | | | 2.5 | | |
| | | r | x | z | r | x | z |
| 25 | 1.85 | 1.85 | 0.160 | 1.90 | 1.60 | 0.140 | 1.65 |
| 35 | 1.35 | 1.35 | 0.155 | 1.35 | 1.15 | 0.135 | 1.15 |
| 50 | 0.98 | 0.99 | 0.155 | 1.00 | 0.86 | 0.135 | 0.87 |
| 70 | 0.67 | 0.67 | 0.150 | 0.69 | 0.59 | 0.130 | 0.60 |
| 95 | 0.49 | 0.50 | 0.150 | 0.52 | 0.43 | 0.130 | 0.45 |
| 120 | 0.39 | 0.40 | 0.145 | 0.42 | 0.34 | 0.130 | 0.37 |
| 150 | 0.31 | 0.32 | 0.145 | 0.35 | 0.38 | 0.125 | 0.30 |
| 185 | 0.25 | 0.26 | 0.145 | 0.29 | 0.22 | 0.125 | 0.26 |
| 240 | 0.195 | 0.200 | 0.140 | 0.24 | 0.175 | 0.125 | 0.21 |
| 300 | 0.155 | 0.160 | 0.140 | 0.21 | 0.140 | 0.120 | 0.185 |
| 400 | 0.120 | 0.130 | 0.140 | 0.190 | 0.115 | 0.120 | 0.165 |

Note: r = conductor resistance at operating temperature
 x = reactance
 z = impedance



Rated Voltage




Standard



Flame Retardancy
IEC 60332-1-2



Reduced Fire Propagation
IEC 60332-3-24



Halogen Free
IEC 60754-1




Low Corrosivity
IEC 60754-2



Low Smoke Emission
IEC 61034-2

600/1000V XLPE Insulated, LSZH Sheathed, Armoured Power Cables to IEC 60502-1 (2-4 Cores)

FTX400 1RZ1MZ1-R (CU/XLPE/LSZH/SWA/LSZH 600/1000V Class 2)

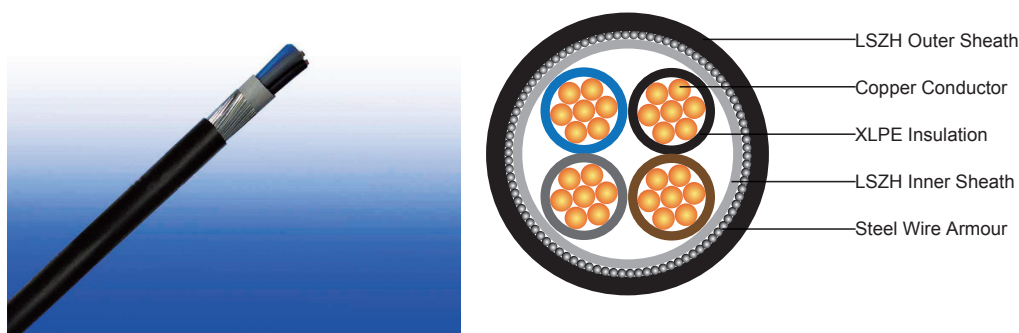

APPLICATION

The cables are mainly used in power stations, mass transit underground passenger systems, airports, petrochemical plants, hotels, hospitals and high-rise buildings.

STANDARDS

Basic design to IEC 60502-1

FIRE PERFORMANCE

| | |
|---|-------------------------------|
| Flame Retardance (Single vertical wire or cable test) | IEC 60332-1-2; EN 60332-1-2 |
| Reduced Fire Propagation (Vertically-mounted bundled wires & cables test) | IEC 60332-3-24; EN 60332-3-24 |
| Halogen Free | IEC 60754-1; EN 50267-2-1 |
| No Corrosive Gas Emission | IEC 60754-2; EN 50267-2-2 |
| Minimum Smoke Emission | IEC 61034-2; EN 61034-2 |

VOLTAGE RATING

600/1000V

CABLE CONSTRUCTION

Conductor: The conductors shall be class 2 plain or metal-coated annealed copper in accordance with IEC 60228. Class 1 and class 5 conductor can be offered as option.

Insulation: Thermosetting XLPE material as per IEC 60502-1.

Inner Covering: Thermoplastic halogen free compound ST₈ as per IEC 60502-1.

Armouring: Steel wire armour.

Outer Sheath: Thermoplastic halogen free compound ST₈ as per IEC 60502-1.

Outer Sheath Option: UV resistance, hydrocarbon resistance, oil resistance, anti-rodent and anti-termite properties can be offered as option.



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

COLOUR CODE

Insulation Colour

2-core: Brown and blue.

3-core: Brown, black and grey.

4-core: Blue, brown, black and grey.

Other colours can be offered upon request.

Sheath Colour: Black; other colours can be offered upon request.

PHYSICAL AND THERMAL PROPERTIES

Maximum temperature range during operation: 90°C

Maximum short circuit temperature (5 Seconds): 250°C

Minimum bending radius

circular copper conductors: 6 × Overall Diameter

shaped copper conductors: 8 × Overall Diameter

CONSTRUCTION PARAMETERS

| Conductor | | FTX400 1RZ1MZ1-R | | | | | |
|-------------------------------------|-----------------|------------------------------|----------------------------------|------------------------------|--------------------------|--------------------------|----------------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Nominal Inner Covering Thickness | Nominal Armour Wire Diameter | Nominal Sheath Thickness | Approx. Overall Diameter | Approx. Weight |
| mm ² | | mm | mm | mm | mm | mm | kg/km |
| 2 Cores | | | | | | | |
| 2×1.5 | 2 | 0.7 | 1.0 | 0.8 | 1.8 | 13.2 | 325 |
| 2×2.5 | 2 | 0.7 | 1.0 | 0.8 | 1.8 | 14.0 | 372 |
| 2×4 | 2 | 0.7 | 1.0 | 0.8 | 1.8 | 15.1 | 438 |
| 2×6 | 2 | 0.7 | 1.0 | 1.25 | 1.8 | 17.1 | 645 |
| 2×10 | 2 | 0.7 | 1.0 | 1.25 | 1.8 | 19.0 | 806 |
| 2×16 | 2 | 0.7 | 1.0 | 1.25 | 1.8 | 21.1 | 1015 |
| 2×25 | 2 | 0.9 | 1.0 | 1.6 | 1.8 | 25.2 | 1517 |
| 2×35 | 2 | 0.9 | 1.0 | 1.6 | 1.8 | 27.5 | 1830 |
| 2×50 | 2 | 1.0 | 1.0 | 1.6 | 1.9 | 30.8 | 2259 |
| 2×70 | 2 | 1.1 | 1.0 | 2.0 | 2.0 | 35.8 | 3182 |
| 2×95 | 2 | 1.1 | 1.2 | 2.0 | 2.1 | 40.2 | 4022 |
| 2×120 | 2 | 1.2 | 1.2 | 2.0 | 2.3 | 44.2 | 4810 |
| 2×150 | 2 | 1.4 | 1.2 | 2.5 | 2.4 | 49.3 | 6120 |
| 2×185 | 2 | 1.6 | 1.4 | 2.5 | 2.6 | 54.7 | 7375 |
| 2×240 | 2 | 1.7 | 1.4 | 2.5 | 2.7 | 60.5 | 9037 |
| 2×300 | 2 | 1.8 | 1.6 | 2.5 | 2.9 | 66.6 | 10871 |
| 2×400 | 2 | 2.0 | 1.6 | 2.5 | 3.1 | 73.7 | 13256 |
| 3 Cores | | | | | | | |
| 3×1.5 | 2 | 0.7 | 1.0 | 0.8 | 1.8 | 13.6 | 368 |
| 3×2.5 | 2 | 0.7 | 1.0 | 0.8 | 1.8 | 14.5 | 427 |
| 3×4 | 2 | 0.7 | 1.0 | 0.8 | 1.8 | 15.7 | 514 |
| 3×6 | 2 | 0.7 | 1.0 | 1.25 | 1.8 | 17.8 | 752 |
| 3×10 | 2 | 0.7 | 1.0 | 1.25 | 1.8 | 19.8 | 965 |
| 3×16 | 2 | 0.7 | 1.0 | 1.25 | 1.8 | 22.1 | 1244 |

| Conductor | | FTX400 1RZ1MZ1-R | | | | | | |
|-------------------------------------|-----------------|------------------------------|----------------------------------|------------------------------|--------------------------|--------------------------|----------------|-------|
| No. of Cores × Cross-sectional Area | Conductor Class | Nominal Insulation Thickness | Nominal Inner Covering Thickness | Nominal Armour Wire Diameter | Nominal Sheath Thickness | Approx. Overall Diameter | Approx. Weight | |
| mm ² | | mm | mm | mm | mm | mm | kg/km | |
| 3×25 | 2 | 0.9 | 1.0 | 1.6 | 1.8 | 26.5 | 1872 | |
| 3×35 | 2 | 0.9 | 1.0 | 1.6 | 1.8 | 29.0 | 2298 | |
| 3×50 | 2 | 1.0 | 1.0 | 1.6 | 1.9 | 32.5 | 2876 | |
| 3×70 | 2 | 1.1 | 1.0 | 2.0 | 2.1 | 38.0 | 4081 | |
| 3×95 | 2 | 1.1 | 1.2 | 2.0 | 2.2 | 42.7 | 5227 | |
| 3×120 | 2 | 1.2 | 1.2 | 2.0 | 2.3 | 46.8 | 6283 | |
| 3×150 | 2 | 1.4 | 1.4 | 2.5 | 2.5 | 52.8 | 8045 | |
| 3×185 | 2 | 1.6 | 1.4 | 2.5 | 2.7 | 58.1 | 9678 | |
| 3×240 | 2 | 1.7 | 1.4 | 2.5 | 2.8 | 64.3 | 11998 | |
| 3×300 | 2 | 1.8 | 1.6 | 2.5 | 3.0 | 70.8 | 14540 | |
| 3×400 | 2 | 2 | 1.6 | 3.15 | 3.3 | 80.0 | 18919 | |
| 3 Cores + 1 Core Earth Conductor | | | | | | | | |
| | | 3 Cores | 1 Core | | | | | |
| 3×16/10 | 2 | 0.7 | 0.7 | 1.0 | 1.6 | 1.8 | 22.7 | 1363 |
| 3×25/16 | 2 | 0.9 | 0.7 | 1.0 | 1.6 | 1.8 | 26.5 | 2054 |
| 3×35/16 | 2 | 0.9 | 0.7 | 1.0 | 1.6 | 1.9 | 29 | 2480 |
| 3×50/25 | 2 | 1.0 | 0.9 | 1.0 | 1.6 | 2.1 | 33 | 3167 |
| 3×70/35 | 2 | 1.1 | 0.9 | 1.2 | 2 | 2.2 | 38 | 4476 |
| 3×95/50 | 2 | 1.1 | 1.0 | 1.2 | 2 | 2.3 | 42.4 | 5757 |
| 3×120/70 | 2 | 1.2 | 1.1 | 1.2 | 2 | 2.5 | 48.0 | 7047 |
| 3×150/70 | 2 | 1.4 | 1.1 | 1.4 | 2.5 | 2.7 | 52 | 8812 |
| 3×185/95 | 2 | 1.6 | 1.1 | 1.4 | 2.5 | 2.8 | 57.2 | 10723 |
| 3×240/120 | 2 | 1.7 | 1.2 | 1.6 | 2.5 | 3.1 | 64 | 13326 |
| 3×300/150 | 2 | 1.8 | 1.4 | 1.6 | 2.5 | 3.2 | 69.8 | 16169 |
| 3×400/185 | 2 | 2.0 | 1.6 | 1.6 | 3.15 | 3.6 | 78.6 | 20955 |
| 4 Cores | | | | | | | | |
| 4×1.5 | 2 | 0.7 | 1.0 | 0.8 | 1.8 | 14.4 | 414 | |
| 4×2.5 | 2 | 0.7 | 1.0 | 0.8 | 1.8 | 15.4 | 487 | |
| 4×4 | 2 | 0.7 | 1.0 | 1.25 | 1.8 | 17.6 | 728 | |
| 4×6 | 2 | 0.7 | 1.0 | 1.25 | 1.8 | 19.0 | 870 | |
| 4×10 | 2 | 0.7 | 1.0 | 1.25 | 1.8 | 21.3 | 1136 | |
| 4×16 | 2 | 0.7 | 1.0 | 1.6 | 1.8 | 24.5 | 1642 | |
| 4×25 | 2 | 0.9 | 1.0 | 1.6 | 1.8 | 28.6 | 2254 | |
| 4×35 | 2 | 0.9 | 1.0 | 1.6 | 1.9 | 31.6 | 2814 | |
| 4×50 | 2 | 1.0 | 1.0 | 2.0 | 2.1 | 36.5 | 3837 | |
| 4×70 | 2 | 1.1 | 1.2 | 2.0 | 2.2 | 41.9 | 5096 | |
| 4×95 | 2 | 1.1 | 1.2 | 2.0 | 2.3 | 46.7 | 6499 | |
| 4×120 | 2 | 1.2 | 1.4 | 2.5 | 2.5 | 52.9 | 8446 | |
| 4×150 | 2 | 1.4 | 1.4 | 2.5 | 2.7 | 58.0 | 10039 | |
| 4×185 | 2 | 1.6 | 1.4 | 2.5 | 2.8 | 63.7 | 12099 | |
| 4×240 | 2 | 1.7 | 1.6 | 2.5 | 3.1 | 71.5 | 15261 | |
| 4×300 | 2 | 1.8 | 1.6 | 2.5 | 3.2 | 78.0 | 18400 | |
| 4×400 | 2 | 2.0 | 1.8 | 3.15 | 3.6 | 88.7 | 24037 | |



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

ELECTRICAL PROPERTIES

Conductor operating temperature: 90°C

Air ambient temperature: 30°C

Ground ambient temperature: 20°C

Current-Carrying Capacities (Amp) according to BS 7671:2008 table 4E4A

| Conductor cross-sectional area | Ref. Method C (clipped direct) | | Ref. Method E (in free air or on a perforated cable tray etc. horizontal or vertical) | | Ref. Method D (direct in in ground or in ducting in ground. in or around buildings) | |
|--------------------------------|---|---|---|---|---|---|
| | 1 two-core cable, single-phase a.c. or d.c. | 1 three- or four-core cable, three-phase a.c. | 1 two-core cable, single-phase a.c. or d.c. | 1 three- or four-core cable, three-phase a.c. | 1 two-core cable, single-phase a.c. or d.c. | 1 three- or four-core cable, three-phase a.c. |
| 1 mm ² | 2 A | 3 A | 4 A | 5 A | 6 A | 7 A |
| 1.5 | 27 | 23 | 29 | 25 | 25 | 21 |
| 2.5 | 36 | 31 | 39 | 33 | 33 | 28 |
| 4 | 49 | 42 | 52 | 44 | 43 | 36 |
| 6 | 62 | 53 | 66 | 56 | 53 | 44 |
| 10 | 85 | 73 | 90 | 78 | 71 | 58 |
| 16 | 110 | 94 | 115 | 99 | 91 | 75 |
| 25 | 146 | 124 | 152 | 131 | 116 | 96 |
| 35 | 180 | 154 | 188 | 162 | 139 | 115 |
| 50 | 219 | 187 | 228 | 197 | 164 | 135 |
| 70 | 279 | 238 | 291 | 251 | 203 | 167 |
| 95 | 338 | 289 | 354 | 304 | 239 | 197 |
| 120 | 392 | 335 | 410 | 353 | 271 | 223 |
| 150 | 451 | 386 | 472 | 406 | 306 | 251 |
| 185 | 515 | 441 | 539 | 463 | 343 | 281 |
| 240 | 607 | 520 | 636 | 546 | 395 | 324 |
| 300 | 698 | 599 | 732 | 628 | 446 | 365 |
| 400 | 787 | 673 | 847 | 728 | - | - |


Voltage Drop (Per Amp Per Meter) according to BS 7671:2008 table 4E4B

| Conductor cross-sectional area | Two-core cables, d.c. | Two-core cable, single-phase a.c. | | | Three- or four-core cable, three-phase a.c. | | |
|--------------------------------|-----------------------|-----------------------------------|-------|-------|---|-------|-------|
| 1 | 2 | 3 | | | 4 | | |
| mm ² | mV/A/m | mV/A/m | | | mV/A/m | | |
| 1.5 | 31 | 31 | | | 27 | | |
| 2.5 | 19 | 19 | | | 16 | | |
| 4 | 12 | 12 | | | 10 | | |
| 6 | 7.9 | 7.9 | | | 6.8 | | |
| 10 | 4.7 | 4.7 | | | 4.0 | | |
| 16 | 2.9 | 2.9 | | | 2.5 | | |
| | | r | x | z | r | x | z |
| 25 | 1.85 | 1.85 | 0.160 | 1.90 | 1.60 | 0.140 | 1.65 |
| 35 | 1.35 | 1.35 | 0.155 | 1.35 | 1.15 | 0.135 | 1.15 |
| 50 | 0.98 | 0.99 | 0.155 | 1.00 | 0.86 | 0.135 | 0.87 |
| 70 | 0.67 | 0.67 | 0.150 | 0.69 | 0.59 | 0.130 | 0.60 |
| 95 | 0.49 | 0.50 | 0.150 | 0.52 | 0.43 | 0.130 | 0.45 |
| 120 | 0.39 | 0.40 | 0.145 | 0.42 | 0.34 | 0.130 | 0.37 |
| 150 | 0.31 | 0.32 | 0.145 | 0.35 | 0.38 | 0.125 | 0.30 |
| 185 | 0.25 | 0.26 | 0.145 | 0.29 | 0.22 | 0.125 | 0.26 |
| 240 | 0.195 | 0.200 | 0.140 | 0.24 | 0.175 | 0.125 | 0.21 |
| 300 | 0.155 | 0.160 | 0.140 | 0.21 | 0.140 | 0.120 | 0.185 |
| 400 | 0.120 | 0.130 | 0.140 | 0.190 | 0.115 | 0.120 | 0.165 |

Note: r = conductor resistance at operating temperature

x = reactance

z = impedance



Rated Voltage




Standard



Flame Retardancy
IEC 60332-1-2




Reduced Fire Propagation
IEC 60332-3-24



Halogen Free
IEC 60754-1



Low Corrosivity
IEC 60754-2



Low Smoke Emission
IEC 61034-2




Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

Type Codes for LSZH Flame Retardant Power & Control Cables

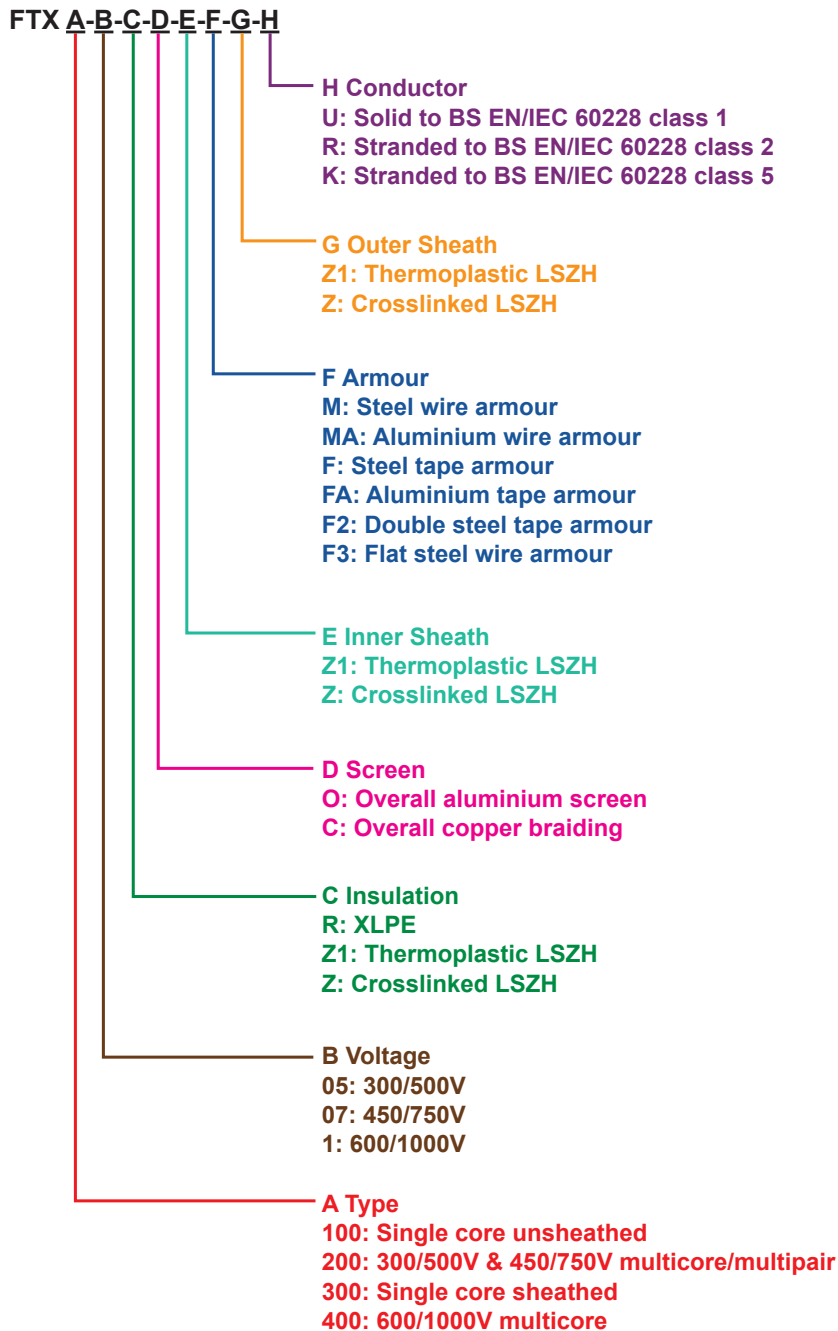

Technical Information for Fire Properties

FLAME RETARDANCE IN ACCORDANCE WITH DIFFERENT STANDARDS

The following standards specify a method for flame propagation test for single core cables. The single cable sample undergoes the flame action of a bunsen burner. The test only lasts few minutes.

The IEC 60332-1 standards are taken over as EN standards and transferred to national standards. Example: IEC 60332-1 becomes EN 60332-1 and introduced in Germany as DIN EN 60332-1.

Flame retardance in accordance with EN 60332:2004

EN 60332:2004 Tests on electrical and optical cables under fire conditions. The standard applies to single insulated wires (cables) and requires a vertical flame test with a maximum flame climb of 450mm. The test lasts between 1 and 8 minutes, depending on the cable diameter.

EN 60332-1-1:2004 / BS EN 60332-1-1:2004 / IEC 60332-1-1:2004 / DIN EN 60332-1-1:2004 / VDE 0482-1-1:2005-06 Test on electrical and optical cables under fire conditions. Test for a vertical flame propagation fo a single insulated wire or cables.

EN 60332-1-2:2004 / BS EN 60332-1-2:2004 / IEC 60332-1-2:2004 / DIN EN 60332-1-2:2004 / VDE 0482-1-2:2005-06 / CEI 60332-2-2 (CEI 20-35/2-2) Tests on electrical and optical fiber cables under fire conditions. Test for a verticalflame propagation for a single insulated wire or cable – Procedure for 1kW premixed flame.



This standard specifies a method of test for resistance to vertical flame propagation for a single insulated wire or cable. Part 1-1 specifies the test apparatus and Part 1-2 specifies the test procedure.

The cable sample is deemed to pass the test if the distance between the lower edge of the top support and the onset of charring is greater than 50mm. In addition, a failure shall be recorded if burning extends downward to a point greater than 540mm from the lower edge of the top support.

EN 60332-1-2:2004 specifies the use of 1kW premix flame and is for general use, except that the procedure may not be suitable for the testing of small insulated conductors or cables of less than 0.5mm sq cross section because the conductor melts before the test is completed, or for the testing of small optic fiber cables because the fiber will be broken before the test is completed. In this case, the procedure given by EN 60332-2-1/2 is recommended.

EN 60332-2-1:2004 / BS EN 60332-2-1:2004 / IEC 60332-2-1:2004 / DIN EN 60332-2-1:2004 / VDE 0482-



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

2-1:2005-06 Tests on electrical and optical cables under fire conditions. Test for a vertical flame propagation for a single small insulated wire or cable.

EN 60332-2-2:2004 / BS EN 60332-2-2:2004 / IEC60332-2-2:2004 / DIN EN 60332-2-2:2004 / VDE 0482-2-2:2005-06 / CEI 60332-2-2 (CEI 20-35/2-2) Test on electric and optical fiber cables under fire conditions. Tests for vertical flame propagation for a single small insulated wire or cable. Procedure for diffusion flame. This test applies to small dimensions cables.

This standard specifies a method of test for resistance to vertical flame propagation for a single insulated wire or cable. Part 2-1 specifies the test apparatus and Part 2-2 specifies the test procedure.

Flame retardance in accordance with NF C32-070-2.1(C2)

NF C32-070:2001 Insulated conductors and cables for installation - Classification tests on conductors and cables with regard to fire behavior.

NF C32-070 2.1 Procedure for 1 kW pre-mixed flame.

The NF F 32070 2.1 (Category C2) and IEC 60332-1-2 are very similar. The sole difference is the time during which the flame is applied.

Flame retardance in accordance with EN 50265-1:1999 (replaced by EN 60332)

EN 50265-1:1999 / BS EN 50265-1:1999 / DIN EN 50265-1:1999 / VDE 0482-265-1:1999-04 – Common test methods for cables under fire conditions. Test for resistance to a vertical flame propagation for a single insulated conductor or cable. Apparatus (Replaced by EN 60332-1-1:2004 and EN 60332-2-1:2004).

EN 50265-2-1:1999 / BS EN 50265-2-1:1999 / DIN EN 50265-2-1:1999 / VDE 0482-265-2-1:1999-04 – Common test methods for cables under fire conditions. Test for resistance to a vertical flame propagation for a single insulated conductor or cable. Part 2-1: Procedure 1kW pre-mixed flame (Replaced by EN 60332-1-2:2004).

EN 50265-2-2:1999 / BS EN 50265-2-2:1999 / DIN EN 50265-2-2:1999 / VDE 0482-265-2-2:1999-04 – Common test methods for cables under fire conditions. Test for resistance to a vertical flame propagation for a single insulated conductor or cable. Part 2-2: Procedure Diffusion flame (Replaced by EN 60332-2-2:2004).

Flame retardance in accordance with BS 4066 Part 1 & 2 (replaced by EN 60332)

BS 4066-2:1980 (superseded) – Tests on electric cables under fire conditions. Method of test on a single vertical insulated wire or cable.

This standard is no longer in force and is replaced by BS EN 50265-2-1 which was also superseded by BS EN 60332-1:2009.

Flame retardance in accordance with NBN C 30-004 (cat. F1)

NBN C 32-004 specifies a method of test for measuring the vertical flame propagation characteristics of a

single wire or cable. The cable specimen is deemed to have passed the test and categorized as F1 if after burning has ceased, the charred or affected portion does not reach within 50mm of the lower edge of the top clamp which is equivalent to 425mm above the point of flame application.

Flame retardance in accordance with IEEE 383

In the IEEE 383 test, cables are supported by a one foot wide vertical rack eight feet high. The cables are positioned in the centre six inches of the rack, spaced one-half diameter apart. The rack is centered in an eight foot enclosure. A ten inch ribbon burner ignites the cable with a 21kW (70000 BTU). The burner is positioned 2 feet above the floor and 9 to 12 inches of cables are exposed to direct flames for 20 minutes. Cables on which flame extends above the top of the 8 foot rack fail the test.

REDUCED FIRE PROPAGATION IN ACCORDANCE WITH DIFFERENT STANDARDS

These standards specify a method for fire propagation test for vertically mounted bunched cables. These tests simulate the chimney effect in vertical installation of bunch of cables. A certain number of cable sections with a length of 3.5m is fastened to a vertical ladder in an adapted chamber. The amount of combustible materials for cables and duration of flame application depends on the category the cable has to meet.

Resistance of the wires bundle arranged vertically to the spread of the flame should be such that after a certain time and stopping the source of ignition, flame is extinguished by itself and the length of charred fragments will not exceed 2.5m in height measured above the lower edge of the burner.



Reduced fire propagation in accordance with IEC 60332-3

This test is the most common one to verify the behaviour of a cables for the fire propagation. The cables are installed on a bunch of vertical ladder inside a metal cabinet and undergo the action of a ribbon flame at 750°C. The standard is subdivided in several parts that differ one from the other for the quantity of cable to be installed, the installation mode and the flame application time.

EN 60332-3-10:2009 / BS EN 60332-3-10:2009 / IEC 60332-3-10 ed1.1 / DIN EN 60332-3-10:2009 / VDE 0482-332-3-10:2010-08 – Common test methods for cables under fire conditions. Tests on electric and optical fiber cables under fire conditions - Part 3-10: Test for vertical flame spread of vertically mounted bunched wires or cables.

EN 60332-3-21:2009 / BS EN 60332-3-21:2009 / IEC 60332-3-21 ed1.1 / DIN EN 60332-3-21 / VDE 0482-332-3-21:2010-08 / CEI EN 60332-3-21:2009 (CEI 20-22/3-1)– Procedures. Tests on electric and optical fiber cables under fire conditions - Part 3-21: Test for vertical flame spread of vertically-mounted bunched wires or cables - Category A . F/R
-Installation in one layer (front).



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

- Installation in two layers (front and rear)
- The quantity of the Installed cable is equal to 7 litres/m of combustible materials for cables
- The time of application of the flame is 40 minutes

EN 60332-3-22:2009 / BS EN 60332-3-22:2009 / IEC 60332-3-22 ed1.1 / DIN EN 60332-3-22:2009 / VDE 0482-332-3-22:2010-08 / CEI EN 60332-3-22:2009 (CEI 20-22/3-2)– Procedures. Tests on electric and optical fiber cables under fire conditions - Part 3-22: Test for vertical flame spread of vertically-mounted bunched wires or cable - Category A

- Installation in one layer (front).
- The quantity of the installed cable is equal to 7 litres/m of combustible materials for cables
- The time of application of the flame is 40 minutes

EN 60332-3-23:2009 / BS EN 60332-3-23:2009 / IEC 60332-3-23 ed1.1 / DIN EN 60332-3-23:2009 / VDE 0482-332-3-23:2010-08 / CEI EN 60332-3-23:2009 (CEI 20-22/3-3)– Procedures. Tests on electric and optical fiber cables under fire conditions - Part 3-23: Test for vertical flame spread of vertically-mounted bunched wires or cables - Category B


- Installation in one layer (front).
- The quantity of the installed cable is equal to 3.5 litres/m of combustible materials for cables
- The time of application of the flame is 40 minutes

EN 60332-3-24:2009 / BS EN 60332-3-24:2009 / IEC 60332-3-24 ed1.1 / DIN EN 60332-3-24:2009 / VDE 0482-332-3-24:2010-08 / CEI EN 60332-3-24:2009 (CEI 20-22/3-4) – Procedures. Tests on electric and optical fiber cables under fire conditions - Part 3-24: Test for vertical flame spread of vertically-mounted bunched wires or cables - Category C

- Installation in one layer (front).
- The quantity of the installed cable is equal to 1.5 litres/m of combustible materials for cables
- The time of application of the flame is 20 minutes

EN 60332-3-25:2009 / BS EN 60332-3-25:2009 / IEC 60332-3-25 ed1.1 / DIN EN 60332-3-25: 2009 / VDE 0482-332-3-25:2010-08 / CEI EN 60332-3-25:2009 (CEI 20-22/3-5)– Procedures. Tests on electric and optical fiber cables under fire conditions - Part 3-25: Test for vertical flame spread of vertically-mounted bunched wires or cables - Category D

- Installation in one layer (front).
- The quantity of the installed cable is equal to 0.5 litres/m of combustible materials for cables
- The time of application of the flame is 20 minutes.

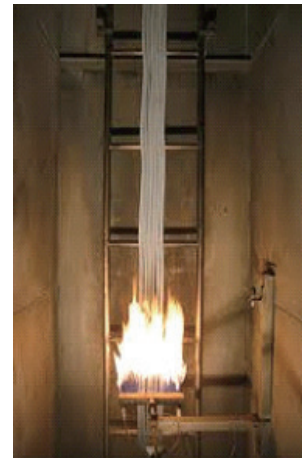

Summary of test condition:

| IEC | 60332-3-21 | 60332-3-22 | | | 60332-3-23 | | 60332-3-24 | | 60332-3-25 | |
|--|--|---------------------------------------|--|-----------------|------------------|--|------------------|--|------------------|-----|
| BS EN 50266 | 50266-2-1 | 50266-2-2 | | | 50266-2-3 | | 50266-2-4 | | 50266-2-5 | |
| CEI | 20-22/3-1 | 20-22/3-2 | | | 20-22/3-3 | | 20-22/3-4 | | 20-22/3-5 | |
| Category | AF/R | A | | | B | | C | | D | |
| Conductor cross-sections mm ² | >35 | >35 | ≤35 | | >35 | ≤35 | >35 | ≤35 | >35 | ≤35 |
| NMV (litres per metre of cable) | 7 | 7 | | | 3.5 | | 1.5 | | 0.5 | |
| Minimum length of test pieces (m) | 3.5 | 3.5 | | | 3.5 | | 3.5 | | 3.5 | |
| Standard ladder (500 mm wide): • number of layers • maximum width of test sample | 1front+1rear 300mm | ≥1front 300mm | 1front 300mm | - - | ≥1front 300mm | 1front 300mm | ≥1front 300mm | 1front 300mm | ≥1front 300mm | |
| Wide ladder (800 mm wide): • number of layers • maximum width of test sample | - - | - - | - - | 1front 600mm | - - | - - | - - | - - | - - | |
| Positioning of test pieces | Spaced 0.5×Diameter cable (Max.20mm) | Touching | Spaced 0.5×Diameter cable (Max.20mm) | | Touching | Spaced 0.5×Diameter cable (Max.20mm) | Touching | Spaced 0.5×Diameter cable (Max.20mm) | Touching | |
| Number of burners | 1 | 1 | 1 | 2 | 1 | | 1 | | 1 | |
| Ladder mounting | Front and rear | Front, Wider ladder for larger cables | | | Front | | Front | | Front | |
| Flame application time (min) | 40 | 40 | 40 | | 40 | | 40 | | 40 | |
| Test conditions | Wind speed: <8 m/s; Temperature: 5°C - +40°C | | | | | | | | | |
| Extent of the charred portion | ≤2.5m above the bottom edge of the burner, neither at the front nor at the rear of the ladder. | | | | | | | | | |

Reduced fire propagation in accordance with NF C32-070-2.2(C1)

NF C32-070 :2001 Insulated conductors and cables for installation.

-Classification tests on conductors and cables with regard to fire behavior.

A 1600mm vertically installed bundled of cable is exposed to the effects of a radiating oven (approx 830°C) and forced ventilation. Pilot flames arranged above the oven burn off the emitted gases. The test duration is 30 minutes, with the ventilation stopped for every 10 minutes during the flame application period. The cable sample is classified under Category C1 according to NF F 32070-2.2 if the carbonised part of the cable sample does not extend more than 0.8m above the upper base of the oven.



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

Depending on the damaged length, they can be further classified into 4 classes A, B, C and D according to NF F 16-101 as follows:

| Category | Test Result |
|----------|--|
| A | No damaged length from top of the oven in upper position. |
| B | Damaged length from top of oven in upper position not extending more than 50mm. |
| C | Damaged length from top of oven in upper position not extending more than 300mm |
| D | Damaged length from top of oven in upper position not extending above the top of the chimney |

Reduced fire propagation in accordance with EN 50266-1, EN 50266-2-2, EN 50266-2-3, EN 50266-2-4.

EN 50266-1:2001 / BS EN 50266-1:2001 / DIN EN 50266-1:2001 / VDE 0482-266-1:2001-09– Common test methods for cables under fire conditions. Test for vertical flame spread of vertically mounted bunched wires or cables - Part 1: Apparatus (Replaced by EN 60332-3-10:2009)

EN 50266-2-1:2001 / BS EN 50266-2-1:2001 / DIN EN 50266-2-1:2001 / VDE 0482-266-2-1:2001-09 / CEI EN 50266-2-1– Common test methods for cables under fire conditions. Test for vertical flame spread of vertically mounted bunched wires or cables - Part 2-1 : Procedures. Category A F/R (Replaced by EN 60332-3-21:2009)


EN 50266-2-2:2001 / BS EN 50266-2-2:2001 / DIN EN 50266-2-2:2001 / VDE 0482-266-2-2:2001-09 / CEI EN 50266-2-2– Common test methods for cables under fire conditions. Test for vertical flame spread of vertically mounted bunched wires or cables

- Part 2-2: Procedures. Category A (Replaced by EN 60332-3-22:2009)



EN 50266-2-3:2001 / BS EN 50266-2-3:2001 / DIN EN 50266-2-3:2001 / VDE 0482-266-2-3:2001-09 / CEI EN 50266-2-1– Common test methods for cables under fire conditions. Test for vertical flame spread of vertically mounted bunched wires or cables

- Part 2-3: Procedures. Category B (Replaced by EN 60332-3-23:2009)



EN 50266-2-4:2001 / BS EN 50266-2-4:2001 / DIN EN 50266-2-4:2001 / VDE 0482-266-2-4:2001-09 / CEI EN 50266-2-4:2001 – Common test methods for cables under fire conditions. Test for vertical flame spread of vertically mounted bunched wires or cables - Part 2-4: Procedures. Category C (Replaced by EN 60332-3-24:2009).

Reduced fire propagation in accordance with BS 4066-3


BS 4066-3:1994 (superseded) – Tests on electric cables under fire conditions. Tests on bunched wires or cables. This standard is no longer in force and is replaced by the BS EN 50266-1:2001

Reduced fire propagation in accordance with NBN C 32-004 (F2)

NBN C 32-004 specifies a method of test for measuring the vertical flame propagation characteristics of a bunch of cables. The cable specimen is deemed to have passed the test and categorized as F2 if after burning has ceased, the extent of charred or affected portion does not reach a height exceeding 2.5m above the bottom edge of the burner.

HALOGEN CONTENT TEST IN ACCORDANCE WITH DIFFERENT STANDARDS

In the event of a fire, many fumes are produced. This test is concerned with the possibilities of corrosive acid gases being released from halogen containing cables and the damage such cables can cause (to equipments). These standards specify a method for determination of the amount of halogen acid gas, evolved during combustion of compound.



Halogen content test in accordance with EN 50267-2-1

EN 50267-2-1:1998 / BS EN 50267-2-1:1999 / DIN EN 50267-2-1: 1999 / VDE 0482-267-2-1:1999-04 / CEI EN 50267-2-1:1999 (CEI 20-37/2-1) Common test methods for cables under fire conditions- Test on gases evolved during combustion of materials from cables- Part 2-1: Procedures. Determination of the amount of halogen acid gas. This part of the standard defines the method to measure the amount of halogen acid evolved and which should be expressed in hydrochloric acid. The amount of halogen acid contained in the test solution is determined by a titration method.

If the cables are described as zero halogen or halogen free, it is recommended that the hydrochloric acid yield should be less than 0.5%.

Halogen content test in accordance with IEC 60754-1

IEC 60754-1 ed 2.0 Common test methods for cables under fire conditions. Test on gases evolved during combustion of materials from cables. Part 1: Procedures. Determination of the amount of halogen acid gas. Basically, this is same as EN 50267-2-1.

Halogen content test in accordance with BS 6425-1

BS 6425-1:1990(superseded): Test on gases evolved during the combustion of materials from cables. Method for determination of amount of halogen acid gas evolved during combustion of polymeric materials taken from cables.

This standard is no longer in force and is replaced by the EN 50267-2-1.

ACID GAS EMISSION TEST IN ACCORDANCE WITH DIFFERENT STANDARDS

The following standards specify a method for determination of acidity of gas evolved during combustion of cables by measuring PH and conductivity. This test allows to determine the corrosivity of the acid gases generally halogens, that develop during the electric cable combustion.



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

Acid gas emission test in accordance with EN 50267-2-2

EN 50267-2-2:1999 / BS EN 50267-2-2:1999 / DIN EN 50267-2-2:1999 / VDE 0482-267-2-2:1999- 04/ CEI EN 50267-2-2:1999 (CEI 20-37/2-2). Common test methods for cables under fire conditions- Test on gases evolved during combustion of materials from cables- Part 2-2: Procedures. Determination of degree of acidity of gases for materials by measuring PH and conductivity.

The standard states that the pH and the conductivity of a test solution should be measured, using calibrated PH and conductivity meters.

If the cables are described as zero halogen or halogen free, it is recommended that at least both of the following requirements should be met for each of the individual materials of a cable:

-The PH value should not be less than 4.3 when related to 1 litre of water

-The conductivity should not be less than 10us/mm when related to 1 litre of water



EN 50267-2-3:1999 / BS EN 50267-2-3:1999 / DIN EN 50267-2-3:1999 / VDE 0482-267-2-3:1999-04 / CEI EN 50267-2-3:1999 (CEI 20-37/2-3). Common test methods for cables under fire conditions- Test on gases evolved during combustion of materials from cables- Part 2-3:Procedures. Determination of degree of acidity of gases for cables by determination of the weighted average of pH and conductivity.

The standard states that the pH and the conductivity of a test solution should be measured, using calibrated pH and conductivity meters. The results from the different components of the cable are then weighted.

Acid gas emission test in accordance with IEC 60754-2

IEC 60754-2 ed1.0 Test on gases evolved during combustion of electric cables - Part 2 : Determination of degree of acidity of gases evolved during combustion of materials taken from electric cables by measuring pH and conductivity.

Acid gas emission test in accordance with NF C32-074

NF C32-074 Common test methods for cables under fire conditions - Test on gases evolved during combustion of materials from cables. This standard is equivalent to IEC 60754-2

Acid gas emission test in accordance with BS 6425-2

BS 6425-2:1993 (superseded) test on gases evolved during the combustion of materials from cables. Determination of degree of acidity (corrosivity) of gases by measuring pH and conductivity.

This standard is no longer in force and is replaced by the EN 50267-2-2:1999.

Acid gas emission test in accordance with DIN VDE 0472-813 / VDE 0472-813:1994

DIN VDE 0472-813 / VDE 0472-813:1994 Corrosivity of combustion gases.

The standards are no longer in force and are replaced by the EN 50267-2-2 & VDE 0482-267-2-2.

SMOKE DENSITY TEST IN ACCORDANCE WITH DIFFERENT STANDARDS

The smoke density measurement taken from a material under fire conditions gives an indication of the visibility through the smoke. This is important as reduced visibility in a real fire situation makes it more difficult to escape from the fire thus increasing the threat to human life from the toxic gas, fumes and heat.


The following standards specify the method for measuring the generation of smoke from cables during fire.

Smoke density test in accordance with IEC 61034-1 & IEC 61034-2

IEC 61034-1:2005 / EN 61034-1:2005 / BS EN 61034-1:2005 / DIN EN 61034-1:2006 / VDE 0482-1034-1:2006 Measurement of smoke density of cables burning under defined conditions. Part 1: Test apparatus

IEC 61034-2:2005 / EN 61034-2:2005 / BS EN 61034-2:2005 / DIN EN 61034-2:2006 / VDE 0482-1034-2:2006 / CEI EN 61034-2:2006 (CEI 20-37/3-1) Measurement of smoke density of cables burning under defined conditions.

Part 2: Test procedure and requirements.

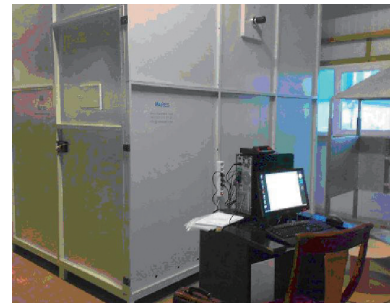

The standard specifies a method of measurement of smoke density of cables. Part 1 specifies the test apparatus and Part 2 specifies the test procedure.

The test is usually performed inside a chamber of 3mx3mx3m and the test is sometimes described as 3 metres cube test. The test is performed by monitoring the transmittance reduction of a white light beam, running from one side of the chamber to the other, at a set height, thus monitoring the build up of smoke inside the chamber. The minimum percentage of light transmittance is often used to determine if the cable has passed or failed the test, often a minimum light transmittance of 60% is applied in order to classify a cable as low smoke.

Smoke density test in accordance with NF C32- 073

NF C32 073 Common test methods for cables under fire conditions.

- Measurement of smoke density of cables burning under defined conditions.

This standard is equivalent to IEC 61034-2

Smoke density test in accordance with BS 7622-1 & BS 7622-2

BS 7622-1:1993 (superseded) – Measurement of smoke density of electric cables burning under defined conditions. Test apparatus.

BS 7622-2:1993 (superseded) – Measurement of smoke density of electric cables burning under defined conditions. Test procedure and requirements.



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

The standards are no longer in force and were replaced by the EN 50268-1:2000 and EN 50268-2:2000 even though they too were superseded by EN 61034-1:2005 and EN 61034-2:2005.

Smoke density test in accordance with EN 50268-1 & EN 50268-2

EN 50268-1:2000 / BS EN 50268-1:2000 / DIN EN 50268-1:2000 / VDE 0482-268-1:2000 (superseded) – Common test methods for cables under fire conditions. Measurement of smoke density of cable burning under defined conditions. Part 1: Apparatus.

EN 50268-2:2000 / BS EN 50268-2:2000 / DIN EN 50268-2:2000 / VDE 0482-268-2:2000 (superseded) – Common test methods for cables under fire conditions. Measurement of smoke density of cable burning under defined conditions. Part 2: Procedure.

The standards are no longer in force and are replaced by the EN 61034-1:2005 and EN 61034-2:2005. Although these standards have been withdrawn, they are still called upon in some specification documents such as in the London Underground specification 1-085.

Smoke density test in accordance with DIN VDE 0472-816 / VDE 0472-816:1994

DIN VDE 0472-816/VDE 0472-816:1994 Testing of cables, wires and flexible cords. Smoke Density.

The standards are no longer in force and are replaced by the EN 50268-1, VDE 0482-268-1, EN 50268-2 & VDE 0482-268-2 which are also replaced by the EN 61034-1:2005 and EN 61034-2:2005.

OXYGEN INDEX TEST IN ACCORDANCE WITH DIFFERENT STANDARDS

The oxygen index is defined as the minimum concentration of oxygen, expressed as volume percentage, in a mixture of oxygen and nitrogen that will just support combustion of a material initially at room temperature under specified test conditions.



Oxygen Index test in accordance with ASTM D 2863

ASTM D 2863-10 Measuring the minimum oxygen concentration to support candle-like combustion of plastics (Oxygen Index).

The test is performed in accordance with the procedure specified in ASTM 2863-95 using test piece cut from the outer sheath of the cable. The apparatus holds a small specimen which is clamped vertically in a tube in an atmosphere where the relative concentration of oxygen and nitrogen can be changed. The aim is to test the flammability of the sample with a small pilot flame to find the minimum oxygen concentration required to just sustain combustion of the sample.


Oxygen index test in accordance with ISO 4589-2

ISO4589-2:1996 Determination of burning behaviour by oxygen index Part 2: Ambient temperature test.

Specimens measuring 100mm long by 6mm wide are used for testing. The test is performed in accordance with the procedure specified in the standard.

TEMPERATURE INDEX TEST IN ACCORDANCE WITH DIFFERENT STANDARDS

This is a test for assessing the performance of a material when it is tested in accordance with BS2782: Part 1: Method 143a and 143b. The oxygen index of a material will drop when the temperature rises. When the temperature rises and the oxygen index drops to 21%, the material will burn automatically. This temperature is defined as temperature index. For example, the oxygen index of the coal at room temperature is 50% and when the temperature climbs to 150°C, its oxygen index drops to 21% and the coal will burn by itself automatically. The temperature index of the coal is defined as 150°C. In general, the temperature index of fire retardant cable exceeds 250°C.

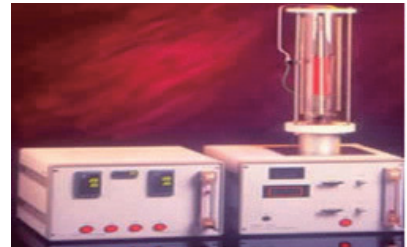

Temperature index test in accordance with BS 2782

BS 2782: Part 1:1989 Method 143a and 143b Temperature of materials. Determination of flammability. Specimens measuring nominally 100mm long by 6.5mm wide by 3mm thick are used for testing. The specimens are then tested in accordance with the test procedure specified in the standard.

Temperature index test in accordance with ISO 4589-3

ISO4589-3:1996 Determination of burning behaviour by oxygen index Part 3: Elevated temperature test. Specimens measuring 100mm long by 6mm wide are used for testing. The test is performed in accordance with the procedure specified in the standard.

TOXICITY TEST IN ACCORDANCE WITH DIFFERENT STANDARDS

Toxicity test in accordance with NES 02-713

Measuring a fume from a material exposed to a controlled fire conditions gives an indication of the fumes which may be produced in a real fire situation. A standard method of test for determining the toxicity of materials under fire condition is Defense Standard NES 02-713- Toxicity. This method gives the level of toxicity of the fumes produced from the material under test. During the test, the test specimen is heated via direct flame application at 1150°C.

The flame is applied via a bunsen burner with a flame height of between 100mm and 125mm formed with a methane gas and an external supply of compressed air. The specimen toxicity is determined from accurate pre-analysis weight (4pp) colorimetric tubes and ion chromatography.

The test may determine the following species: Hydrogen Bromide, Hydrochloric Acid, Hydrogen Fluoride, Formaldehyde, Nitrous gases, Carbon Monoxide, Carbon Dioxide, Acrylonitrile, Phenol, Hydrogen Sulphide, Sulphur Dioxide, Hydrocyanic Acid, Ammonia. The concentration in ppm for each gas detected are provided. The toxicity index of the specimens summates the toxic gases, taking into account of their level of danger to humans. The smaller the toxicity index, the better the product. A limit of 5 is often applicable.



Caledonian

FIRETOX LSZH Flame Retardant Power & Control Cables

www.caledonian-cables.co.uk www.addison-cables.com

Toxicity test in accordance with NF C 20-454

NF C 20-454 base environmental testing procedures. Fire behaviour. Analysis and titration of gases evolved during pyrolysis or combustion of materials used in electrotechnics. Exposure to abnormal heat or fire. Tube furnace method.

The test defined by this standard serves to define the conventional toxicity index (cti) of the gases emitted by the insulating or sleeving materials during combustion at 800°C.

Toxicity test in accordance with NF X 70-100

NF X 70-100 Fire Tests; Analysis of gaseous effluents.

The test is conducted within a tube furnace where the temperature is set at either 400°C, 600°C, 800°C (commonly 600°C is used for most of the materials or 800°C for some electrical products) for 40 minutes throughout the test by analysis of the toxicity index of the gases including CO, CO₂, HCl, HBr, HCN, HF and SO₂.





www.caledonian-cables.co.uk
sales@caledonian-cables.co.uk



www.addison-cables.com
sales@addison-cables.com

Address: Marchants Industrial Centre, Mill Lane,
Laughton, Lewes, East Sussex, BN8 6AJ, UK
Tel: 44-20 7419 5087
Fax: 44-20 7831 9489